

OG Lutron Panel (A)	
The Bill of Materials below should be ordered from: Specialty Lighting Group Mike Ricigliano mwr@splightline.com 860.767.0110 x221; 860-767-5008 (fax)	
Bill of Materials	
1	LCP-1XAA-1204ML-20 Dimming Panel
1	LCP-SA-1204ML-20 Dimming Panel
1	SD-4BI-WH-EGN Exterior Lighting Override
1	SD-SBI-WH-EGN Scene Selector
1	SD-4BI-WH-NS1 Engraving (Signs, Building Lights, Parking Lot, Flagpole/Security)
1	SD-SBI-WH-NS1 Engraving (Signs, Lunch, Dusk, Diner, Overnight)
1	Photocell with Shield
1	GRX-CBL-4BL-250 Communications Cable (250ft)

OG 1289 Site Survey - Commissioning Document.xlsx
Distribution Data - 2 rows

MAIN DISCONNECT 1200 AMPS					
MAIN DISTRIBUTION PANEL					
Left Breaker	Rating	Load Description	Right Breaker	Rating	Load Description
3	400	Panel C	2	100	Panel NCR
3	400	Panel KA	4	200	Panel A
5			6	200	Panel KB
7			8	600	Panel B

NOTES:

OG 1289 Site Survey - Commissioning Document.xlsx
Panel Schedule KB-2

PANEL RATING 225 Amps					
Breaker	Rating	Load	Breaker	Rating	Load
1	20		2	20	Receipt Line
3	20		4	20	
5	20	1TH Kettle 2	6	20	
7	20	1TH Kettle 2	8	20	
9	30		10	20	
11	30		12	20	
13	20		14	20	Steamwell - Server Line
15	20		16	20	Steamwell - Server Line
17	20		18	20	Steamwell - Server Line
19	20		20	20	Steamwell - Server Line
21	20		22	20	Spare
23	20	Spare	24	20	Spare
25	20	Spare	26	20	Spare
27	20	Spare	28	20	App Station Cooler
29	20		30	20	
31	20		32	20	
33	20		34	20	Spare
35	20		36	20	Spare
37	20		38	20	Spare
39	20	Spare	40	20	Spare
41	20	Spare	42	20	Spare

NOTES:

OG 1289 Site Survey - Commissioning Document.xlsx
Cover Page & Notes

CONTACT INFORMATION		
1903 N. Ross St. Johnson City, TN 37601-3115		
Phone	423-929-0137	
Fax	423-929-2557	
GM	Sonya L. Gray	
Estimator/Interior		
Note	Area	Comment
1	Emergency Lighting	Emergency lighting is landed on DM 1, breaker 14
2	Restroom Lighting	Mens restroom lighting is landed on Panel A, breaker 21. Womens restroom lighting is landed on Panel A, breaker 22
3	Restroom EM Lights	
4	Dimming Panel	Two Marlin Dimmer Panels, DM 1 located in East service area, DM 2 located in West service area
5	Strip Lights	No strip lights
7	MDP PANEL	MDP is located in electrical room, back side of building
6	Uplights/High Ceilings	Opened ceilings in kitchen or high ceilings
9	Time Clocks and Contactors	Time Clocks and Contactors are located in back office of kitchen area
10	Panel A	Panel A is located in back-west side of kitchen
11	Panel Y	
12	Special Notes	
13	Comments	For the purposes of this survey, restaurant faces North East.

OG 1289 Site Survey - Commissioning Document.xlsx
Panel A


PANEL RATING 225 Amps							
Breaker	Rating	Draw	Load	Breaker	Rating	Draw	Load
2	20	7.9	Kitchen Lgt/Cash Dash	2	20		
4	20	8.2	Kitchen Lgt	4	20	2.9	Bar Can Lgt
6	20	8.9	Spare	6	20	NW	Spare
8	20	8.4	Kitchen Lgt	8	20	NW	Spare
10	20	1.4	Kitchen Lgt	10	20	18.4	Rooftop and Outdoor Wall Lgt
11	20	0.7	Bar Printers	12	20	0.3	
13	20	2.0	Office Lgts & Break Room	14	20	0.3	Contactors
15	20			16	20	NW	Spare
17	20	0.2	Rooftop Receptacle	18	20	12.5	Road Sign
20	20	12.6	Rear and Right Roof Sign	20	20	8.1	Left Roof Sign
21	20	3.0	Men's Bathroom	22	30	9.3	Road Sign
23	20	2.7	Women's Bathroom	24	30	19.5	Rooftop and Outdoor Wall Lgt
25	20	0.0		26	20	12.0	Side and Front Outdoor Lgt
27	20	12.4	Pole Lights and Rooftop Lgts	28	20	4.5	Pole and Rooftop Lgt
29	20	6.4	Pole Lights and Rooftop Lgts	30	20	4.2	Pole and Rooftop Lgt
31	60	13.1	DA-2	32	60	19.4	DA-1
33	60	18.6	DA-2	34	60	8.4	DA-1
35	60	10.2	DA-2	36	60	13.7	DA-1
37	20		Spare	38	20		Spare
39	20		Spare	40	20		Spare
41	20		Spare	42	20		Spare

NOTES: NL = NO LOAD MEASURED NW = NO WIRE LANDED CKT DESCRIPTIONS COME FROM RESIDENT PANEL SCHEDULE

OG 1289 Site Survey - Commissioning Document.xlsx
Panel Schedule B

PANEL RATING 600 Amps					
Breaker	Rating	Load	Breaker	Rating	Load
1	100	AC-2	2	100	AC-1
3	100	AC-2	4	100	AC-1
5	100	AC-2	6	100	AC-1
7	100	AC-4	8	100	AC-2
9	100	AC-4	10	100	AC-2
11	100	AC-4	12	100	AC-2
13	20		14	20	
15	20		16	20	Spare
17	20		18	20	Spare
19	20		20	20	Spare
21	20		22	20	Spare
23	20		24	20	Spare
25	20	Spare	26	20	Spare
27	20	Spare	28	20	Spare
29	20	Spare	30	20	Spare
31	100	AC-5	32	20	Spare
33	100	AC-5	34	20	Spare
35	100	AC-5	36	20	Spare
37	20	Spare	38	20	Spare
39	20	Spare	40	20	Spare
41	20	Spare	42	20	Spare

NOTES:

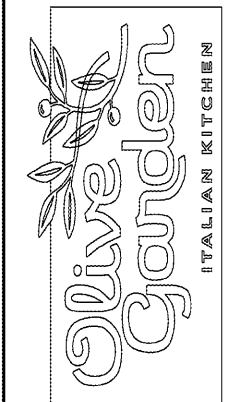

Order Plans

WWW.LDLINE.COM