


MAXIMUM ALLOWABLE PERSONS TO EXIT THIS DOOR:
68"/2" 340 PERSONS

MAXIMUM ALLOWABLE PERSONS TO EXIT THIS DOOR:
64"/2" 320 PERSONS

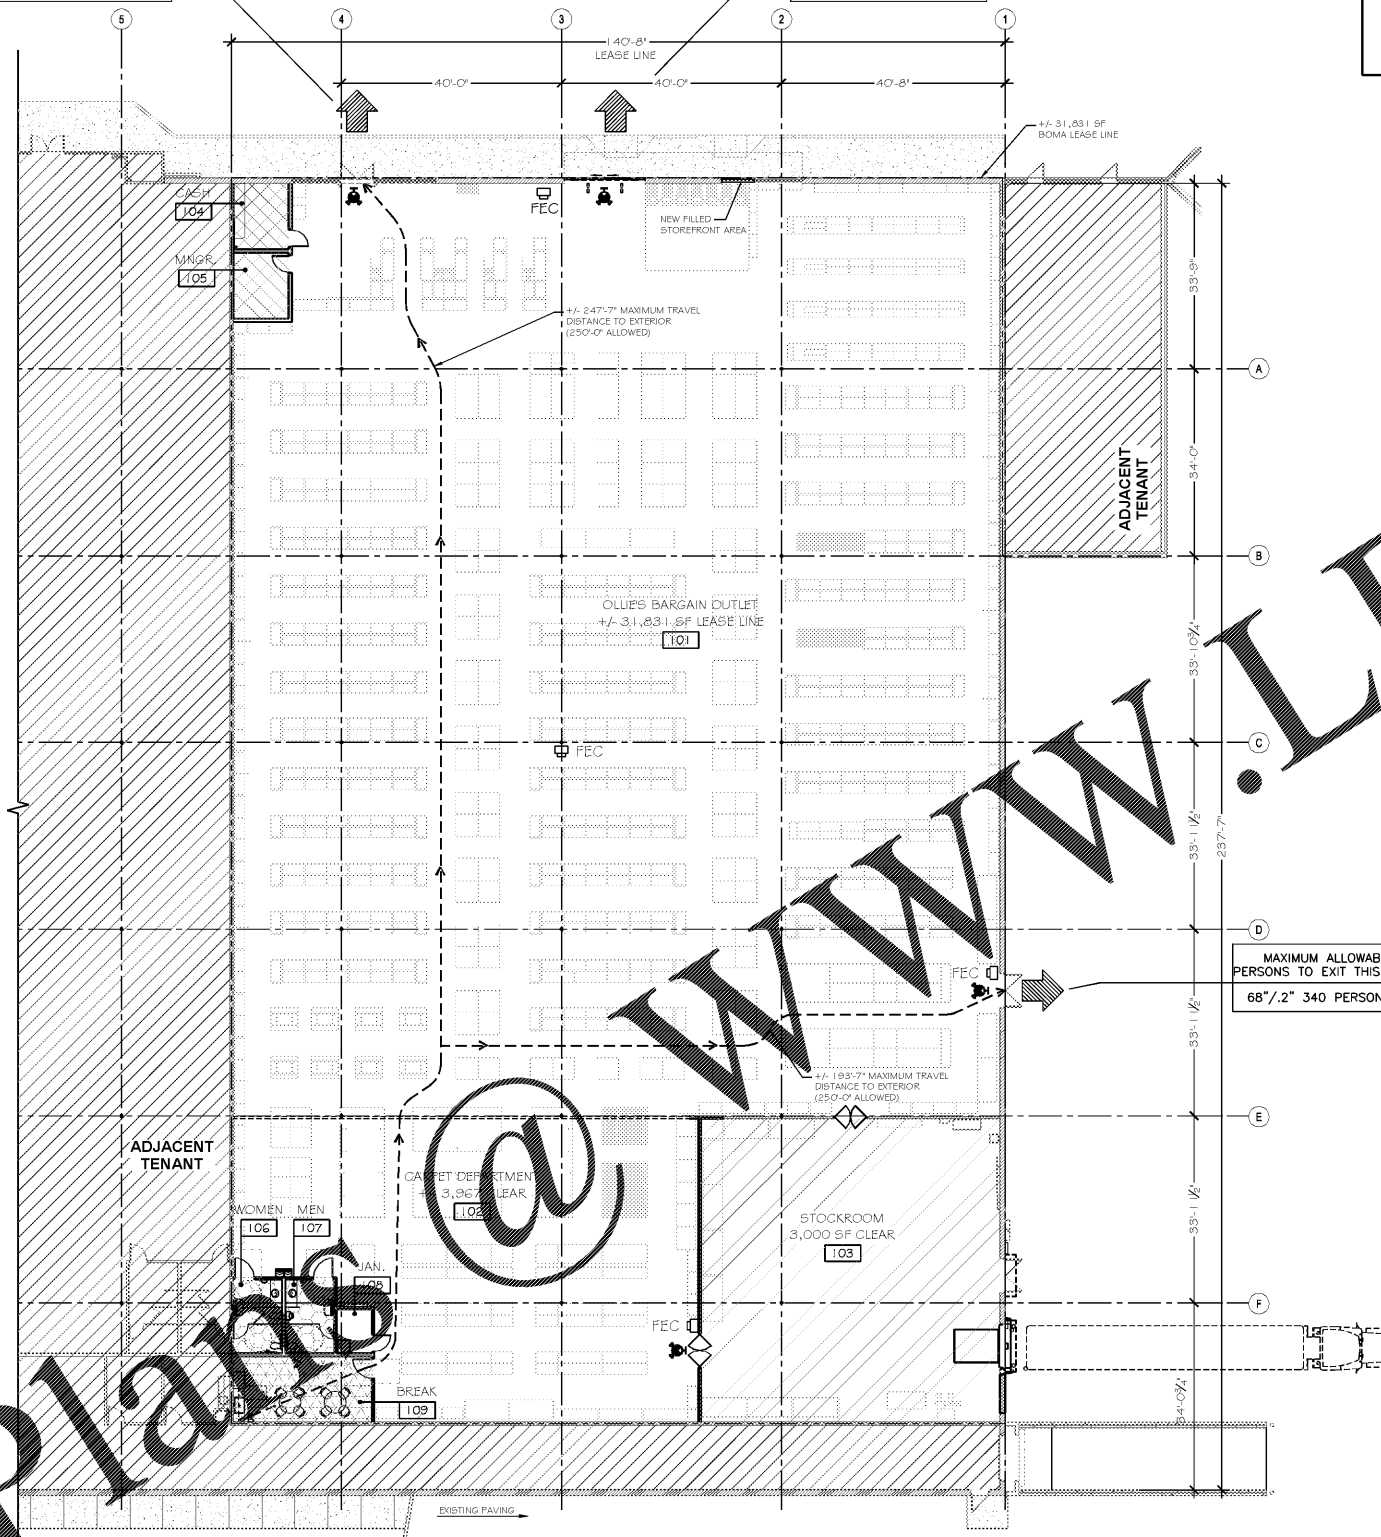

MAXIMUM ALLOWABLE PERSONS TO EXIT THIS DOOR:
68"/2" 340 PERSONS

1 LIFE SAFETY PLAN
1/16" = 1'-0"

PROJECT PROPERTIES

BUILDING PLAN REVIEW:
MERCANTILE

BUILDING PROPERTIES	
1. OCCUPANCY CLASSIFICATION: (IBC 2012) (NFPA 101) 2012	NEW MERCANTILE - CLASS C NEW MERCANTILE - CLASS C
2. CONSTRUCTION TYPE: (IBC 2012) A=PROTECTED B=UNPROTECTED (NFPA 101) 2012	TYPE II-B
3. AREA & HEIGHT LIMITATIONS: (IBC TABLE 503)	BUILDING HEIGHT = 1 STORY BOMA: = 1,831 SF
4. FIRE SUPPRESSION / ALARM: SUPPRESSION:	SPRINKLERED
5. FIRE PROTECTION REQUIREMENTS: (IBC TABLE 601)	
STRUCTURAL FRAME:	
COLUMNS & GIRDERS, BEAMS, TRUSSES	0 HOUR
BEARING WALLS:	
EXTERIOR:	0 HOUR
INTERIOR:	0 HOUR
NONBEARING WALLS & PARTITIONS:	
EXTERIOR:	(SEE IBC TABLE 602)
NONBEARING INTERIOR PARTITIONS:	0 HOUR
FLOOR CONSTRUCTION INCLUDING SUPPORTING BEAMS & JOISTS	0 HOUR
ROOF CONSTRUCTION INCLUDING SUPPORTING BEAMS & JOISTS	0 HOUR
USABLE GORGE	
WEATHER RESISTANT RATING FOR EXTERIOR WALLS:	
X < 10	N/A
10 ≤ X < 30	N/A
X ≥ 30	0 HOUR
VERTICAL SHAFTS: (IBC 713.4 & NFPA 7.1.3.2)	N/A
INCIDENTAL USES: (IBC TABLE 509)	N/A
TENANT SEPARATION: (IBC TABLE 508.4)	0-HOUR EXISTING TENANT SEPARATION WALLS PROVIDED AND MAINTAINED.
6. OCCUPANT LOAD: (NFPA TABLE 7.3.1.2)	TOTAL OCCUPANT LOAD 977 OCCUPANTS
7. EXIT CAPACITY: (NFPA TABLE 7.3.3.1)	977 OCC. x 0.2 = 195.4' REQUIRED
.2" PER OCCUPANT (LEVEL COMPONENTS): (FLOORS)	200-INCHES - PROVIDED
.3" PER OCCUPANT (STAIRWAYS):	N/A
8. COMMON PATH, DEAD-END, & TRAVEL DISTANCE LIMITS: (NFPA TABLE A.7.6)	
COMMON PATH LIMIT:	75 FT. (SPRINKLED) 0 FT.
DEAD-END LIMIT:	50 FT. (SPRINKLED) 0'-0" < 50 FT.
TRAVEL DISTANCE LIMIT:	250 FT. (SPRINKLED) 247'-9" < 250 FT. TOTAL TRAVEL DISTANCE

WALL LEGEND

- EXISTING WALL
- NEW CMU WALL
- NEW WALL
- NEW CEILING MOUNTED EXIT SIGN ENLIGHT WITH BATTERY BACK UP
- STANDARD FIRE EXTINGUISHER CABINET INSTALLED TO COMPLY WITH LOCAL FIRE CODE AND MAINTAINED PER NFPA 10 WITH 4" PROJECTION TYP., G.C. TO VERIFY LOCATION AND MINIMUM QUANTITY BE TEN (10) PER STORE; 10LB ABC DRY CHEMICAL.

DOOR LEGEND

- AREA NO WORK
- NEW DOOR
- EXISTING DOOR

OCCUPANCY LEGEND

TOTAL OCCUPANT LOAD = 977 OCCUPANTS

	SALES AREA (MERCANTILE) 28,353 GROSS SF/30= 945 OCCUPANTS
	BUSINESS 240 SF/100= 2 OCCUPANTS
	MERCANTILE STORAGE 3,000 GROSS SF/300= 10 OCCUPANTS STORAGE NOT REQUIRED TO BE FIRE RATED (NFPA 36.3.2.1.2)
	NO OCCUPANT LOAD, U.N.O OR AREAS W/ NO OCCUPANT LOAD
	BREAK ROOM ASSEMBLY USE 300 NET SF/15= 20 OCCUPANTS

NOTES:

SEE ELECTRICAL DRAWINGS FOR EMERGENCY LIGHTS, STROBES, PULL DOWN STATIONS, ALARM PANEL ETC.

PLUMBING FIXTURE COUNT

MERCANTILE - 28,353 S.F./30 PER OCCUPANT = 945 OCCUPANTS
STORAGE - 3,000 S.F./300 PER OCCUPANT = 10 OCCUPANTS TOTAL = 955 + 2 (BUSINESS) + 20 (ASSEMBLY) = 977 TOTAL OCCUPANTS
TOILET FIXTURES - 1 PER 500 MALE & 1 PER 500 FEMALE 488.50 MALES/500 = 0.977 (1 TOILET FIXTURE REQUIRED - 2 PROVIDED) 488.50 FEMALES/500 = 0.977 (1 TOILET FIXTURE REQUIRED - 2 PROVIDED)
DRINKING FOUNTAIN - 1 PER 1000 HIGHLOW DRINKING FOUNTAIN 977 OCCUPANTS/1000 = 0.977 (1 EACH REQUIRED - 1 EACH PROVIDED)
LAVATORIES - 1 PER 750 977 OCCUPANTS/750 = 1.27 488.50 MALES/750 = 0.65 (1 TOILET LAVATORY REQUIRED) 488.50 FEMALES/750 = 0.65 (1 LAVATORY REQUIRED)
SERVICE SINK - 1 SERVICE SINK REQUIRED - 1 SERVICE SINK PROVIDED



REVISIONS

NO.	DESCRIPTION

OLLIE'S BARGAIN OUTLET

SPALDING VILLAGE
1424 NORTH EXPRESSWAY, SUITE 146, 147A
GRIFFIN, GEORGIA 30223

PROJECT



SEPTEMBER 24, 2018

PERMIT DOCUMENTS
RELEASED FOR CONSTRUCTION

RELEASE DATE

LIFE SAFETY PLAN

DRAWING TITLE

© COPYRIGHT 2018
JEFFERSON BROWNE GRESHAM
ARCHITECTS INC.
THIS DOCUMENT AS AN
INSTRUMENT OF SERVICE
REMAINS THE PROPERTY OF
JEFFERSON BROWNE GRESHAM
ARCHITECTS AND NO PART THEREOF MAY BE
REPRODUCED IN ANY FORM
WITHOUT WRITTEN PERMISSION
FROM JEFFERSON BROWNE
ARCHITECTS

Drawn By: _____
Checked By: _____
PROJECT # A-002
18-0671 SHEET 03 OF 15

Order Plans