

REVISIONS	
NO.	DESCRIPTION


OLLIE'S BARGAIN OUTLET
 SPAULDING VILLAGE
 1424 NORTH EXPRESSWAY, SUITE 146, 147A
 GRIFFIN, GEORGIA 30223

GENERAL NOTES

- EACH SUPPLY DIFFUSER/REGISTER RUNOUT SHALL BE PROVIDED WITH A VOLUME DAMPER. REFER TO THE DIFFUSER TAKE-OFF DETAIL FOR ADDITIONAL INFORMATION.
- DRAWINGS ARE DIAGRAMMATIC ONLY; FINAL ROUTING OF DUCTWORK AND EQUIPMENT LOCATIONS SHALL BE DETERMINED IN THE FIELD. ADDITIONAL OFFSETS, ELBOWS, ETC. SHALL BE PROVIDED AND INSTALLED WITHOUT ADDITIONAL COST TO THE OWNER.
- WHERE EXISTING THERMOSTATS ARE IN GOOD WORKING ORDER, RELOCATE TO LOCATIONS SHOWN. WHERE THERMOSTATS ARE IN POOR CONDITION, REPLACE EXISTING THERMOSTAT WITH NEW PROGRAMMABLE THERMOSTAT IN LOCATION SHOWN.
- WHERE EXISTING DUCTWORK OR DIFFUSERS ARE OF LIKE KIND AND SIZE TO THOSE SHOWN ON THESE PLANS, THEY MAY BE RESTORED TO LIKE NEW CONDITION AND REUSED.

KEYNOTES

- NEW RTU-1 SHALL BE CONNECTED TO EXISTING DUCTWORK AND AIR DISTRIBUTION. EXISTING DIFFUSERS SHALL BE BALANCED TO TOTAL 5,000 CFM. CONTRACTOR SHALL CLEAN AND PATCH EXISTING DUCTWORK TO LIKE NEW CONDITION. CONTRACTOR SHALL CLEAN AND RESTORE EXISTING DIFFUSERS TO LIKE NEW CONDITION.
- ROUTE EXHAUST DUCT UP TO ROOF CAP WITH INSECT SCREEN.
- COORDINATE REMAINING RTU-2 AIR DISTRIBUTION WITH OWNER PRIOR TO INSTALLATION OR PURCHASE.

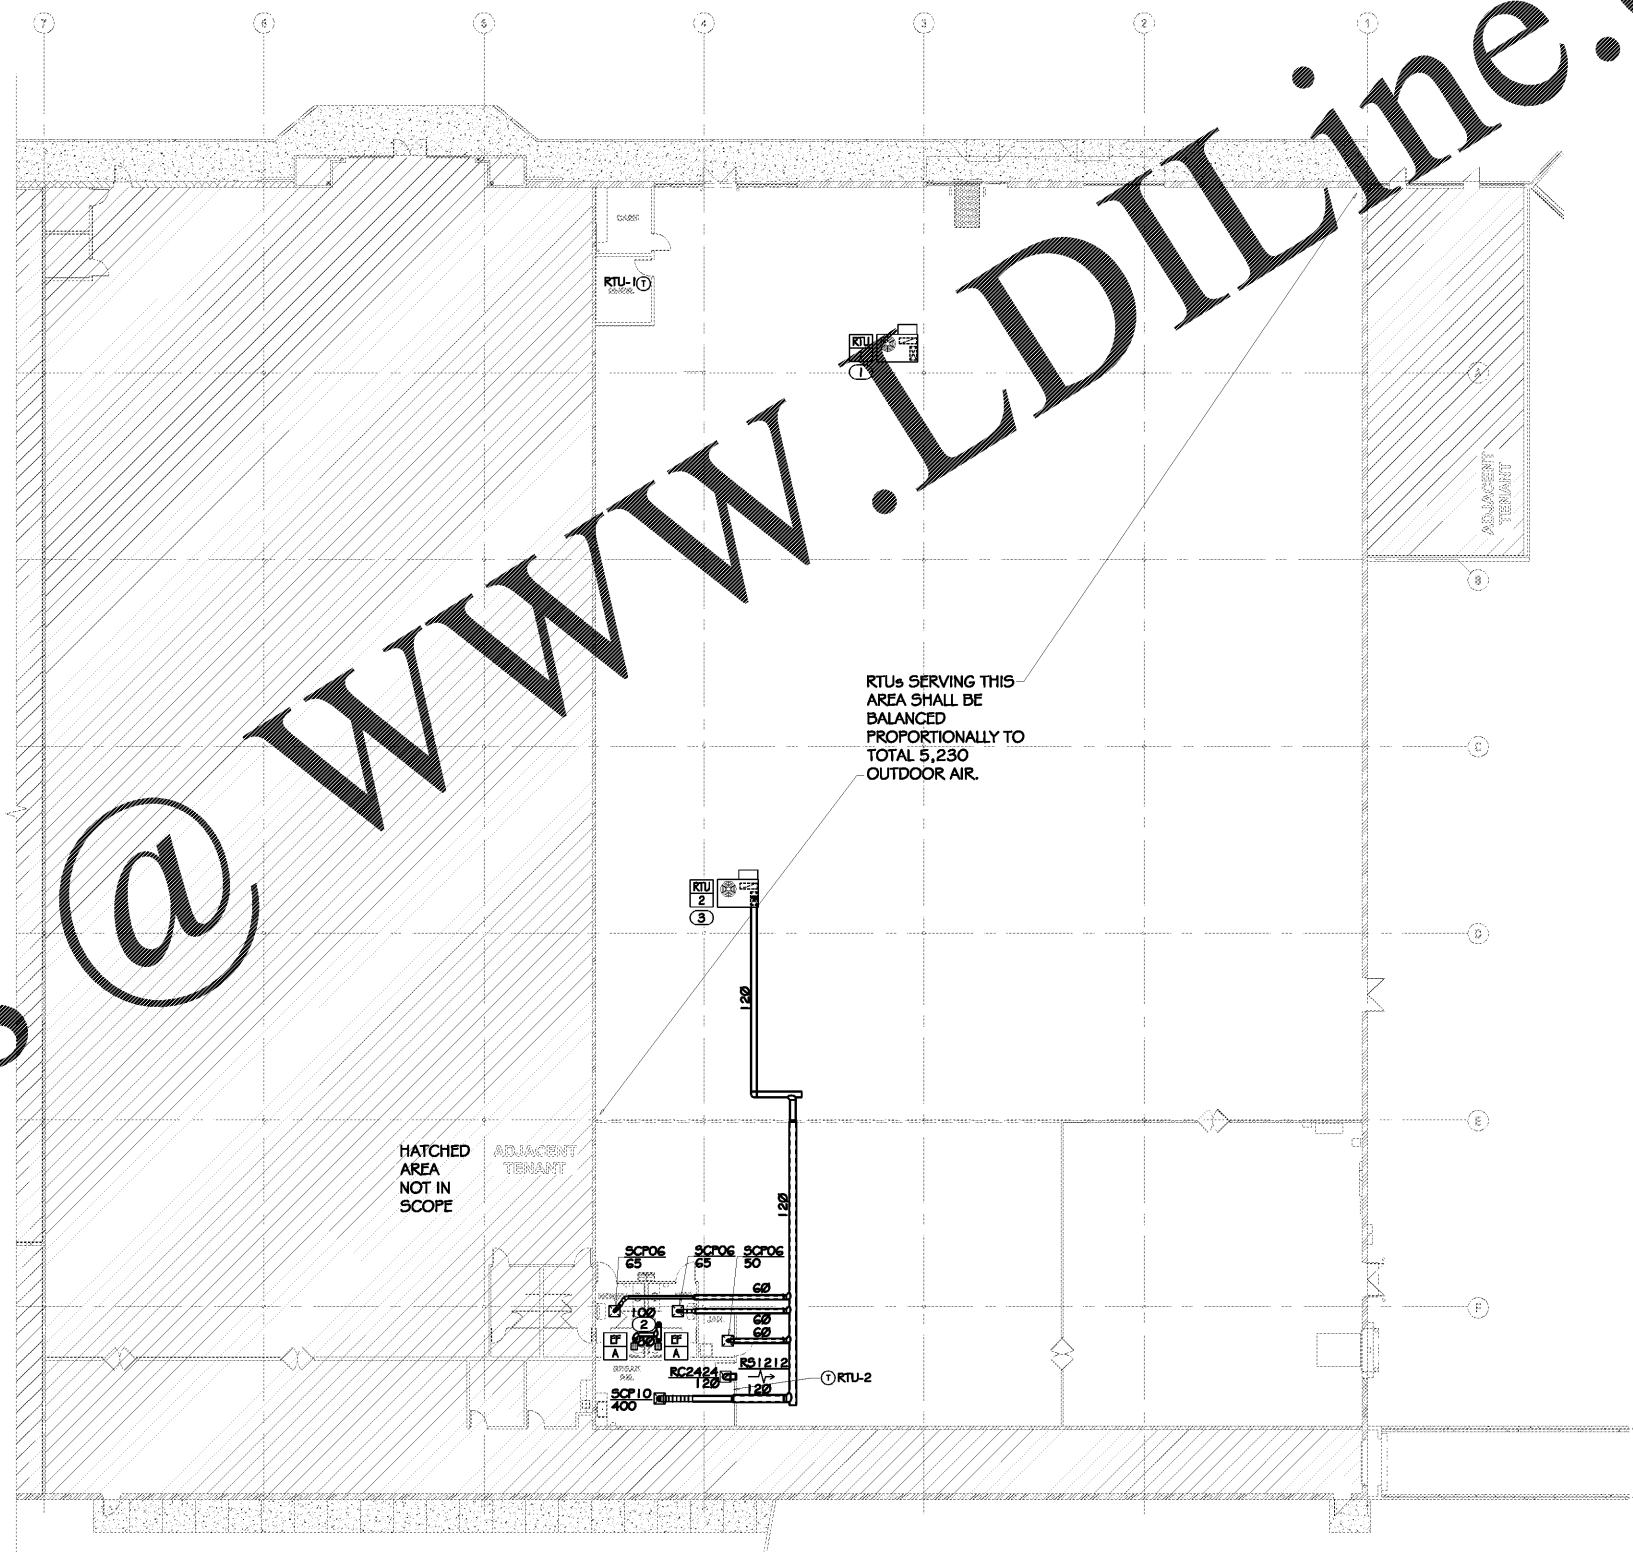

1 FLOOR PLAN
 SCALE: 1/16" = 1'-0"



SEAL
 SEPTEMBER 24, 2018
 100% CONSTRUCTION DOCUMENTS
 RELEASE DATE

FLOOR PLAN

DRAWING TITLE
 © COPYRIGHT 2018 JEFFERSON BROWNE GRESHAM ARCHITECTS INC. THIS DOCUMENT AS AN INSTRUMENT OF SERVICE REMAINS THE PROPERTY OF JEFFERSON BROWNE ARCHITECTS AND NO PART THEREOF MAY BE REPRODUCED IN ANY FORM WITHOUT WRITTEN PERMISSION FROM JEFFERSON BROWNE ARCHITECTS.

Drawn By: AC
 Checked By: **M-101**
 PROJECT # 18-2671 SHEET - of -

Order Plans @ WWW.LDILine.com