


CHAPTER 3: BUILDING BLOCKS

302 FLOOR OR GROUND SURFACES

302.1 CARPET, CARPET TILE OR CARPET TILE SHALL BE SECURELY ATTACHED AND SHALL HAVE A FIRM CUSHION, PAD, OR BACKING OR NO CUSHION OR PAD. CARPET OR CARPET TILE SHALL HAVE A LEVEL LOOP TEXTURED LUMP CUT PILE, OR LEVEL CUT/JUNCTION PILE TEXTURE. PILE HEIGHT SHALL BE 1/2 INCH (13 MM) MAXIMUM. EXPOSED EDGES OF CARPET SHALL BE FASTENED TO FLOOR SURFACES AND SHALL HAVE TRIM ON THE ENTIRE LENGTH OF THE EXPOSED EDGE. CARPET EDGE TRIM SHALL COMPLY WITH 303.



302.3 OPENINGS, OPENINGS IN FLOOR OR GROUND SURFACES SHALL NOT ALLOW PASSAGE OF A SPHERE MORE THAN 1/2 INCH (13 MM) DIAMETER EXCEPT AS ALLOWED IN 407.4.3, 409.4.3, 410.4, 810.5.3 AND 810.10. ELONGATED OPENINGS SHALL BE PLACED SO THAT THE LONG DIMENSION IS PERPENDICULAR TO THE DOMINANT DIRECTION OF TRAVEL.




302.4 OPENINGS, OPENINGS IN FLOOR OR GROUND SURFACES SHALL NOT ALLOW PASSAGE OF A SPHERE MORE THAN 1/2 INCH (13 MM) DIAMETER EXCEPT AS ALLOWED IN 407.4.3, 409.4.3, 410.4, 810.5.3 AND 810.10. ELONGATED OPENINGS SHALL BE PLACED SO THAT THE LONG DIMENSION IS PERPENDICULAR TO THE DOMINANT DIRECTION OF TRAVEL.



303 CHANGES IN LEVEL


303.1 VERTICAL CHANGES IN LEVEL OF 1/4 INCH (6.4 MM) HIGH MAXIMUM SHALL BE PERMITTED TO BE VERTICAL.



303.2 BEVELED CHANGES IN LEVEL BETWEEN 1/4 INCH (6.4 MM) HIGH MINIMUM AND 1/2 INCH (13 MM) HIGH MAXIMUM SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 1:2.




303.3 RAMP, CHANGES IN LEVEL GREATER THAN 1/2 INCH (13 MM) HIGH SHALL BE RAMPED, AND SHALL COMPLY WITH 405 OR 406.




304 TURNING SPACE


304.1 CIRCULAR SPACE, THE TURNING SPACE SHALL BE A SPACE OF 80 INCHES (1525 MM) DIAMETER MINIMUM. THE SPACE SHALL BE PERMITTED TO INCLUDE KNEE AND TOE CLEARANCE COMPLYING WITH 305.



304.2 T-SHAPED SPACE, THE TURNING SPACE SHALL BE A T-SHAPED SPACE WITHIN A 60 INCH (1525 MM) SQUARE MINIMUM WITH ARMS AND BASE 36 INCHES (915 MM) WIDE MINIMUM. EACH ARM OF THE T SHALL BE CLEAR OF OBSTRUCTIONS 12 INCHES (305 MM) MINIMUM IN EACH DIRECTION AND THE BASE SHALL BE CLEAR OF OBSTRUCTIONS 24 INCHES (610 MM) MINIMUM. THE SPACE SHALL BE PERMITTED TO INCLUDE KNEE AND TOE CLEARANCE COMPLYING WITH 306 ONLY AT THE END OF EITHER THE BASE OR ONE ARM.



304.3 DOOR SWING, DOORS SHALL BE PERMITTED TO SWING INTO TURNING SPACES.




305 CLEAR FLOOR OR GROUND SPACE


305.1 SIZE, THE CLEAR FLOOR OR GROUND SPACE SHALL BE 30 INCHES (760 MM) MINIMUM BY 48 INCHES (1220 MM) MINIMUM.



305.2 KNEE AND TOE CLEARANCE, UNLESS OTHERWISE SPECIFIED, CLEAR FLOOR OR GROUND SPACE SHALL BE PERMITTED TO INCLUDE KNEE AND TOE CLEARANCE COMPLYING WITH 306.



305.3 POSITION, UNLESS OTHERWISE SPECIFIED, CLEAR FLOOR OR GROUND SPACE SHALL BE POSITIONED EITHER FORWARD OR PARALLEL TO AN ELEMENT.




305.5 APPROACH, ONE FULL UNOBSTRUCTED SIDE OF THE CLEAR FLOOR OR GROUND SPACE SHALL ADJOIN AN ACCESSIBLE ROUTE OR ADJOIN ANOTHER CLEAR FLOOR OR GROUND SPACE.



305.7 MANEUVERING CLEARANCE, WHERE A CLEAR FLOOR OR GROUND SPACE IS LOCATED IN AN ALCOVE OR OTHERWISE CONFINED BY TWO OR MORE PARTS OF THREE SIDES, ADDITIONAL MANEUVERING CLEARANCE SHALL BE PROVIDED IN ACCORDANCE WITH 305.1.1 AND 305.7.2.




305.7.1 FORWARD APPROACH, ALCOVES SHALL BE 36 INCHES (915 MM) WIDE MINIMUM WHERE THE DEPTH EXCEEDS 24 INCHES (610 MM).




306 KNEE AND TOE CLEARANCE


306.1 MAXIMUM HEIGHT, TOE CLEARANCE SHALL EXTEND 25 INCHES (635 MM) MAXIMUM UNDER AN ELEMENT.



306.2 MINIMUM DEPTH, WHERE THE CLEARANCE IS REQUIRED AT AN ELEMENT AS PART OF A CLEAR FLOOR SPACE, THE TOE CLEARANCE SHALL EXTEND 17 INCHES (430 MM) MINIMUM UNDER THE ELEMENT.



306.3 ADDITIONAL CLEARANCE, SPACE EXTENDING GREATER THAN 8 INCHES (150 MM) BEYOND THE AVAILABLE KNEE CLEARANCE AT 9 INCHES (230 MM) ABOVE THE FINISH FLOOR OR GROUND SHALL NOT BE CONSIDERED TOE CLEARANCE.




306.3.5 WIDTH, TOE CLEARANCE SHALL BE 30 INCHES (760 MM) WIDE MINIMUM.




306.3 KNEE CLEARANCE


306.3.1 MAXIMUM DEPTH, KNEE CLEARANCE SHALL EXTEND 25 INCHES (635 MM) MAXIMUM UNDER AN ELEMENT AT 9 INCHES (230 MM) ABOVE THE FINISH FLOOR OR GROUND.



306.3.2 MINIMUM DEPTH, WHERE KNEE CLEARANCE IS REQUIRED UNDER AN ELEMENT AS PART OF A CLEAR FLOOR SPACE, THE KNEE CLEARANCE SHALL BE 11 INCHES (280 MM) DEEP MINIMUM AT 9 INCHES (230 MM) ABOVE THE FINISH FLOOR OR GROUND, AND 9 INCHES (230 MM) DEEP MINIMUM AT 27 INCHES (685 MM) ABOVE THE FINISH FLOOR OR GROUND.



306.3.5 WIDTH, KNEE CLEARANCE SHALL BE 30 INCHES (760 MM) WIDE MINIMUM.



307 PROTRUSING OBJECTS

307.1 PROTRUSING OBJECTS, OBJECTS WITH LEADING EDGES MORE THAN 27 INCHES (685 MM) AND NOT MORE THAN 8 INCHES (203 MM) ABOVE THE FINISH FLOOR OR GROUND SHALL PROTRUDE 4 INCHES (100 MM) MAXIMUM HORIZONTALLY INTO THE CIRCULATION PATH.



307.2 POST MOUNTED PROTRUDING OBJECTS

307.2.1 POST MOUNTED PROTRUDING OBJECTS SHALL BE PERMITTED TO PROTRUDE 4 1/2 INCHES (115 MM) MAXIMUM, EXCEPT FOR HANDRAILS AND OTHER HANDRAILS.



307.3 OVERHANGING OBSTRUCTIONS

307.3.1 OVERHANGING OBSTRUCTIONS, OVERHANGING OBSTRUCTIONS SHALL NOT EXCEED 27 INCHES (685 MM) MINIMUM AND 80 INCHES (2030 MM) MAXIMUM ABOVE THE FINISH FLOOR OR GROUND, WHERE A SIGN OR OTHER OBSTRUCTION IS MOUNTED BETWEEN POSTS OR PLYONS SHALL NOT EXCEED 27 INCHES (685 MM) ABOVE THE FINISH FLOOR OR GROUND.




307.4 GUARDRAILS

307.4.1 GUARDRAILS, GUARDRAILS SHALL BE PROVIDED WHERE THE VERTICAL CLEARANCE IS LESS THAN 80 INCHES (2030 MM) HIGH. THE LEADING EDGE OF SUCH GUARDRAIL OR BARRIER SHALL BE LOCATED 27 INCHES (685 MM) MAXIMUM ABOVE THE FINISH FLOOR OR GROUND.



307.5 DOOR CLOSERS AND DOOR STOP

307.5.1 DOOR CLOSERS AND DOOR STOP, DOOR CLOSERS AND DOOR STOP SHALL BE PERMITTED TO BE 78 INCHES (1980 MM) MINIMUM ABOVE THE FINISH FLOOR OR GROUND.

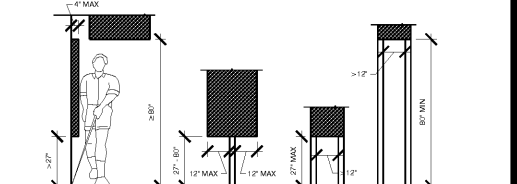

403.5.3 PASSING SPACES, AN ACCESSIBLE ROUTE WITH A CLEAR WIDTH LESS THAN 80 INCHES (1525 MM) SHALL PROVIDE PASSING SPACES AT INTERVALS OF 300 FEET (91 M) MAXIMUM. PASSING SPACES SHALL BE EITHER A SPACE 80 INCHES (1525 MM) MINIMUM BY 80 INCHES (1525 MM) MINIMUM, OR AN INTERSECTION OF TWO WALKING SURFACES PROVIDING A T-SHAPED SPACE COMPLYING WITH 304.2.2 WHERE THE BASE AND ARMS OF THE T-SHAPED SPACE EXTEND 48 INCHES (1220 MM) MINIMUM BEYOND THE INTERSECTION.




404 DOORS, DOORWAYS, AND GATES

404.1 CLEAR WIDTH, CLEAR WIDTH, CLEAR WIDTH SHALL PROVIDE A CLEAR WIDTH OF 32 INCHES (815 MM) MINIMUM. CLEAR OPENINGS OF DOORWAYS WITH SWINGING DOORS SHALL BE MEASURED BETWEEN THE FACE OF THE DOOR AND THE STOP, WITH THE DOOR OPEN 90 DEGREES. OPENINGS MORE THAN 24 INCHES (610 MM) DEEP SHALL PROVIDE A CLEAR OPENING OF 36 INCHES (915 MM) MINIMUM. THERE SHALL BE NO PROJECTIONS INTO THE REQUIRED CLEAR OPENING WIDTH LOWER THAN 34 INCHES (865 MM) ABOVE THE FINISH FLOOR OR GROUND. PROJECTIONS INTO THE CLEAR OPENING WIDTH BETWEEN 34 INCHES (865 MM) AND 80 INCHES (2030 MM) ABOVE THE FINISH FLOOR OR GROUND SHALL NOT EXCEED 4 INCHES (100 MM).



404.2.3 RECESSED DOORS AND GATES, MANEUVERING CLEARANCES AT RECESSED DOORS AND GATES

404.2.3.1 RECESSED DOORS AND GATES, MANEUVERING CLEARANCES AT RECESSED DOORS AND GATES SHALL BE PROVIDED WITH 302. CHANGES IN LEVEL ARE NOT PERMITTED. EXCEPTIONS: 1. SLOPES NOT STEEPER THAN 1:48 SHALL BE PERMITTED. 2. CHANGES IN LEVEL AT THRESHOLDS COMPLYING WITH 404.2.5 SHALL BE PERMITTED.




404.2.4 FLOOR OR GROUND SURFACE, FLOOR OR GROUND SURFACE FOR FORWARD APPROACH SHALL BE PROVIDED WITH 302. CHANGES IN LEVEL ARE NOT PERMITTED. EXCEPTIONS: 1. SLOPES NOT STEEPER THAN 1:48 SHALL BE PERMITTED. 2. CHANGES IN LEVEL AT THRESHOLDS COMPLYING WITH 404.2.5 SHALL BE PERMITTED.




404.2.5 THRESHOLDS, THRESHOLDS, IF PROVIDED AT DOORWAYS, SHALL BE 1/2 INCH (13 MM) HIGH MAXIMUM. RAISED THRESHOLDS AND CHANGES IN LEVEL AT DOORWAYS SHALL COMPLY WITH 302 AND 303.




404.2.6 DOORS IN SERIES AND GATES IN SERIES, THE DISTANCE BETWEEN TWO HINGED OR PIVOTED DOORS IN SERIES AND GATES IN SERIES SHALL BE 48 INCHES (1220 MM) MINIMUM PLUS THE WIDTH OF DOORS OR GATES SWINGING INTO THE SPACE.




404.2.7 DOOR ANTI-GATE HARDWARE, HANDLES, KEYS, LATCHES, LOCKS, AND OTHER OPERABLE PARTS ON DOORS AND GATES SHALL COMPLY WITH 406.5. EXCEPT FOR THE RELEASE OF LATCH ON SELF-LATCHING DEVICES AT 54 INCHES (1370 MM) MAXIMUM ABOVE THE FINISH FLOOR OR GROUND PROVIDED THE SELF-LATCHING DEVICES ARE NOT ALSO SELF-LOCKING DEVICES AND OPERATED BY MEANS OF A KEY, ELECTRONIC OPERATOR, OR INTEGRAL COMBINATION LOCK.



404.2.8.1 DOOR CLOSERS AND GATE CLOSERS, DOOR CLOSERS AND GATE CLOSERS SHALL BE ADJUSTED SO THAT FROM AN OPEN POSITION OF 90 DEGREES, THE TIME REQUIRED TO MOVE THE DOOR TO A POSITION OF 15 DEGREES FROM THE LATCH IS 5 SECONDS MINIMUM.



404.2.8.2 SPRING HINGED DOORS AND GATE SPRING HINGES SHALL BE ADJUSTED SO THAT FROM THE OPEN POSITION OF 70 DEGREES, THE DOOR OR GATE SHALL MOVE TO THE CLOSED POSITION IN 1.5 SECONDS MINIMUM.



404.2.9 DOOR AND GATE OPENING FORCE, FIRE DOORS SHALL HAVE A MINIMUM OPENING FORCE ALLOWABLE BY THE APPROPRIATE ADMINISTRATIVE AUTHORITY. THE FORCE FOR PUSHING OR PULLING OPEN A DOOR OR GATE OTHER THAN FIRE DOORS SHALL BE AS FOLLOWS:


- 1. INTERIOR HINGED DOORS AND GATES: 5 POUNDS (22.2 N) MAXIMUM.
2. SLIDING OR FOLDING DOORS: 5 POUNDS (22.2 N) MAXIMUM.



404.2.10 DOOR AND GATE SURFACES, SWINGING DOOR AND GATE SURFACES WITHIN 10 INCHES (255 MM) OF THE FINISH FLOOR OR GROUND MEASURED VERTICALLY SHALL HAVE A SMOOTH SURFACE ON THE PULL SIDE EXTENDING 12 INCHES (305 MM) FROM THE BOTTOM SMOOTH SURFACE HEIGHT REQUIREMENT.



404.2.11 VISION LIGHTS, DOORS, GATES, AND SIDE LIGHTS ADJACENT TO DOORS OR GATES, CONTAINING ONE OR MORE GLAZING PANELS THAT PERMIT VIEWING THROUGH THE PANELS SHALL HAVE THE BOTTOM CORNER OF EACH GLAZED PANEL LOCATED 43 INCHES (1090 MM) MAXIMUM ABOVE THE FINISH FLOOR OR GROUND.



404.2.12 SLOPE, RAMP RUNS SHALL HAVE A RUNNING SLOPE NOT STEEPER THAN 1:12. EXCEPTION: SLOPES NOT STEEPER THAN 1:12 COMPLYING WITH TABLE 405.2 WHERE SUCH SLOPES ARE NECESSARY DUE TO SPACE LIMITATIONS.





TABLE 405.2 MAXIMUM RAMP SLOPE AND RISE FOR EXISTING SITE, BUILDINGS, AND FACILITIES

Table with 2 columns: SLOPE, MAXIMUM RISE. Rows include Steeper than 1:10 but not steeper than 1:8 (9 inches / 75 mm), Steeper than 1:12 but not steeper than 1:10 (8 inches / 150 mm).


405.1 ACCESSIBLE ROUTES

405.1.1 ACCESSIBLE ROUTES, ACCESSIBLE ROUTES SHALL CONSIST OF ONE OR MORE OF THE FOLLOWING COMPONENTS: WALKING SURFACES WITH A RUNNING SLOPE NOT STEEPER THAN 1:20. DOORWAYS, RAMPS, CURB RAMPS EXCLUDING THE FLARED SIDE, ELEVATORS, PLATFORM LIFTS, ALL COMPONENTS OF AN ACCESSIBLE ROUTE SHALL COMPLY WITH 303.




405.1.2 CLEAR WIDTH

405.1.2.1 CLEAR WIDTH, CLEAR WIDTH SHALL BE PROVIDED IN 405.2 AND 405.3.5. THE CLEAR WIDTH OF WALKING SURFACES SHALL BE 36 INCHES (915 MM) MINIMUM.



405.1.2.2 CLEAR WIDTH AT TURN

405.1.2.2.1 CLEAR WIDTH AT TURN, WHERE THE ACCESSIBLE ROUTE MAKES A 180 DEGREE TURN AROUND AN ELEMENT WHICH IS LESS THAN 48 INCHES (1220 MM) WIDE, CLEAR WIDTH SHALL BE 42 INCHES (1065 MM) MINIMUM APPROACHING THE TURN, 48 INCHES (1220 MM) MINIMUM AT THE TURN AND 42 INCHES (1065 MM) MINIMUM LEAVING THE TURN.




405.1.2.2.2 CLEAR WIDTH AT TURN (90 DEGREES)



405.1.2.2.3 CLEAR WIDTH AT TURN (OTHER THAN 90 AND 180 DEGREES)




405.1.2.2.4 CLEAR WIDTH AT TURN (90 DEGREES)




405.1.2.2.5 CLEAR WIDTH AT TURN (OTHER THAN 90 AND 180 DEGREES)



405.1.2.2 CLEAR WIDTH AT TURN, WHERE THE ACCESSIBLE ROUTE MAKES A 180 DEGREE TURN AROUND AN ELEMENT WHICH IS LESS THAN 48 INCHES (1220 MM) WIDE, CLEAR WIDTH SHALL BE 42 INCHES (1065 MM) MINIMUM APPROACHING THE TURN, 48 INCHES (1220 MM) MINIMUM AT THE TURN AND 42 INCHES (1065 MM) MINIMUM LEAVING THE TURN.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.




EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



EXCEPTION: WHERE THE CLEAR WIDTH AT THE TURN IS 60 INCHES (1525 MM) MINIMUM COMPLIANCE WITH 405.1.2.2 SHALL NOT BE REQUIRED.



404.2.4.4 FLOOR OR GROUND SURFACE, FLOOR OR GROUND SURFACE FOR FORWARD APPROACH SHALL BE PROVIDED WITH 302. CHANGES IN LEVEL ARE NOT PERMITTED. EXCEPTIONS: 1. SLOPES NOT STEEPER THAN 1:48 SHALL BE PERMITTED. 2. CHANGES IN LEVEL AT THRESHOLDS COMPLYING WITH 404.2.5 SHALL BE PERMITTED.



404.2.5 THRESHOLDS, THRESHOLDS, IF PROVIDED AT DOORWAYS, SHALL BE 1/2 INCH (13 MM) HIGH MAXIMUM. RAISED THRESHOLDS AND CHANGES IN LEVEL AT DOORWAYS SHALL COMPLY WITH 302 AND 303.



404.2.6 DOORS IN SERIES AND GATES IN SERIES, THE DISTANCE BETWEEN TWO HINGED OR PIVOTED DOORS IN SERIES AND GATES IN SERIES SHALL BE 48 INCHES (1220 MM) MINIMUM PLUS THE WIDTH OF DOORS OR GATES SWINGING INTO THE SPACE.

