- CONTRACTOR(S) SHALL VERIFY EXISTING CONDITIONS AND CORRELATE DIMENSIONS PRIOR TO PROVIDING THE WORK DETAILED IN THESE DRAWINGS. AND SHALL PROMPTLY NOTIFY THE ARCHITECT OF ANY DISCREPANCIES.

## REMODEL LIGHTING FIXTURE SCHEDULE

| SYMBOL | DESCRIPTION | MOUNTING |
|---|---|---|
| | 8'–0" SALES FIXTURE | TO MATCH EXISTING |
| | 4'–0" SALES FIXTURE | TO MATCH EXISTING |
| | 8'–0" SALES FIXTURE W/ WIRE GUARD | TO MATCH EXISTING |
| | 8'–0" PRE–SALES FIXTURE W/ WIRE GUARD | TO MATCH EXISTING |
| | 4'–0" PRE–SALES FIXTURE W/ WIRE GUARD | TO MATCH EXISTING |
| | NEW 2'X4' (PRISMATIC) | RECESSED |
| | TRACK WITH GIMBAL HEADS CATLOG # – NA1313 LAMPS – (1) GE 18W/4000K/25° DIMMABLE PAR38 LED MANUFACTURER – CON–TECH | SEE F3.1 PLAN |

1006.3 Emergency power for illumination. The power supply for means of egress illumination shall normally be provided by the premises' electrical supply.

In the event of power supply failure, an emergency electrical system shall automatically illuminate all of the following areas:

1. Aisles and unenclosed egress stairways in rooms and spaces that require two or more means of egress.
2. Corridors, interior exit stairways and ramps and exit passageways in buildings required to have two or more exits.
3. Exterior egress components at other than their levels of exit discharge until exit discharge is accomplished for building required to have two or more exits.
4. Interior exit discharge elements, as permitted in Section 1027.1 in buildings required to have two or more exits.
5. Exterior landings as required by Section 1008.1.6 for exit discharge doorways in buildings required to have two or more exits.

The emergency power system shall provide power for a duration of not less than 90 minutes and shall consist of storage batteries, unit equipment or an on–site generator. the installation of the emergency power system shall be in accordance with Section 2702.




| LIGHTING PLAN - BEVERAGE AREA | 03 |
|---|---|
| SCALE: | 1/4" = 1'-0" |

## LIGHTING PLAN NOTES

| NO. | DESCRIPTION |
|---|---|
| 42 | CONTRACTOR TO CONNECT CIRCUIT TO NEAREST AVAILABLE COMPATIBLE LIGHTING CIRCUIT AND CONTROLS. IT SHALL BE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO AMPROBE THE CIRCUIT PRIOR TO ADDING ADDITIONAL LOAD TO DETERMINE ADEQUATE CAPACITY. NO CIRCUIT SHALL EXCEED 16 AMPS. |

NOTE:
EXISTING LAMPS ARE LED. GC TO ORDER LED LAMPS WITH THE OPTIMUM "A" FIXTURES.

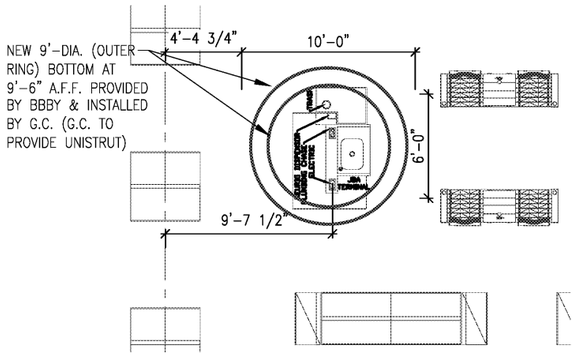


| FLOOR PLAN LIGHTING | 01 |
|---|---|
| SCALE: | 1/16" = 1'-0" |




| LIGHTING PLAN - FOOD PREP ROOM | 02 |
|---|---|
| SCALE: | 1/4" = 1'-0" |

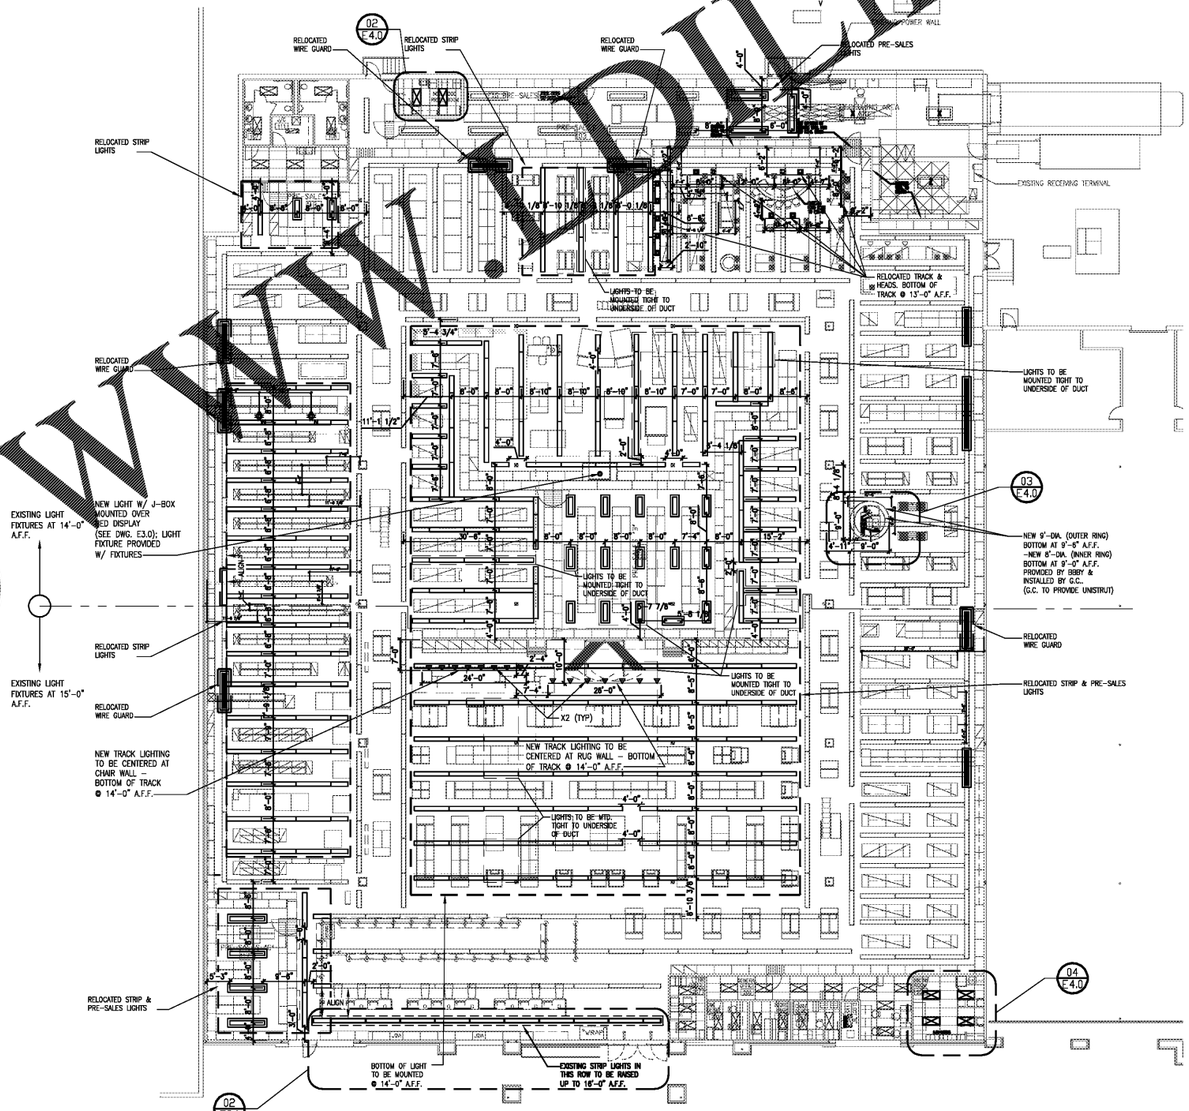


| LIGHTING PLAN - BREAK ROOM | 04 |
|---|---|
| SCALE: | 1/4" = 1'-0" |

Order Plans @ WWW.DLine.com

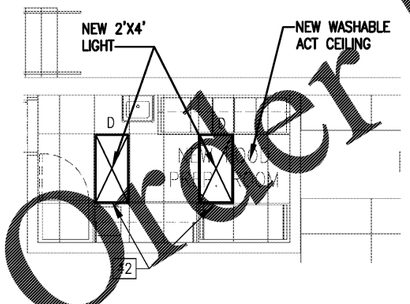BED BATH & BEYOND
Beyond any store of its kind.
BED BATH & BEYOND
CORPORATE OFFICES:
650 LIBERTY AVE
UNION, NJ 07083
(908) 688–0888 (OFFICE)
(908) 688–0295 (FAX)
PROJECT NAME & LOCATION:
# 103 ALPHARETTA, GA
6050 NORTH POINT PARKWAY
ALPHARETTA, GA 30022

| REVISIONS: | DATE: |
|---|---|
| OWNER REVIEW | 09/13/18 |
| PERMIT SET | 09/25/18 |
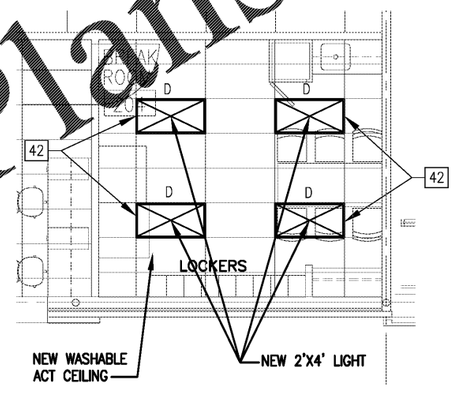
| ARCH. PROJECT # | BBB PROJECT # |
|---|---|
| | |
| DRAWN: | CHECKED: |
| NI | GW |

DRAWING TITLE:
LIGHTING PLAN

E4.0