


Order Plans @ WWW.LDILLING.COM

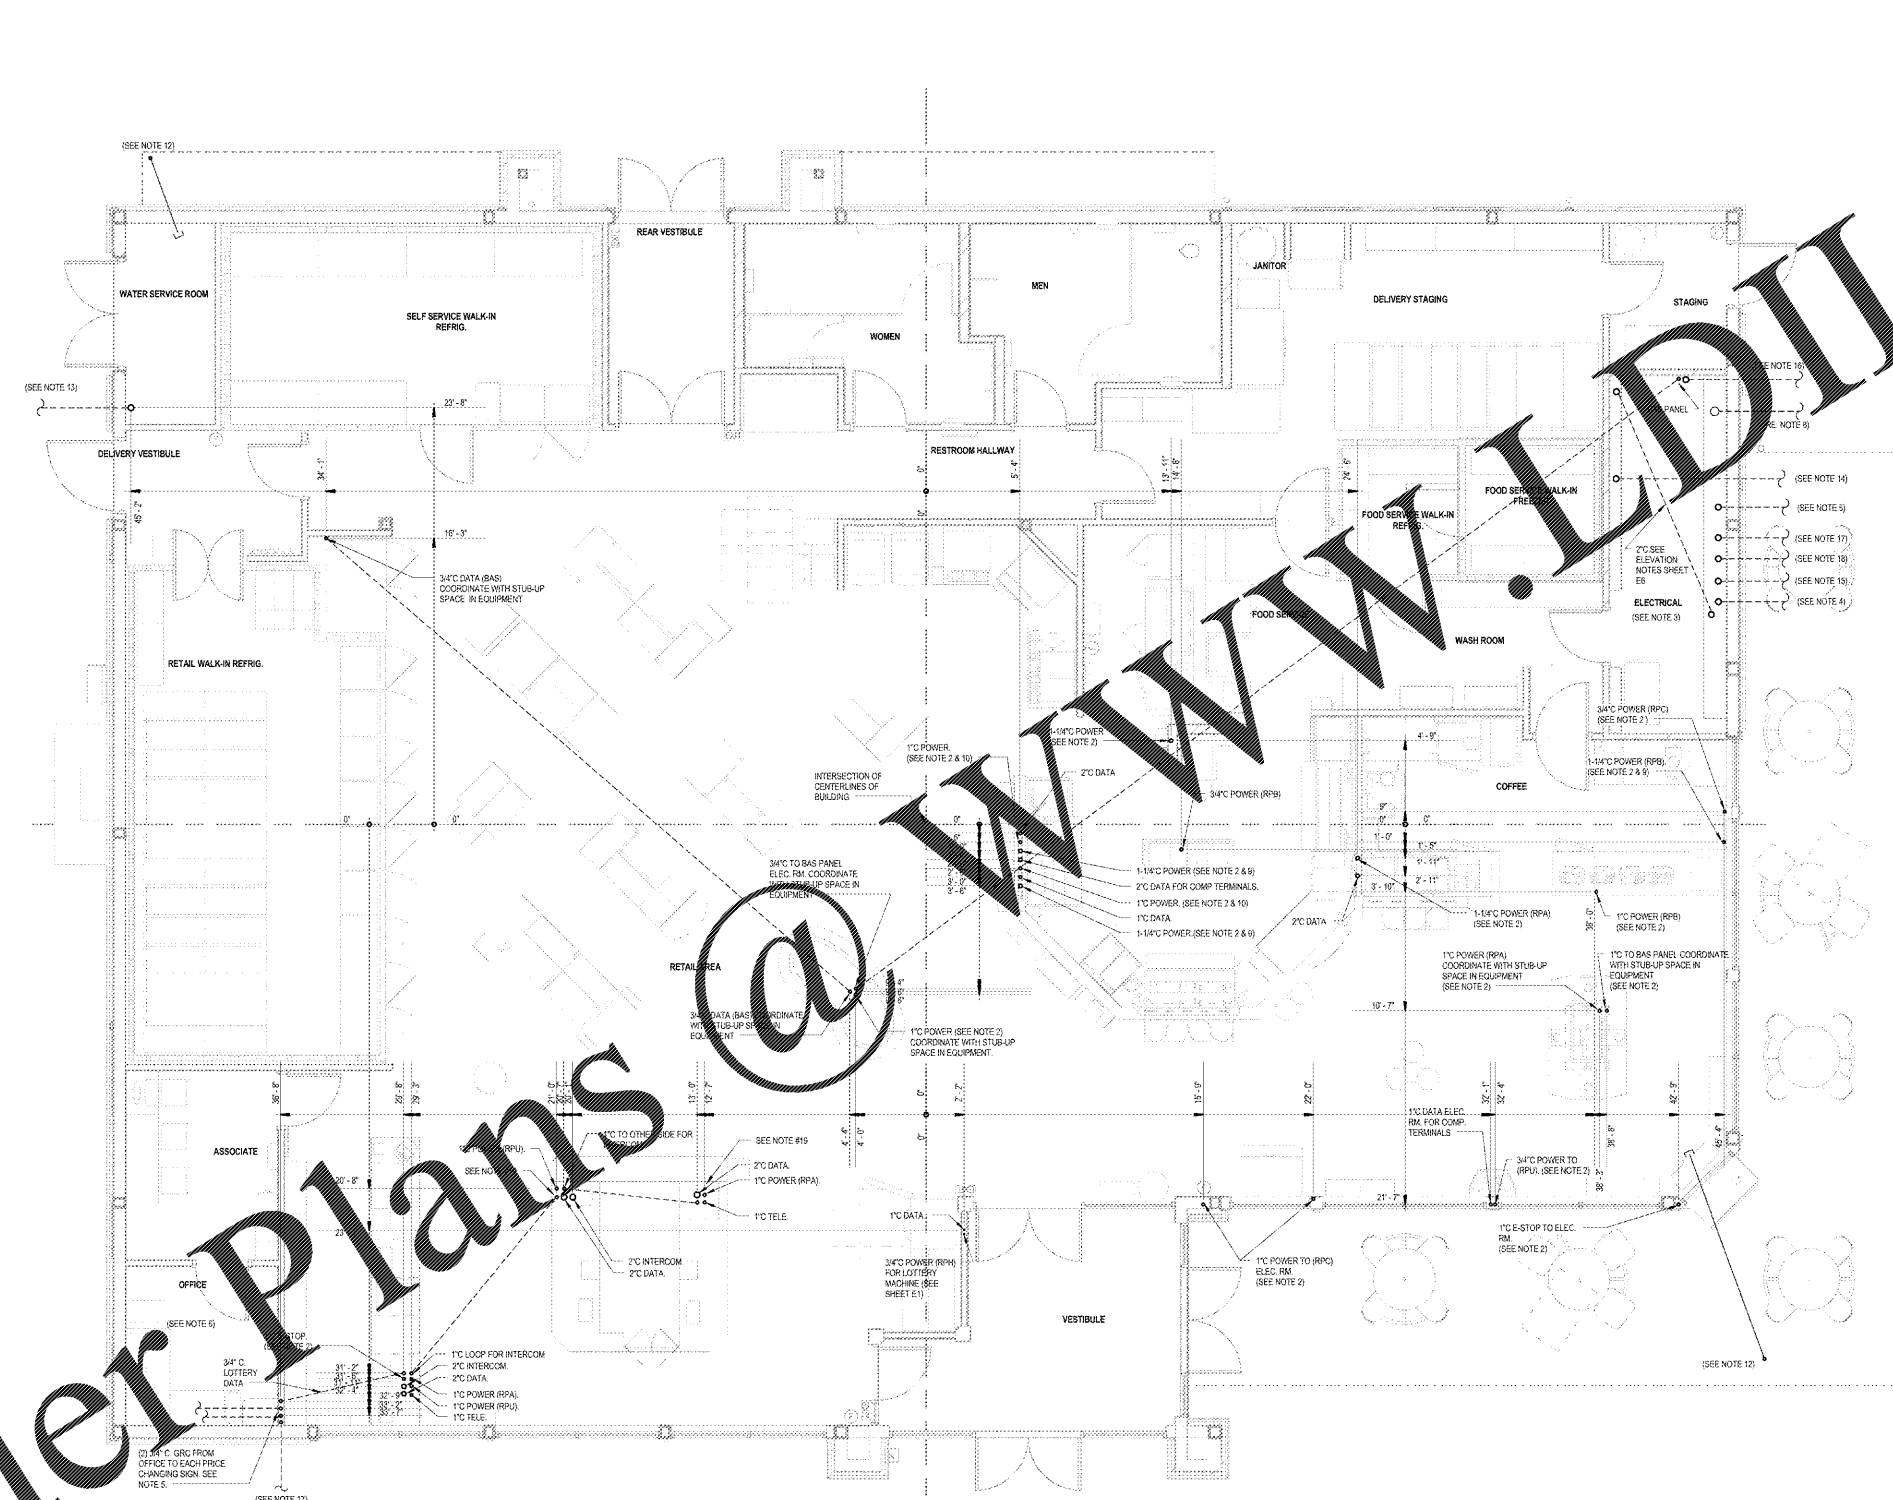


GENERAL NOTES:

- REFER TO DRAWINGS FOR ROOF PLAN AND ADDITIONAL ELECTRICAL REQUIREMENTS AND EQUIPMENT CONNECTIONS.
- REFER TO DRAWING FOR ADDITIONAL ELECTRICAL ROOM INFO. COORDINATE CONDUIT REQUIREMENTS WITH THE SITE AND PETROLEUM CONTRACTORS.
- INSTALL CONDUITS AND CONDUITS IN ACCORDANCE WITH NEC REQUIREMENTS FOR VOLTAGE DROPPING AND SIZING.
- THIS PROJECT HAS LARGE QUANTITIES OF UNDERGROUND CONDUITS. COORDINATE WITH ALL OTHER TRADES FOR REQUIRED DEPTHS FOR UNDERGROUND CONDUITS. PROVIDE ALL OTHER TRADES WITH DISCRETE CONDUIT MARKING TO AVOID CONFLICTS.
- THE ELECTRICAL CONTRACTOR SHALL EXTEND ALL ELECTRICAL CONDUITS FROM THE STORE TO THE EDGE OF THE CONCRETE CANOPY PAD AND TANK PAD. PETROLEUM CONTRACTOR SHALL COORDINATE THE HEIGHT OF THE SEAL OFF FITTINGS WITH THE OFFICE CONTRACTOR. GENERAL CONTRACTOR TO COORDINATE WITH THE OFFICE CONTRACTOR TO PROVIDE SEAL OFF FITTINGS IN COLLARS FOR CONDUIT RUNS TO LIGHTING INTERCOM.

ELECTRICAL PLAN NOTES:

- NOT USED.
 - CONDUIT TO BE RUN FROM FLOOR LOCATION TO ELECTRICAL ROOM OR CLOSEST WALL. FIELD COORDINATE LOCATION IN ELECTRICAL ROOM. REFER TO DRAWING FOR ADDITIONAL INFORMATION.
 - THE ELECTRICAL CONTRACTOR SHALL EXTEND ALL ELECTRICAL CONDUITS FROM THE STORE TO THE EDGE OF THE CONCRETE CANOPY PAD AND TANK PAD. PETROLEUM CONTRACTOR TO RUN ALL CONDUITS UNDER CANOPY PAD TO CANOPY COLLARS AND COORDINATE THE HEIGHT OF THE SEAL OFF FITTINGS WITH THE OPENINGS PROVIDED IN THE STEEL COLLARS. GENERAL CONTRACTOR TO COORDINATE AT SEAL OFF FITTINGS IN COLLARS FOR CONDUIT RUNS FOR LIGHTING AND INTERCOM.
 - THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL ALL CONDUITS TO THE 400 PUMP 1\"/>
- FROM MANAGER'S OFFICE:
 (1) 1\"/>
- FROM ELECTRICAL ROOMS:
 (1) 1\"/>
- ALSO PROVIDE (2) 1\"/>
- THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL IN THE MANAGER'S OFFICE A DEDICATED SIMPLEX OUTLET TO THE PRICE CHANGING SIGN. ELECTRICAL CONTRACTOR TO INSTALL FILTER PROVIDED BY SIGN CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL PROVIDE A 20 AMP WATERPROOF RECEPTACLE POWERED FROM A SEPARATE GENERAL PURPOSE CIRCUIT AT THE BASE OF EACH PRICE CHANGING SIGN.
 - THE CANOPY COLUMN CLOSET TO THE STORE SHALL BE USED FOR INTERCOM CAMERA AND CAMERA WIRE. THE CANOPY COLUMN FURTHEST FROM THE STORE SHALL BE USED FOR LIGHTING. SEE CANOPY ELECTRICAL PLANS FOR EXACT LOCATIONS.
 - CONDUITS TO BE COORDINATED WITH SITE SPECIFIC REQUIREMENTS:
 (2) 1\"/>
 - STUB-UP TO JUNCTION BOX. PROVIDE LIQUID TIGHT FLEXIBLE METAL CONDUIT FROM JUNCTION TO RECEPTABLES IN THIS AREA. MOUNT RECEPTABLES ON INSIDE FACE OF COUNTER BACKWALL. RECEPTABLE LOCATIONS SHALL ALLOW FOR EQUIPMENT TO FIT AGAINST COUNTER BACKWALL.
 - STUB-UP TO JUNCTION BOX. PROVIDE LIQUID TIGHT FLEXIBLE METAL CONDUIT FROM JUNCTION TO RECEPTABLES FOR CUSTOMER TERMINALS. (SEE SHEET E1). MOUNT RECEPTABLES ON OUTSIDE FACE OF COUNTER FRONTWALL.
 - NOT USED.
 - 1\"/>
 - 4\"/>
 - 1\"/>
 - (3) 1\"/>
 - IN ADDITION TO THOSE SHOWN ON SHEET E1 ADD (1) GASOLINE EMERGENCY SHUTOFF AT THE STREET SIDE OF THE GAS CANOPY. POSITION JUST OFF THE CURB ON THE GRASS, CENTERED ON THE GAS CANOPY. MOUNT AT 48\"/>
 - PROVIDE 1\"/>
 - IF REQUIRED FOR THIS PROJECT PROVIDE THE FOLLOWING: (1) 1\"/>
 - CONDUITS IN THIS AREA CAN BE BUNDLED UP TOGETHER AND DON'T NEED TO BE IN A ROW TO AVOID CONDUIT CONFLICTS. WHEN INSTALLING CABINETS, VERIFY LOCATION OF KNOCKOUTS IN BASE CABINET WITH CABINET VENDOR.

CONDUIT PLAN
 04 04 14



PROJECT NAME	CLIENT NAME
WAWA F85FB 2018.01 STORE #52715-LIT	WAWA
9021 STATE ROAD 52 HUDDSON, FL 34689	280 WEST BALTIMORE PIKE WAWA, PENNSYLVANIA 19083
PROJECT NUMBER	DATE
2101002	03/24/2017
PRE-BID REVIEW SET	08/29/2018
REV. 01 (01)	09/18/2018
REV. 02 (01)	09/18/2018
REV. 03 (01)	09/18/2018
REV. 04 (01)	09/18/2018
REV. 05 (01)	09/18/2018
REV. 06 (01)	09/18/2018
REV. 07 (01)	09/18/2018
REV. 08 (01)	09/18/2018
REV. 09 (01)	09/18/2018
REV. 10 (01)	09/18/2018
REV. 11 (01)	09/18/2018
REV. 12 (01)	09/18/2018
REV. 13 (01)	09/18/2018
REV. 14 (01)	09/18/2018
REV. 15 (01)	09/18/2018
REV. 16 (01)	09/18/2018
REV. 17 (01)	09/18/2018
REV. 18 (01)	09/18/2018
REV. 19 (01)	09/18/2018
REV. 20 (01)	09/18/2018
REV. 21 (01)	09/18/2018
REV. 22 (01)	09/18/2018
REV. 23 (01)	09/18/2018
REV. 24 (01)	09/18/2018
REV. 25 (01)	09/18/2018
REV. 26 (01)	09/18/2018
REV. 27 (01)	09/18/2018
REV. 28 (01)	09/18/2018
REV. 29 (01)	09/18/2018
REV. 30 (01)	09/18/2018
REV. 31 (01)	09/18/2018
REV. 32 (01)	09/18/2018
REV. 33 (01)	09/18/2018
REV. 34 (01)	09/18/2018
REV. 35 (01)	09/18/2018
REV. 36 (01)	09/18/2018
REV. 37 (01)	09/18/2018
REV. 38 (01)	09/18/2018
REV. 39 (01)	09/18/2018
REV. 40 (01)	09/18/2018
REV. 41 (01)	09/18/2018
REV. 42 (01)	09/18/2018
REV. 43 (01)	09/18/2018
REV. 44 (01)	09/18/2018
REV. 45 (01)	09/18/2018
REV. 46 (01)	09/18/2018
REV. 47 (01)	09/18/2018
REV. 48 (01)	09/18/2018
REV. 49 (01)	09/18/2018
REV. 50 (01)	09/18/2018
REV. 51 (01)	09/18/2018
REV. 52 (01)	09/18/2018
REV. 53 (01)	09/18/2018
REV. 54 (01)	09/18/2018
REV. 55 (01)	09/18/2018
REV. 56 (01)	09/18/2018
REV. 57 (01)	09/18/2018
REV. 58 (01)	09/18/2018
REV. 59 (01)	09/18/2018
REV. 60 (01)	09/18/2018
REV. 61 (01)	09/18/2018
REV. 62 (01)	09/18/2018
REV. 63 (01)	09/18/2018
REV. 64 (01)	09/18/2018
REV. 65 (01)	09/18/2018
REV. 66 (01)	09/18/2018
REV. 67 (01)	09/18/2018
REV. 68 (01)	09/18/2018
REV. 69 (01)	09/18/2018
REV. 70 (01)	09/18/2018
REV. 71 (01)	09/18/2018
REV. 72 (01)	09/18/2018
REV. 73 (01)	09/18/2018
REV. 74 (01)	09/18/2018
REV. 75 (01)	09/18/2018
REV. 76 (01)	09/18/2018
REV. 77 (01)	09/18/2018
REV. 78 (01)	09/18/2018
REV. 79 (01)	09/18/2018
REV. 80 (01)	09/18/2018
REV. 81 (01)	09/18/2018
REV. 82 (01)	09/18/2018
REV. 83 (01)	09/18/2018
REV. 84 (01)	09/18/2018
REV. 85 (01)	09/18/2018
REV. 86 (01)	09/18/2018
REV. 87 (01)	09/18/2018
REV. 88 (01)	09/18/2018
REV. 89 (01)	09/18/2018
REV. 90 (01)	09/18/2018
REV. 91 (01)	09/18/2018
REV. 92 (01)	09/18/2018
REV. 93 (01)	09/18/2018
REV. 94 (01)	09/18/2018
REV. 95 (01)	09/18/2018
REV. 96 (01)	09/18/2018
REV. 97 (01)	09/18/2018
REV. 98 (01)	09/18/2018
REV. 99 (01)	09/18/2018
REV. 100 (01)	09/18/2018