GENERAL NOTES:

1. ELECTRICAL CONTRACTOR TO PROVIDE CONDUIT, OUTLET/BACK BOX AND PULL STRING TO ABOVE ACCESSIBLE CEILING FOR ALL DEVICES, PANELS AND OTHER ELECTRICAL EQUIPMENT LOCATED IN WALL OR HARD CEILING SPACES.
2. ALL SECURITY SYSTEM PANELS, DEVICES, CAMERAS, SPEAKERS, AND ASSOCIATED WIRING SUPPLIED AND INSTALLED BY WAWA SECURITY CONTRACTOR
3. CONNECTION BETWEEN SECURITY CAMERA SYSTEM AND FIRE ALARM SYSTEM PANEL SHALL BE A 2 GAUGE 2 PAIR.
4. ELECTRICAL CONTRACTOR SHALL PROVIDE (1)18-2 AND (1)RG-59 COAX CABLE TO EACH SECURITY CAMERA FROM CAMERA POWER SUPPLY. PROVIDE 2 WHITE 18-2 CONDUCTORS FOR POWER SUPPLY.
5. PHONE LINES PROVIDED BY OTHERS. E.C. TO PROVIDE CONDUIT, BOX AND PULL STRING TO ACCESSIBLE ABOVE CEILING SPACE.
6. EXTERIOR WALL MOUNTED CAMERAS (NOT UNDER OVERHANGS) TO BE MOUNTED AT HEIGHT OF 14 FEET.

KEYNOTES: (X)

1. SECURITY CONTRACTOR TO MOUNT OUTSIDE CAMERAS 9 AND 10 VIEWING GAS PUMPS. FOR EXACT LOCATION OF DEVICES IN MANAGER'S OFFICE RM. SHEET A8.2
2. SECURITY CONTRACTOR SHALL MOUNT SECURITY [illegible] IN OFFICE CEILING [illegible] WALL OR METAL STUD [illegible]
3. TRASH DOOR [illegible] RELEASE BUTTON MOUNTED [illegible] SECOND SWITCH MOUNTED TO THE RIGHT OF CORE OPENING IN FIRST CABINET. [illegible] HEATED WITH ENCLOSURE.
4. DELIVERY [illegible] RELEASE BUTTONS MOUNTED IN OFFICE BELOW SECURITY [illegible] SECOND SWITCH MOUNTED TO THE LEFT OF CORE OPENING IN FIRST CABINET.
5. [illegible] SECURITY [illegible] FLOOR. FIELD COORDINATE EXACT LOCATION WITH [illegible] MANAGER.
6. FOR [illegible] SERVICE AREA, PROVIDE O/S TYPE RATED FOR COLD TEMPERATURE.

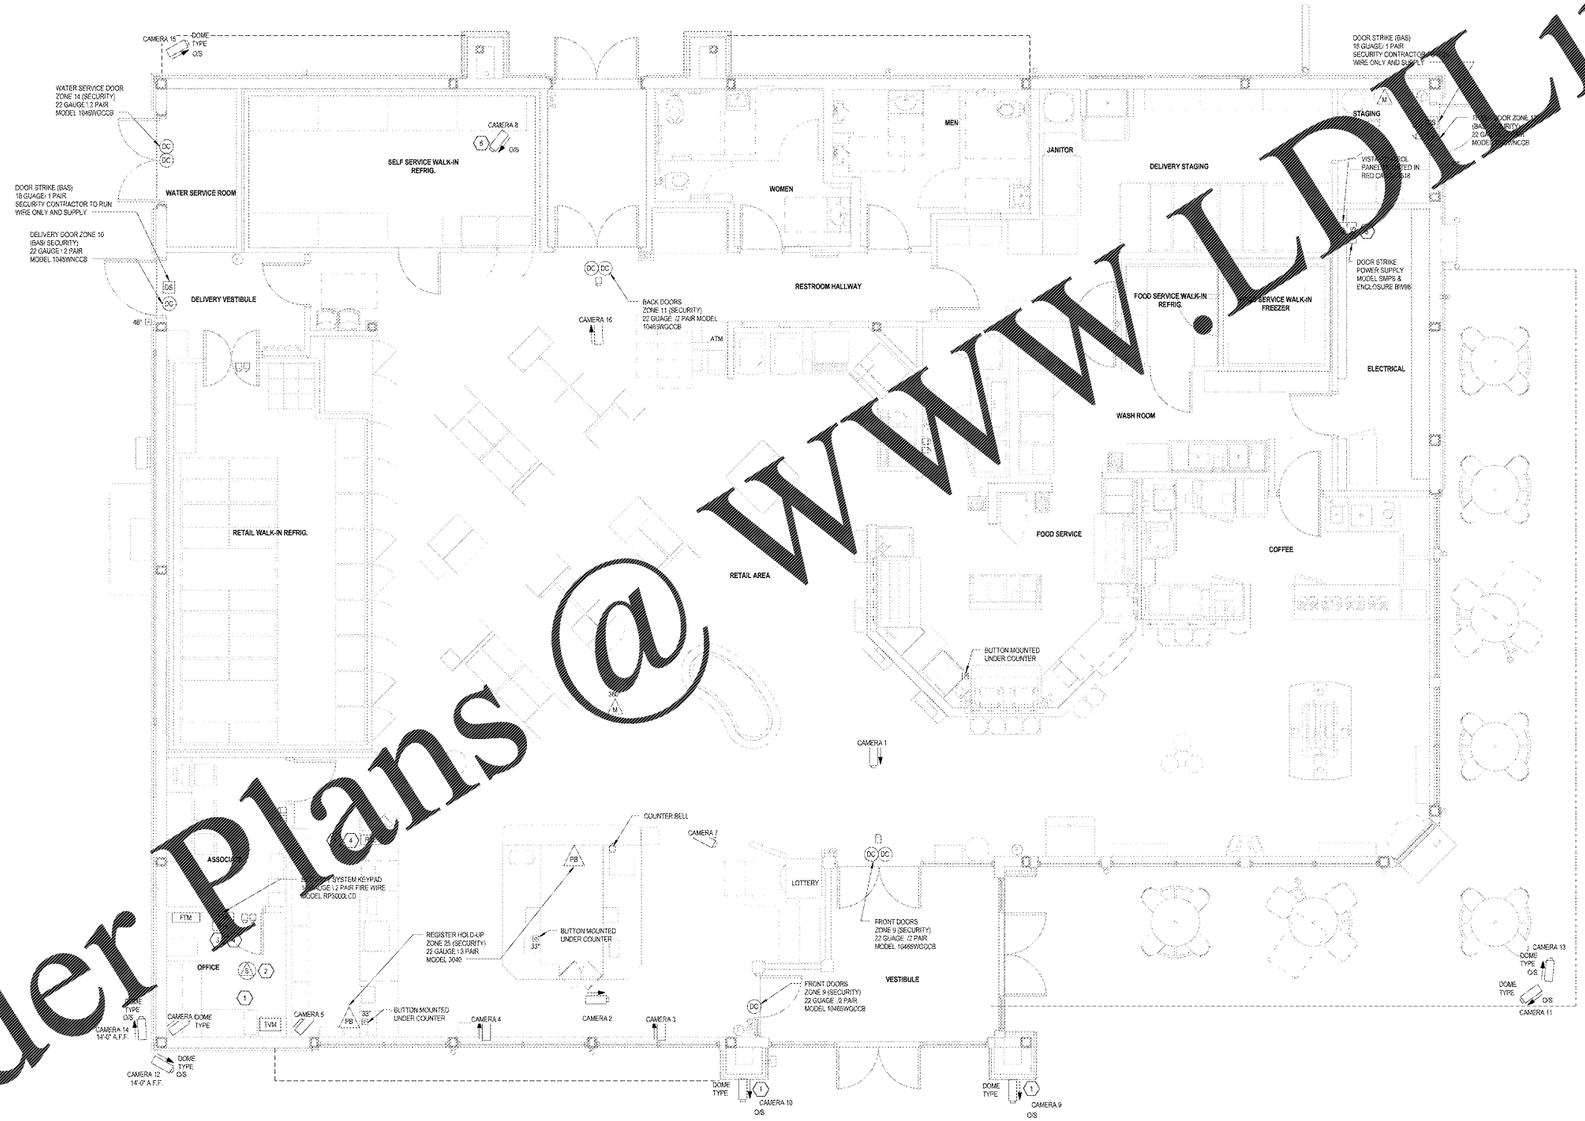

1 SECURITY SYSTEM DEVICE PLAN

LEGEND

	PUSH BUTTON BUZZER (EXTERIOR)
	PUSH BUTTON BELL (INTERIOR)
	BUZZER (EXTERIOR) / BELL (INTERIOR)
	CHIME
ASP	SECURITY SYSTEM PANEL
ASK	SECURITY SYSTEM KEYPAD
FTM	FUEL TANK MONITOR
DC	DOOR CONTACT
M	MOTION DETECTOR
PB	PANIC BUTTON
PBL	PANIC BUTTON WITH LEAD
S	SECURITY SPEAKER
DPS	DOOR STRIKE POWER SUPPLY
DS	DOOR STRIKE
RTE	REQUEST TO ENTER
	CAMERA (SHOWING DIRECTION)
O/S	CAMERA (OUTSIDE RATED FOR TEMPERATURE AND WEATHER)
TVM	MONITOR FOR CAMERAS (CCTV)

Order Plans @ WWW.LDLinc.com

Cantel & Peterson Architects Engineers Planners
Corporate Certificate # AA 0 C000525
1 Pleasant Avenue Hacketts, FL 32814
Ph. (407) 841-6161 Fax (407) 841-6101
www.cpfl.com

CLIENT NAME
WAWA
260 WEST BALTIMORE PIKE
WAWA, PENNSYLVANIA 19063

PROJECT NAME
WAWA F85FB 2018.01 STORE #5275-LIT
9021 STATE ROAD 52
HUDSON, FL 34669

SHEET TITLE
SECURITY PLAN

Revision Schedule

No.	Description	Date
1	PERMIT SET	03/27/2017
2	PRE-BID REVIEW SET	08/29/2018
3	REV 2018.01	09/18/2018
4	BID SET	09/19/2018

PROJECT No. 2951082
DATE 03-25-2017
DRAWN MLB
CHECKED JPM

CONTRACT: All reports, data, specifications, computer disk files, data and other deliverables are instruments of service and property of Cantel & Peterson, C & P/S, Inc. and shall remain the property of C & P/S, Inc. whether the project for which they are made is executed or not. They shall not be used by the Owner or others on other projects, for additions to this project, or for completion of this project by others, except by agreement in writing and with appropriate compensation to C & P/S, Inc. Reuse without written verification or adaptation by C & P/S, Inc. for the specific purpose intended will be at Owner's sole risk and without liability or legal exposure to C & P/S, Inc. Owner shall indemnify and hold harmless C & P/S, Inc. from all claims, damages, losses and expenses including attorney's fees arising out of or resulting therefrom. Any verification or adaptation will entitle C & P/S, Inc. to further compensation at rates to be agreed upon by Owner and C & P/S, Inc.