

FINISH SCHEDULE NOTES:

- NOTES ARE REFERENCED TO SPECIFIC AREAS FOR CONVENIENCE, BUT MAY APPLY TO THE SAME GENERAL CONDITION WHEREVER IT IS FOUND. THESE NOTES APPLY TO ALL DRAWINGS.
- REMOVE SCHEDULE CALLS FOR NEW ACoustICAL LAY-IN CEILING IN AREAS WHERE EXISTING LAY-IN CEILING EXISTS. REMOVE EXISTING CEILING AND GRID AND INSTALL NEW GRID AND LAY-IN CEILING TO ACHIEVE A CONSISTENT FINISH OF CEILING IN ENTIRE SPACES. WHERE EXISTING CLG. TILES ARE REPLACED BY NEW CONTRACTOR SHALL MATCH NEW CLG. TILES W/ SURROUNDING EXISTING TILES. INSTALL NEW CEILING GRID AT SAME ELEVATION AS EXISTING IF GRID IS GETTING REPLACED. WHERE NEW CEILING AND GRID ARE INSTALLED, CONTRACTOR SHALL INSTALL CEILING GRID TO COMPLY WITH SEISMIC DETAILS 3/A2.1 & 4/A2.1.
- AT ALL CLG. FASCIAS, FUR-DOWNS, AND SOFFITS DISTURBED BY CONSTRUCTION, PATCH, PREP, AND PAINT INTERIOR GYP. BO. AT CLG. FUR-DOWNS AND SOFFITS WITH FLAT PAINT.
- ALL CEILINGS REQUIRING PAINTING, PAINT SHALL BE WHITE - (SEE SPECIFICATIONS SECTION 095000).
- WHERE AREAS HAVE EXPOSED STRUCTURE, ALL NEW STEEL STRUCTURE, NEW DUCTWORK, NEW PIPING, NEW CONDUIT, ETC. (AND ALL STEEL STRUCTURE, DUCTWORK, PIPING CONDUIT, ETC. - DISTURBED BY CONSTRUCTION) SHALL BE PAINTED (TYPICAL).
- AT NEW GYPSUM BOARD CEILING, PROVIDE DETAIL EXPANSION JOINT FOR EVERY 96 SQUARE FEET OF CEILING. PROVIDE 1/8" JOINT FOR CALKING AT ALL PERIMETER WALLS. CALK EXPANSION JOINT PRIOR TO PAINTING (TYPICAL).
- DURING COURSE OF CEILING DEMO AND HVAC REMOVAL/INSTALLATION - PROTECT LIGHTS FOR REUSE. DAMAGED LIGHTS SHALL BE REPLACED BY G.C.
- IN ALL SPACES WHERE CONSTRUCTION TAKES PLACE, THE G.C. SHOULD TAKE CARE TO MAINTAIN THE EXISTING QUALITY OF FINISHES AND MATERIALS IN THESE SPACES. WHERE EXISTING MATERIALS OR FINISHES ARE DAMAGED, IT IS THE RESPONSIBILITY OF THE G.C. TO REPLACE.
- AREAS DISTURBED BY CONSTRUCTION THAT REQUIRE "PAINT" IN EXISTING CONSTRUCTION, CONTRACTOR SHALL DETERMINE TYPE OF EXISTING PAINT ON EXISTING SURFACES PRIOR TO OBTAINING MATERIALS FOR INSTALLATION. WHERE NECESSARY, CONTRACTOR SHALL REMOVE ALL LOOSE OR PEELING PAINT, FEATHER EDGES OF EXISTING PAINT EDGES WITH GOOD BOND, AND PROVIDE BARRIER COATS AS REQUIRED BY MANUFACTURER PRIOR TO PROCEEDING WITH FINISH COATS. CONTRACTOR SHALL RUB & BLOCK FILL WALLS TO REMAIN EXPOSED WHERE ITEMS REMOVED, AND PROVIDE BARRIER COATS AS NECESSARY PRIOR TO INSTALLING NEW PAINT.

NOTES ARE REFERENCED TO SPECIFIC AREAS FOR CONVENIENCE, BUT MAY APPLY TO THE SAME GENERAL CONDITION WHEREVER IT IS FOUND. THESE NOTES APPLY TO ALL DRAWINGS.


LEGEND

- 222 - DOOR NUMBER
- A1 - COLUMN NUMBER
- X22 - ROOM NUMBER
- F2 - FINISH NUMBER (SEE SHEET A2) FOR FINISH SCHEDULE & NOTES
- UND. - UNLESS NOTED OTHERWISE
- CH. - CEILING HEIGHT
- C.J. - CONTROL JOINT
- EX.F.T.R. - EXISTING FINISH TO REMAIN
- PROT. - PROTECT
- M.R. - MOISTURE RESISTANT
- N.I.C. - NOT IN CONTRACT

HATCHING ON FLOOR PLANS INDICATES CEILING AREAS DISTURBED BY ALL PLUMBING, MECHANICAL, AND ELECTRICAL WORK ASSOCIATED WITH HVAC REPLACEMENT. CEILING REPLACEMENT WILL NOT BE LIMITED TO AREAS HATCHED. G.C. MUST PROVIDE A CONSISTENT CEILING FINISH IN AREAS WHERE CEILING ARE DISTURBED. IN SOME INSTANCES THE CEILING TILE IN ENTIRE SPACES WILL REQUIRE REPLACEMENT. ALL DAMAGED TILE MUST BE REPLACED.

FINISH SCHEDULE

NO.	FLOOR	BASE	WALLS	CEILING	REMARKS
F2	EF.T.R.	EF.T.R.	EF.T.R.	EF.T.R.	
F1	EF.T.R.	EF.T.R.	EF.T.R.	2 1/2" ACoust. LAY-IN TYPE 1	DDDDA DDD
F2	EF.T.R.	EF.T.R.	EF.T.R.	MOIST. RESIST. GYP. BO. (EPOXY PAINT)	DDDDDDDD

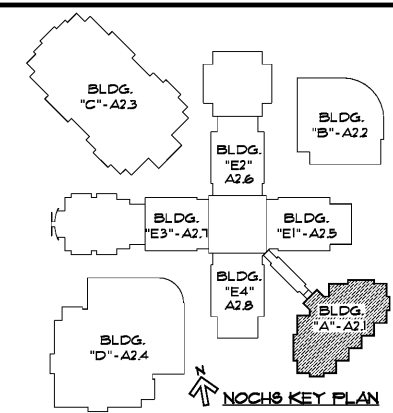


DRAWING ISSUE RECORD


DATE	REVISION	NO.
10/06/06	BID SET	

HYAC REPLACEMENT FOR NORTH OCOONEE HIGH SCHOOL
 EC: 108-0101
 FOR THE
 OCOONE COUNTY BOARD OF EDUCATION
 WATKINSVILLE, GEORGIA
 DATE: SEPT 14, 2016
 SHEET NO. 34 - 009-18

cunningham forhand matthews moe
 cunningham, forhand, matthews & moore, architects, inc. - 2011 manchester street, n.e. - atlanta, georgia 30324 - phone (404) 873-2152

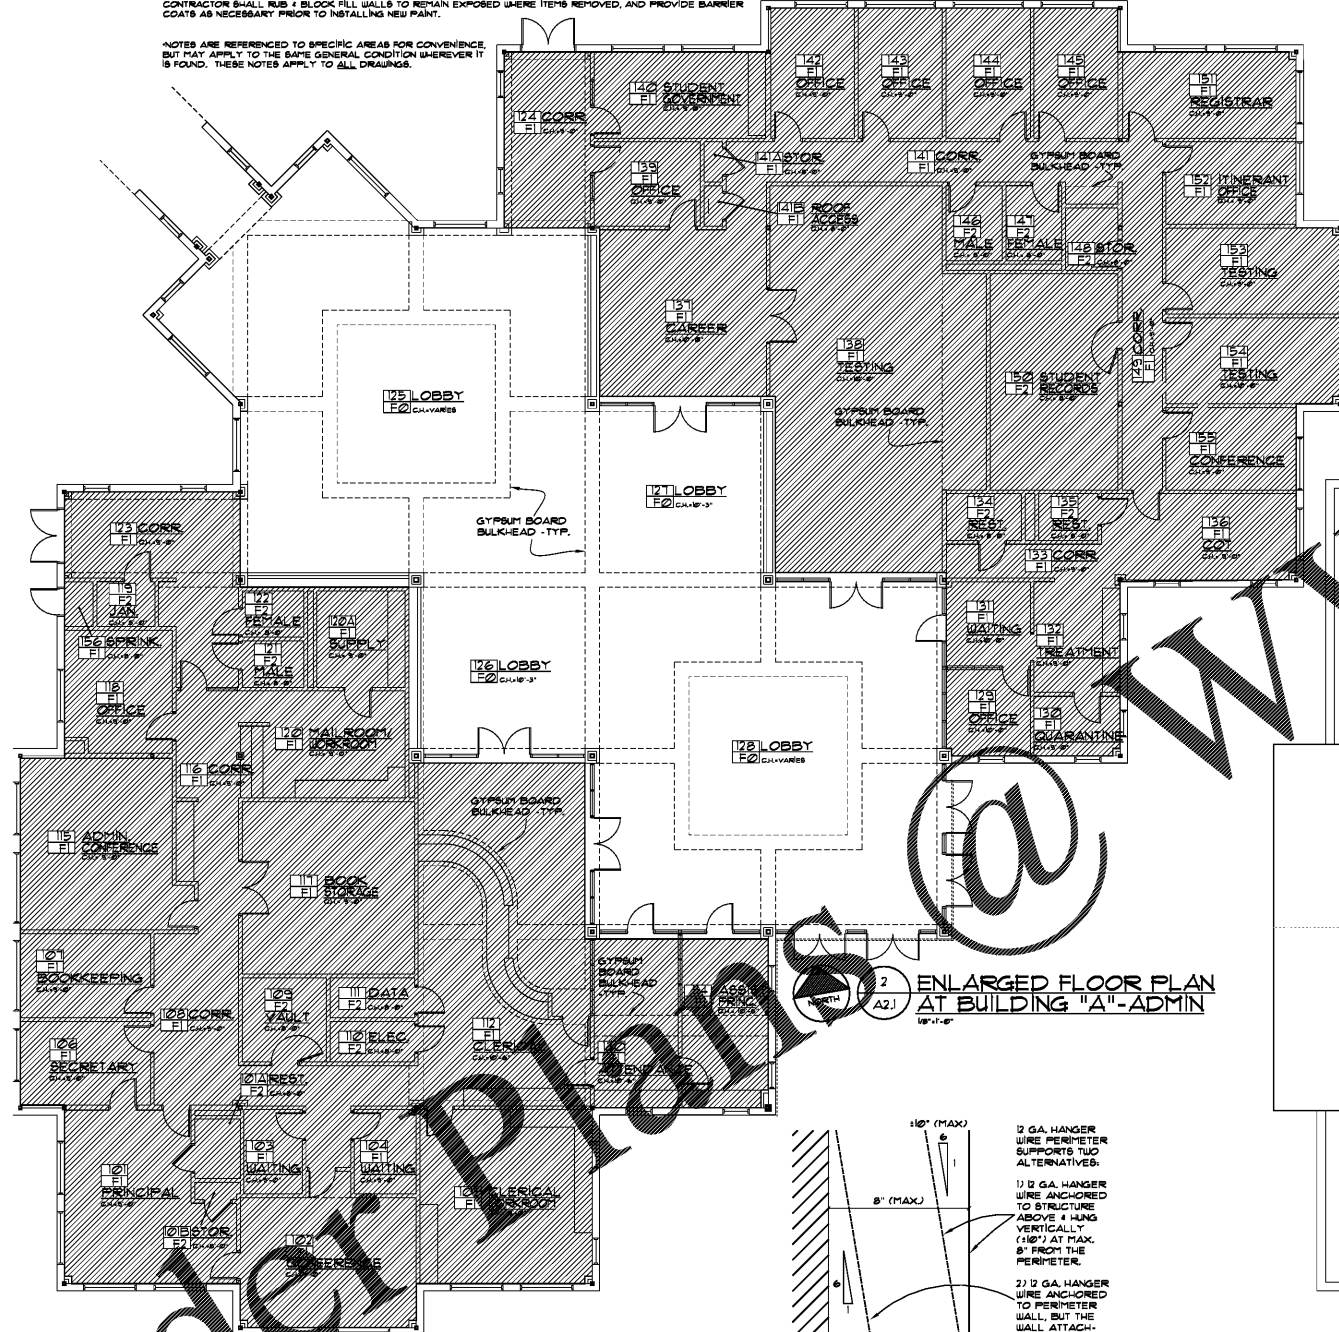


2 ENLARGED FLOOR PLAN AT BUILDING "A"-ADMIN
18'-11" x 18'-0"

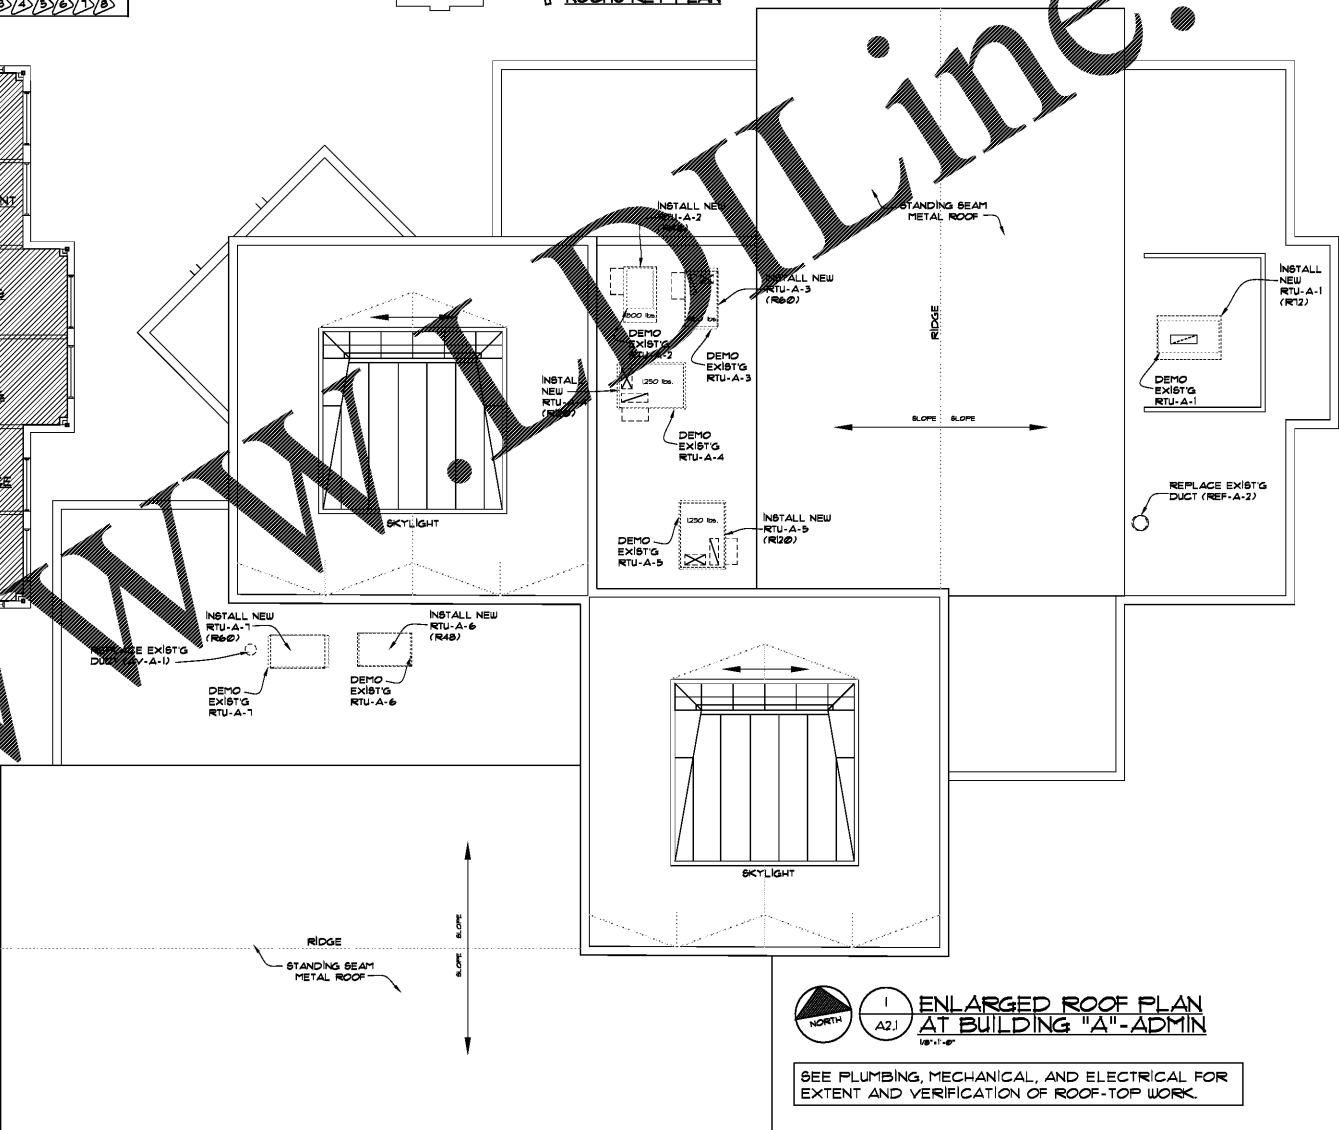


1 ENLARGED ROOF PLAN AT BUILDING "A"-ADMIN
18'-11" x 18'-0"

SEE PLUMBING, MECHANICAL, AND ELECTRICAL FOR EXTENT AND VERIFICATION OF ROOF-TOP WORK.

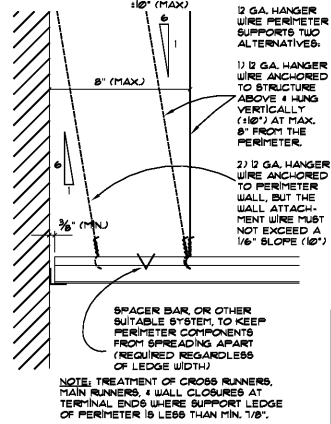


3 SEISMIC CLG. DET. AT WALL
3' x 1'-0"

NOTE: CLG. GRID MAINS & CROSS MEMBERS SHALL NOT BE ATTACHED TO WALL EDGE TRIM, I.E. NO SCREWS, POP RIVETS OR MECHANICAL TABS. CEILING GRID SHALL COMPLY WITH THE REQUIREMENTS OF CISCA (CEILING AND INTERIOR SYSTEMS CONSTRUCTION ASSOCIATION), IBC SECTION 1613.1 & ASCE/SEI 1-05 SECTION 13.5.6. THIS NOTE APPLIES AT DETAILS 4/A2.2 AND 5/A2.2 - TYPICAL.

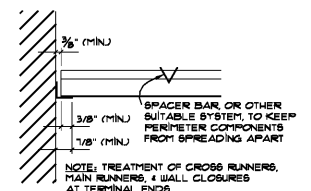

4 SEISMIC CLG. DET. AT WALL
3' x 1'-0"



Order Plans @

WWW.OnLine.com