

Order Plans @



WWW.LDILine.com

DRAWING ISSUE RECORD		
DATE	REVISIONS	NO.
10/30/18	BID SET	

EXISTING GAS METER LOAD  
 HEATING - 1080 CFH  
 COOKING - 405 CFH  
 TOTAL - 1545 CFH  
 DELIVERY PRESSURE = 5 PSI

NEW GAS METER LOAD  
 HEATING - 584 CFH  
 COOKING - 285 CFH  
 TOTAL - 1264 CFH  
 DELIVERY PRESSURE = 5 PSI

EXIST GAS METER

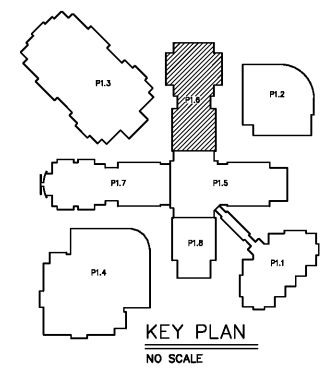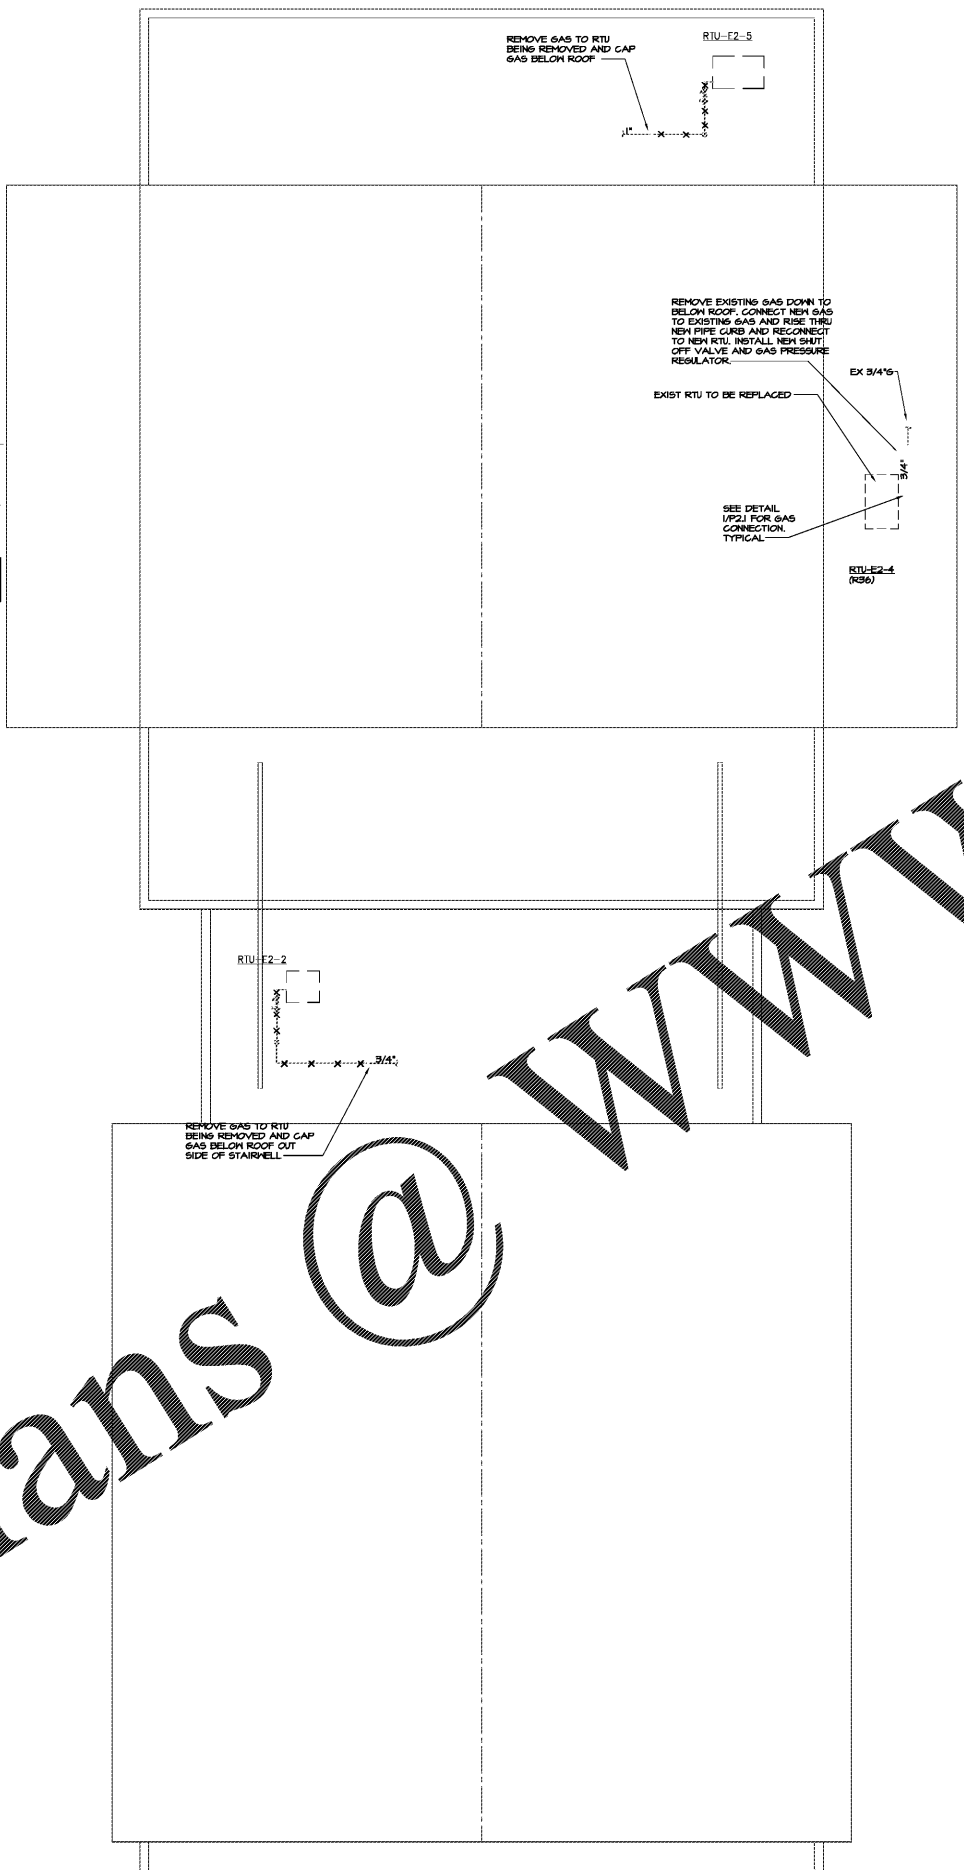

PL6 PARTIAL FLOOR PLAN - PLUMBING  
1/8"=1'-0"



**SPURLOCK & ASSOCIATES, INC.**  
 consulting engineers  
 2970 Clairmont Rd., Suite 620 | Atlanta, GA 30329  
 P: 404.633.0245 | F: 404.633.1756  
 JOB NO. 1869

cunningham forehand matthews moore

HYAC REPLACEMENT FOR NORTH OCONEE HIGH SCHOOL  
 EG: 108-010-010  
 FOR THE OCONEE COUNTY BOARD OF EDUCATION  
 WATKINSVILLE, GEORGIA

DATE: SEPT 14, 2018  
 JOB NO. 8-LL-108-18  
 DESIGNED BY: J.C.F.  
 PROJECT NO. 111111

cunningham, forehand, matthews & moore, architects, inc. - 2011 manchester street, n.e. - atlanta, georgia 30324 - phone (404) 873-2152