


Order Plans @

WWW.LDILINE.COM

DRAWING ISSUE RECORD		
DATE:	REVISIONS:	NO.
10/30/18	BID SET	

HVAC REPLACEMENT FOR
NORTH OCOONEE HIGH SCHOOL
FC: 108-0105
FOR THE
OCOONEE COUNTY BOARD OF EDUCATION
WATKINSVILLE, GEORGIA
REV. 01 M.I.D. 04/15/18
REV. 02 SEPT 14, 2018

cunningham forehand matthews moore
cunningham, forehand, matthews & moore, architects, inc. - 2011 manchester street, n.e. - atlanta, georgia 30324 - phone (404) 873-2152

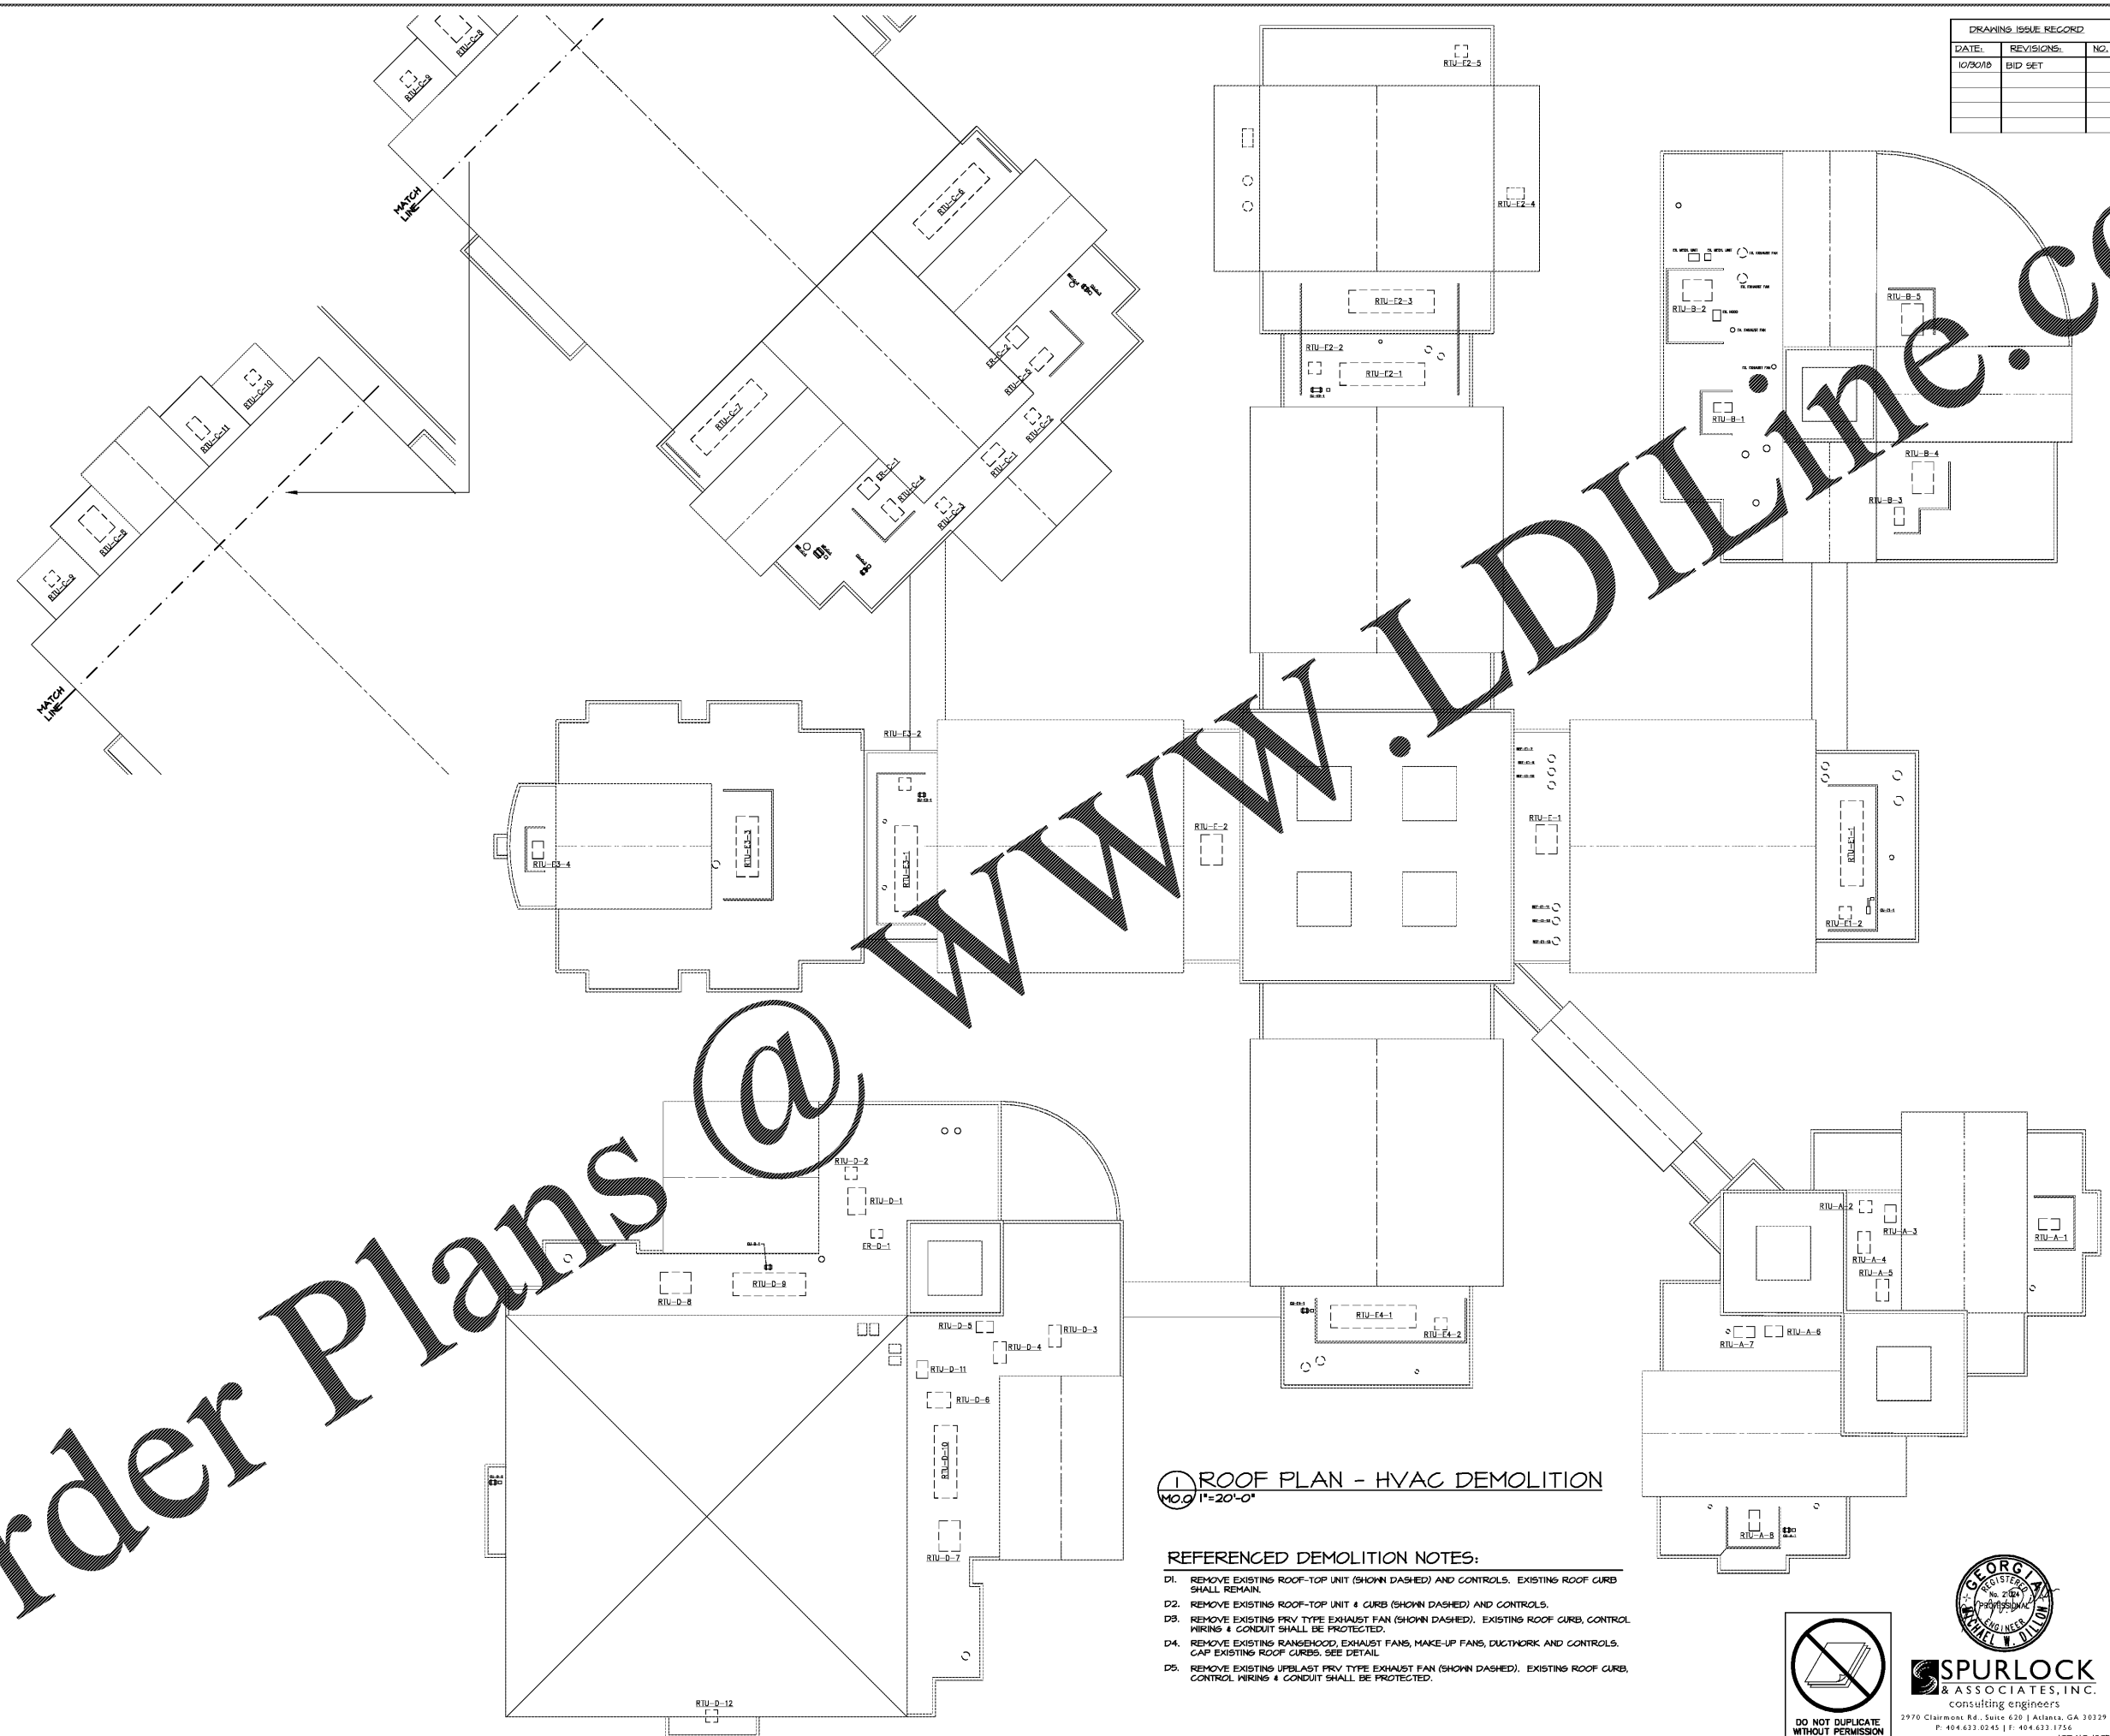

1 ROOF PLAN - HVAC DEMOLITION
MOO 1"=20'-0"

REFERENCED DEMOLITION NOTES:

- D1. REMOVE EXISTING ROOF-TOP UNIT (SHOWN DASHED) AND CONTROLS. EXISTING ROOF CURB SHALL REMAIN.
- D2. REMOVE EXISTING ROOF-TOP UNIT & CURB (SHOWN DASHED) AND CONTROLS.
- D3. REMOVE EXISTING PRV TYPE EXHAUST FAN (SHOWN DASHED). EXISTING ROOF CURB, CONTROL WIRING & CONDUIT SHALL BE PROTECTED.
- D4. REMOVE EXISTING RANGEHOOD, EXHAUST FANS, MAKE-UP FANS, DUCTWORK AND CONTROLS. CAP EXISTING ROOF CURBS. SEE DETAIL.
- D5. REMOVE EXISTING UPBLAST PRV TYPE EXHAUST FAN (SHOWN DASHED). EXISTING ROOF CURB, CONTROL WIRING & CONDUIT SHALL BE PROTECTED.



DO NOT DUPLICATE WITHOUT PERMISSION



SPURLOCK & ASSOCIATES, INC.
consulting engineers
2970 Clairmont Rd., Suite 620 | Atlanta, GA 30339
P: 404.633.0245 | F: 404.633.1756
JOB NO. 1805

MO.0