


| DRAWING ISSUE RECORD | | |
|----------------------|------------|-----|
| DATE: | REVISIONS: | NO. |
| 10/30/18 | BID SET | |
| | | |
| | | |
| | | |

HVAC REPLACEMENT FOR
NORTH OCOREE HIGH SCHOOL
FC: 108-0105
FOR THE
OCOREE COUNTY BOARD OF EDUCATION
WATKINSVILLE, GEORGIA
DATE: 09-14-2018
BY: M.J.D.

cunningham forehand matthews moore
cunningham, forehand, matthews & moore, architects, inc. - 2011 manchester street, n.e. - atlanta, georgia 30324 - phone (404) 873-2152

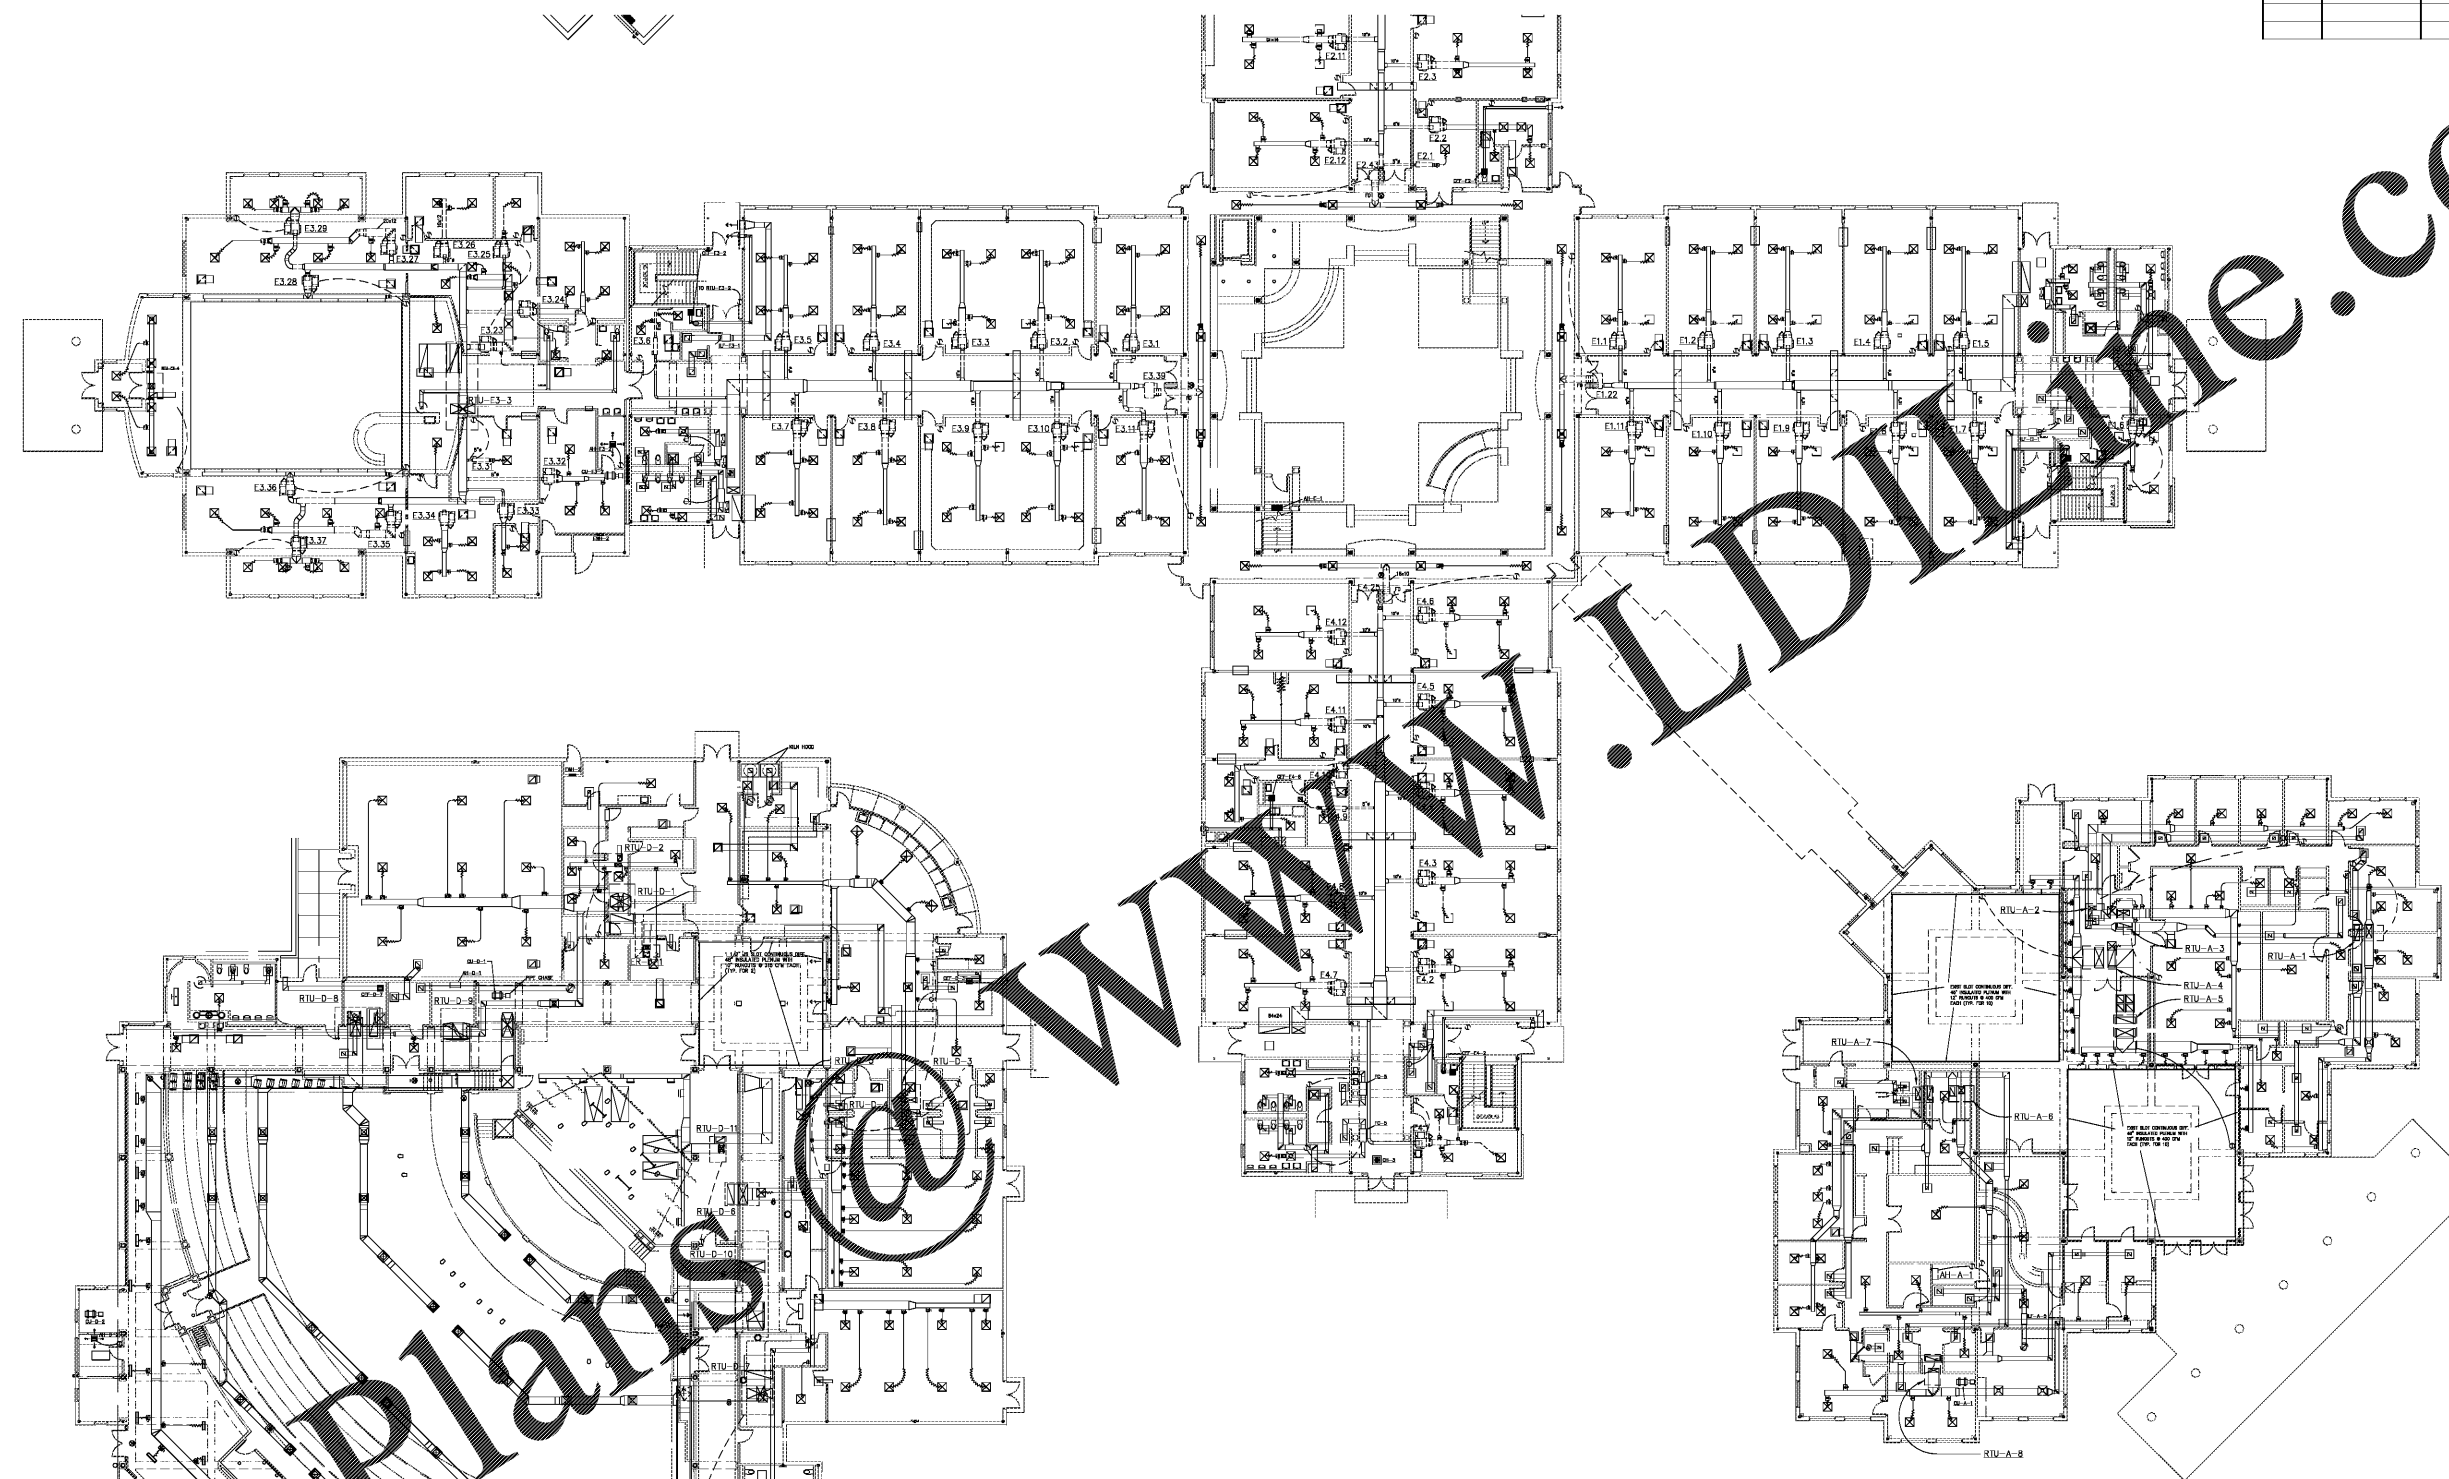

REFERENCED DEMOLITION NOTES:

- D1. REMOVE EXISTING ROOF-TOP UNIT (SHOWN DASHED) AND CONTROLS. EXISTING ROOF CURB SHALL REMAIN.
- D2. REMOVE EXISTING ROOF-TOP UNIT & CURB (SHOWN DASHED) AND CONTROLS.
- D3. REMOVE EXISTING PRV TYPE EXHAUST FAN (SHOWN DASHED). EXISTING ROOF CURB, CONTROL WIRING & CONDUIT SHALL BE PROTECTED.
- D4. REMOVE EXISTING RANGEHOOD, EXHAUST FANS, MAKE-UP FANS, DUCTWORK AND CONTROLS. CAP EXISTING ROOF CURBS. SEE DETAIL.
- D5. REMOVE EXISTING UPBLAST PRV TYPE EXHAUST FAN (SHOWN DASHED). EXISTING ROOF CURB, CONTROL WIRING & CONDUIT SHALL BE PROTECTED.

GENERAL DEMOLITION NOTES:

- DA. GENERALLY ITEMS SHOWN DASHED ARE TO BE REMOVED AND ITEMS SHOWN WITH SOLID LINE ARE TO REMAIN.
- DB. SEE MLI-M41 FOR NEW WORK.
- DC. THE OWNER RESERVES THE RIGHT TO SALVAGE EQUIPMENT OR MATERIALS THAT HAVE BEEN REMOVED.
- DD. RECYCLE (EVACUATE & CLEAN - MULTIPASS) ALL REFRIGERANT FROM RTU'S TO BE REMOVED AND TURN OVER TO OWNER IN CONTRACTOR PROVIDED 50B REFRIGERANT CONTAINERS.
- DE. ROOF-TOP UNIT REMOVAL AND REPLACEMENT WILL OCCUR DURING TIMES WHEN THE BUILDING IS UNOCCUPIED. ALL WORK SHOWN ON THESE DOCUMENTS MUST BE WELL COORDINATED TO ENSURE THAT AIR CONDITIONING AND HEATING IS OPERATIONAL WHEN THE BUILDING IS OCCUPIED.

Order Plans

1 PARTIAL MAIN LEVEL FLOOR PLAN - HVAC DEMOLITION
MOJ 1"=16'-0"



SPURLOCK & ASSOCIATES, INC.
consulting engineers
2970 Clairmont Rd., Suite 620 | Atlanta, GA 30339
P: 404.633.0245 | F: 404.633.1756
JOB NO. 1805