


OCCUPANCY SENSOR LEGEND


- ⊗ SENIOR SWITCH CH PDI IOR
Extended Range 360° Sensor-Ceiling Mount,
Low Voltage, Dual Technology (PDI), Relay
- ⊗ SENIOR SWITCH CH IO
Extended Range 360° Sensor-Ceiling Mount,
Low Voltage, Passive Infrared (PIR)
- ⊗ SENIOR SWITCH CH 6
Hi-BAY 360° Sensor-Ceiling Mount,
Low Voltage, Passive Infrared (PIR)
- ⊗ SENIOR SWITCH CH 4
Standard Range 360° Sensor-Ceiling Mount,
Low Voltage, Passive Infrared (PIR)
- ⊗ SENIOR SWITCH HV PDI BR
High View Sensor-Corner Mount,
Low Voltage, Dual Technology (PDI), Relay,
HD BK Ceiling Mounting Bracket
- ⊗ SENIOR SWITCH PP20
Power Pack-Relay Circuit Protection 120/277V VAC
- ⊗ SENIOR SWITCH CH 4
Standard Range 360° Sensor-Ceiling Mount,
Line Voltage, Passive Infrared (PIR)
- ⊗ SENIOR SWITCH CH 4R PDI 4
Standard Range 360° Sensor-Ceiling Mount,
Low Voltage, Dual Technology (PDI), Relay

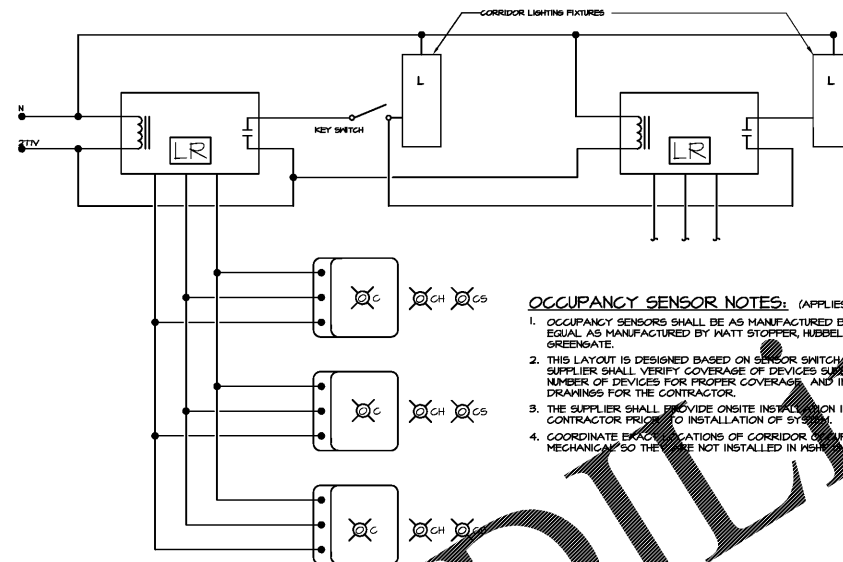

- OCCUPANCY SENSOR NOTES:** (APPLIES TO E-1.11 & E-1.12)
- OCCUPANCY SENSORS SHALL BE AS MANUFACTURED BY SENIOR SWITCH OR EQUAL AS MANUFACTURED BY MATT STOPPER, HUBBELL, LEVITON OR GREENGATE.
 - THIS LAYOUT IS DESIGNED BASED ON SENSOR SWITCH PLACES. THE SUPPLIER SHALL VERIFY COVERAGE OF DEVICES SUPPLIED AND PROVIDE NUMBER OF DEVICES FOR PROPER COVERAGE, AND INSTALLATION LIST DRAWINGS FOR THE CONTRACTOR.
 - THE SUPPLIER SHALL PROVIDE ON-SITE INSTALLATION INSTRUCTION TO THE CONTRACTOR PRIOR TO INSTALLATION OF SYSTEM.
 - COORDINATE EXCLUSIONS OF CORRIDOR OCCUPANCY SENSORS WITH MECHANICAL SO THEY ARE NOT INSTALLED IN MECHANICAL ACCESS SPACES.



3 CLASSROOM OCCUPANCY SENSOR WIRING DIAGRAM
E-1.12 NOT TO SCALE

2 CORRIDOR OCCUPANCY SENSOR WIRING DIAGRAM
E-1.12 NOT TO SCALE

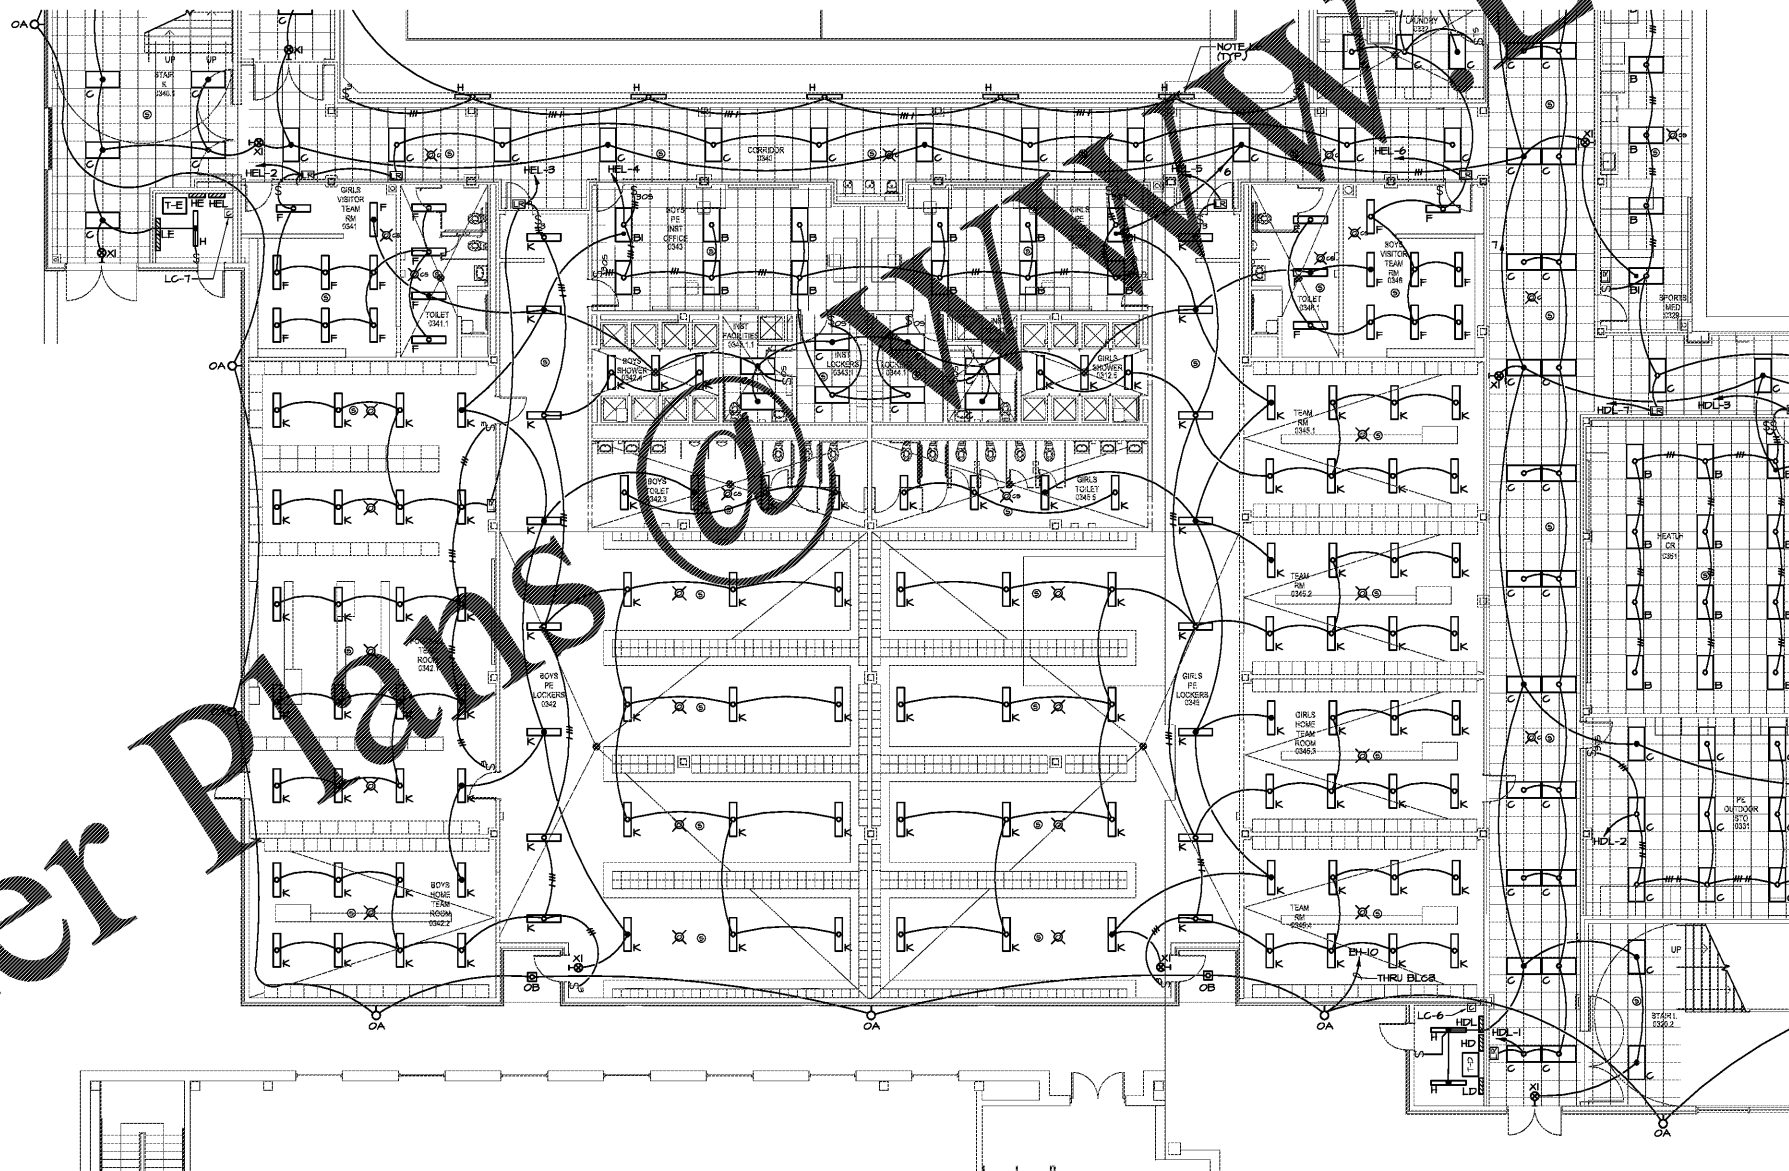

1 LEVEL 000 FLOOR PLAN - PART 2- LIGHTING
E-1.12 1/8"=1'-0"


SEE SHEET E-1.11 FOR REFERENCED LIGHTING NOTES.

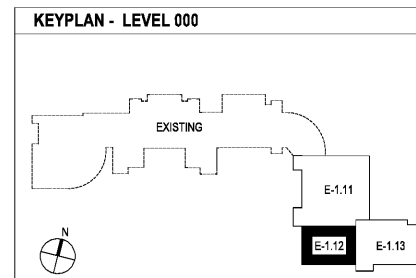

FOR RELEASE OR CONSTRUCTION

SPURLOCK ASSOCIATES, INC.

2970 Clairmont Rd., Suite 420
Atlanta, GA 30329
P: 404.633.0245
F: 404.633.1756



DATE	NO.	DESCRIPTION
03/27/18		ISSUE PRELIMINARY SCHEMATIC
05/19/18		DESIGN DEVELOPMENT DOCUMENTS
08/17/18		ISSUE CONSTRUCTION PERMIT SET
10/19/18		FINAL ISSUE SUBMITTAL READY FOR PROPOSAL

RIVERWOOD HIGH SCHOOL-PHASE 3-8
AUDITORIUM / GYMNASIUM ADDITION
5900 RAIDER DRIVE NW SANDY SPRINGS, GA 30328
FULTON COUNTY SCHOOLS RFP NO. 411-19

SHEET TITLE
LEVEL 000 FLOOR PLAN - PART 2- LIGHTING

PROJECT NO. 18015.02

DATE 09/17/18

DRAWN BY G.T.R.
CHECKED BY B.L.S.

SHEET NO.
E-1.12

Order Plans.com