



**GENERAL NOTES**

1. REFER TO 00.1 FOR COMPLETE CODE ANALYSIS.
2. FINAL FIRE EXTINGUISHER LOCATIONS TO BE COORDINATED WITH FIRE MARSHAL.
3. FIRE EXTINGUISHERS SHALL BE A MINIMUM 4A, 15BC RATING AND INSTALLED WITH A MAXIMUM TRAVEL DISTANCE OF 75 FT. U.N.D.
4. FIRE EXTINGUISHERS SHALL BE PROVIDED AT ALL TIMES DURING CONSTRUCTION WITH A MAXIMUM TRAVEL DISTANCE OF 75 FT.
5. FIRE EXTINGUISHERS SHALL BE CLASS K IN PREP AREAS AND INSTALLED WITH A MAXIMUM TRAVEL DISTANCE OF 30 FT. U.N.D.

**LEGEND**

PHOTOLUMINESCENT EXIT SIGNAGE: FILL QUADRANT INDICATES SIGN FACE. RE: SPECIFICATIONS

Egress Paths	
Egress Path Distance	Egress Path Number
250'-0"	A1
143'-2"	B1
246'-0"	C1
133'-4"	D1
0'-7"	E1
	F1

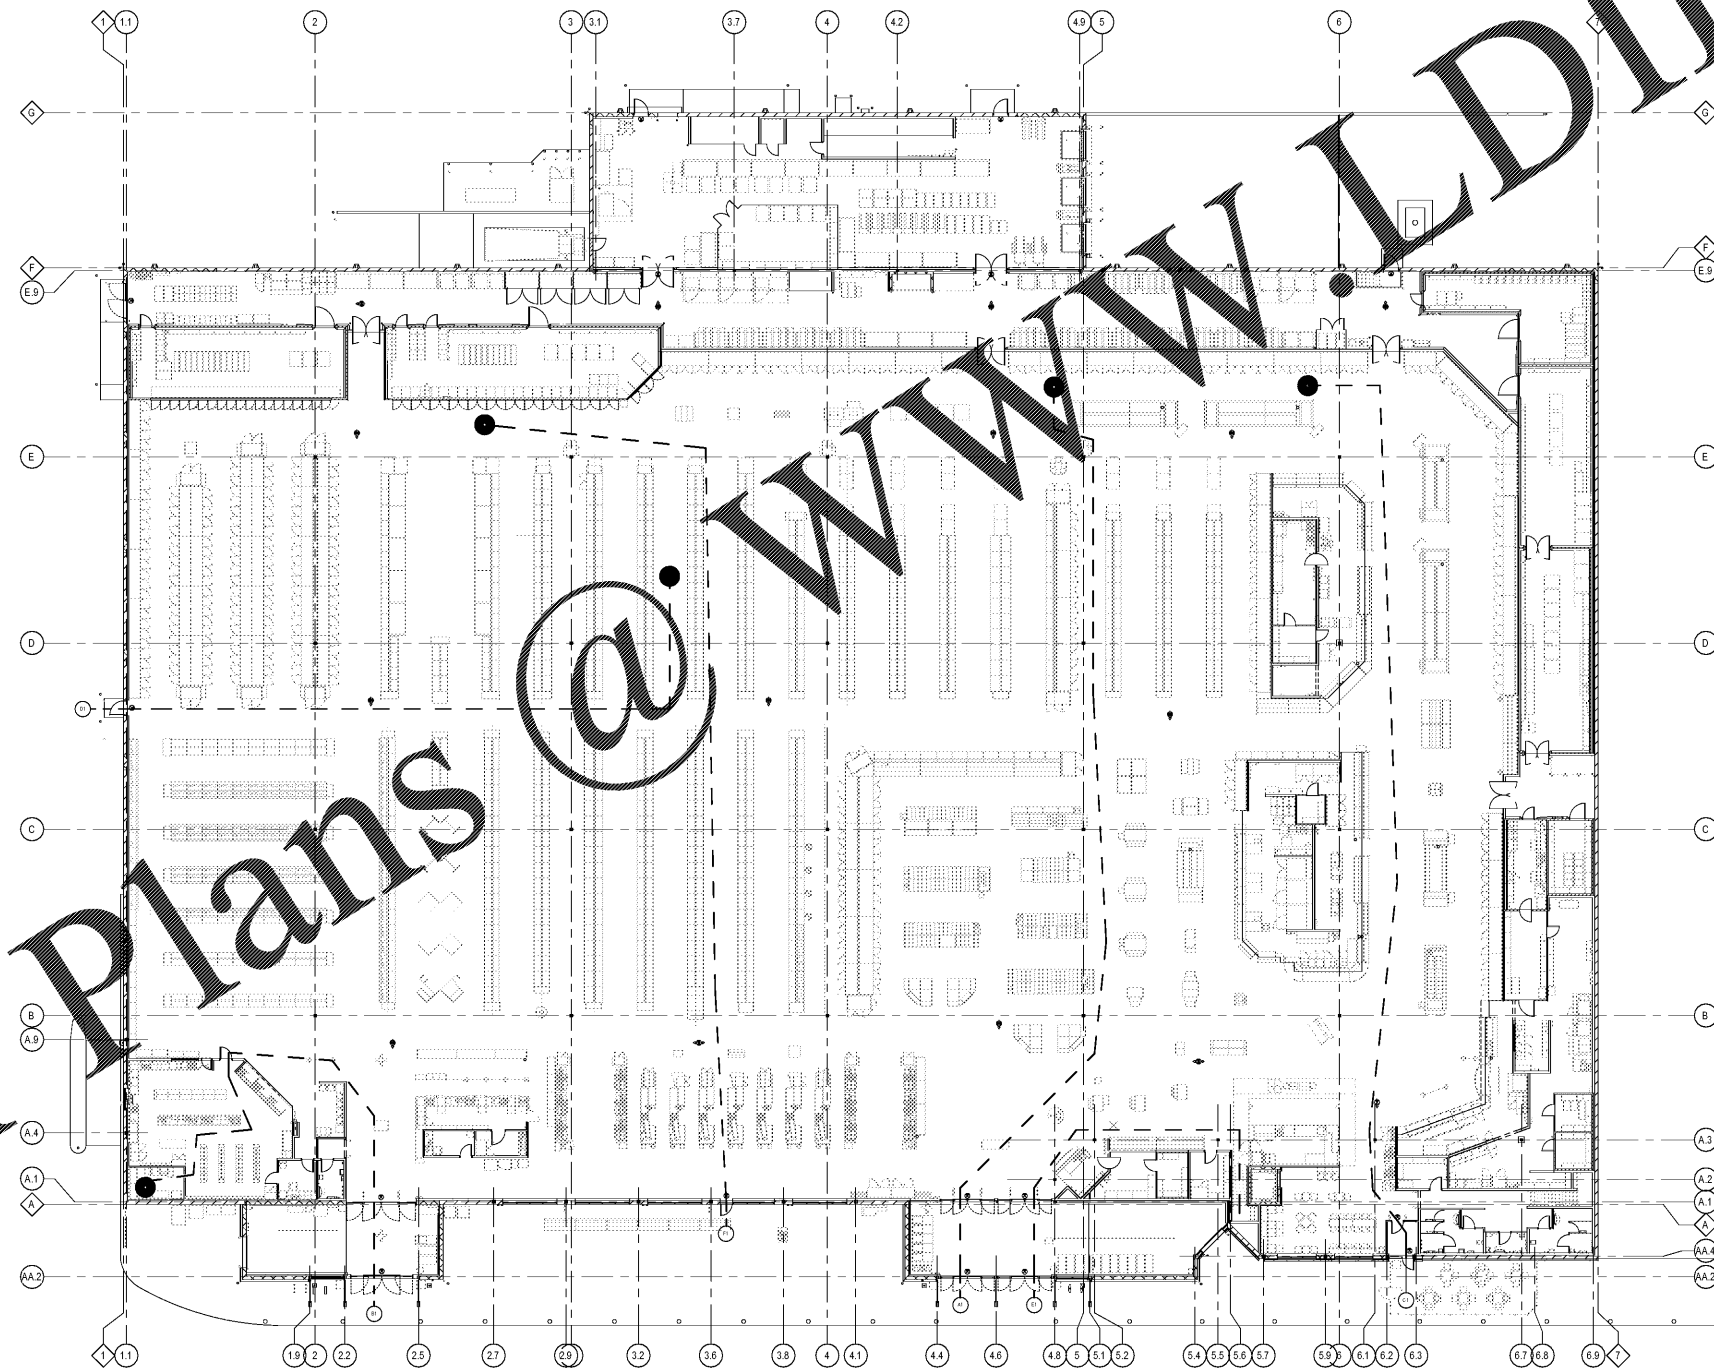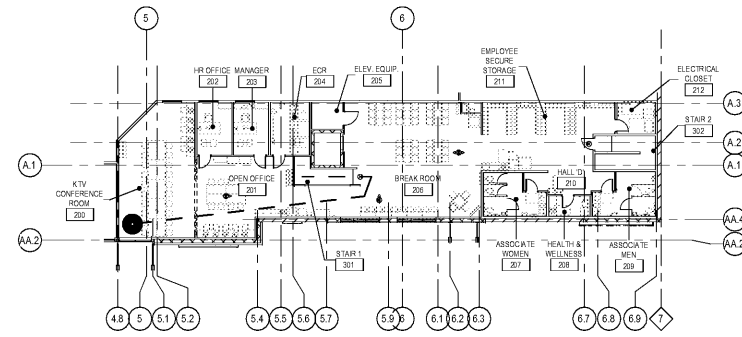

EXECUTED BY: Author  
REVIEWED BY: Checker

PROJECT: 000 W. Mercury Blvd., Suite 200, Hampton, VA 23066  
CINCINNATI: 600 W. River St., Suite 200, Cincinnati, OH 45202  
DENVER: 1700 Broadway, Suite 1000, Denver, CO 80202  
DALLAS: 1000 Ross Ave., Suite 200, Dallas, TX 75202  
EAST RICHMOND: 10000 E. Eastman Ave., Suite 200, East Richmond, VA 23061  
SEATTLE: 900 2nd Avenue, Suite 2000, Seattle, WA 98104

**CR** architecture + design

creating extraordinary places  
www.cr-architects.com  
800-469-4949

CONSULTANTS

OWNER

DATE: 11/23/18  
11/01/18

ISSUED BY: 80% OWNER REVIEW  
100% BID PERMIT

DATE	REVISION

PROJECT TITLE  
**KROGER STORE R543**

1050 W. Mercury Blvd.  
Hampton, VA 23066

COMMISSION NO: 518344  
ISSUE DATE: 11/01/18

SHEET TITLE  
**LIFE SAFETY PLANS**

SHEET NO.  
**G0.3**

Order Plans

WWW.LDILine.com

THIS DOCUMENT IS THE PROPERTY OF ARCHITECTS AND SHOULD NOT BE REPRODUCED OR COPIED IN ANY MANNER WITHOUT THE WRITTEN PERMISSION OF ARCHITECTS. THE EXISTING CONDITIONS OF THE PROJECT MAY BE DIFFERENT FROM THE INFORMATION CONTAINED HEREIN. ARCHITECTS ASSUMES NO LIABILITY FOR ANY DAMAGE TO PERSONS OR PROPERTY ARISING FROM THE USE OF THIS DOCUMENT.

11/23/18 4:52:09 PM