


2 MEZZANINE INTERIOR WALL TYPES PLAN
SCALE: 1/16" = 1'-0"

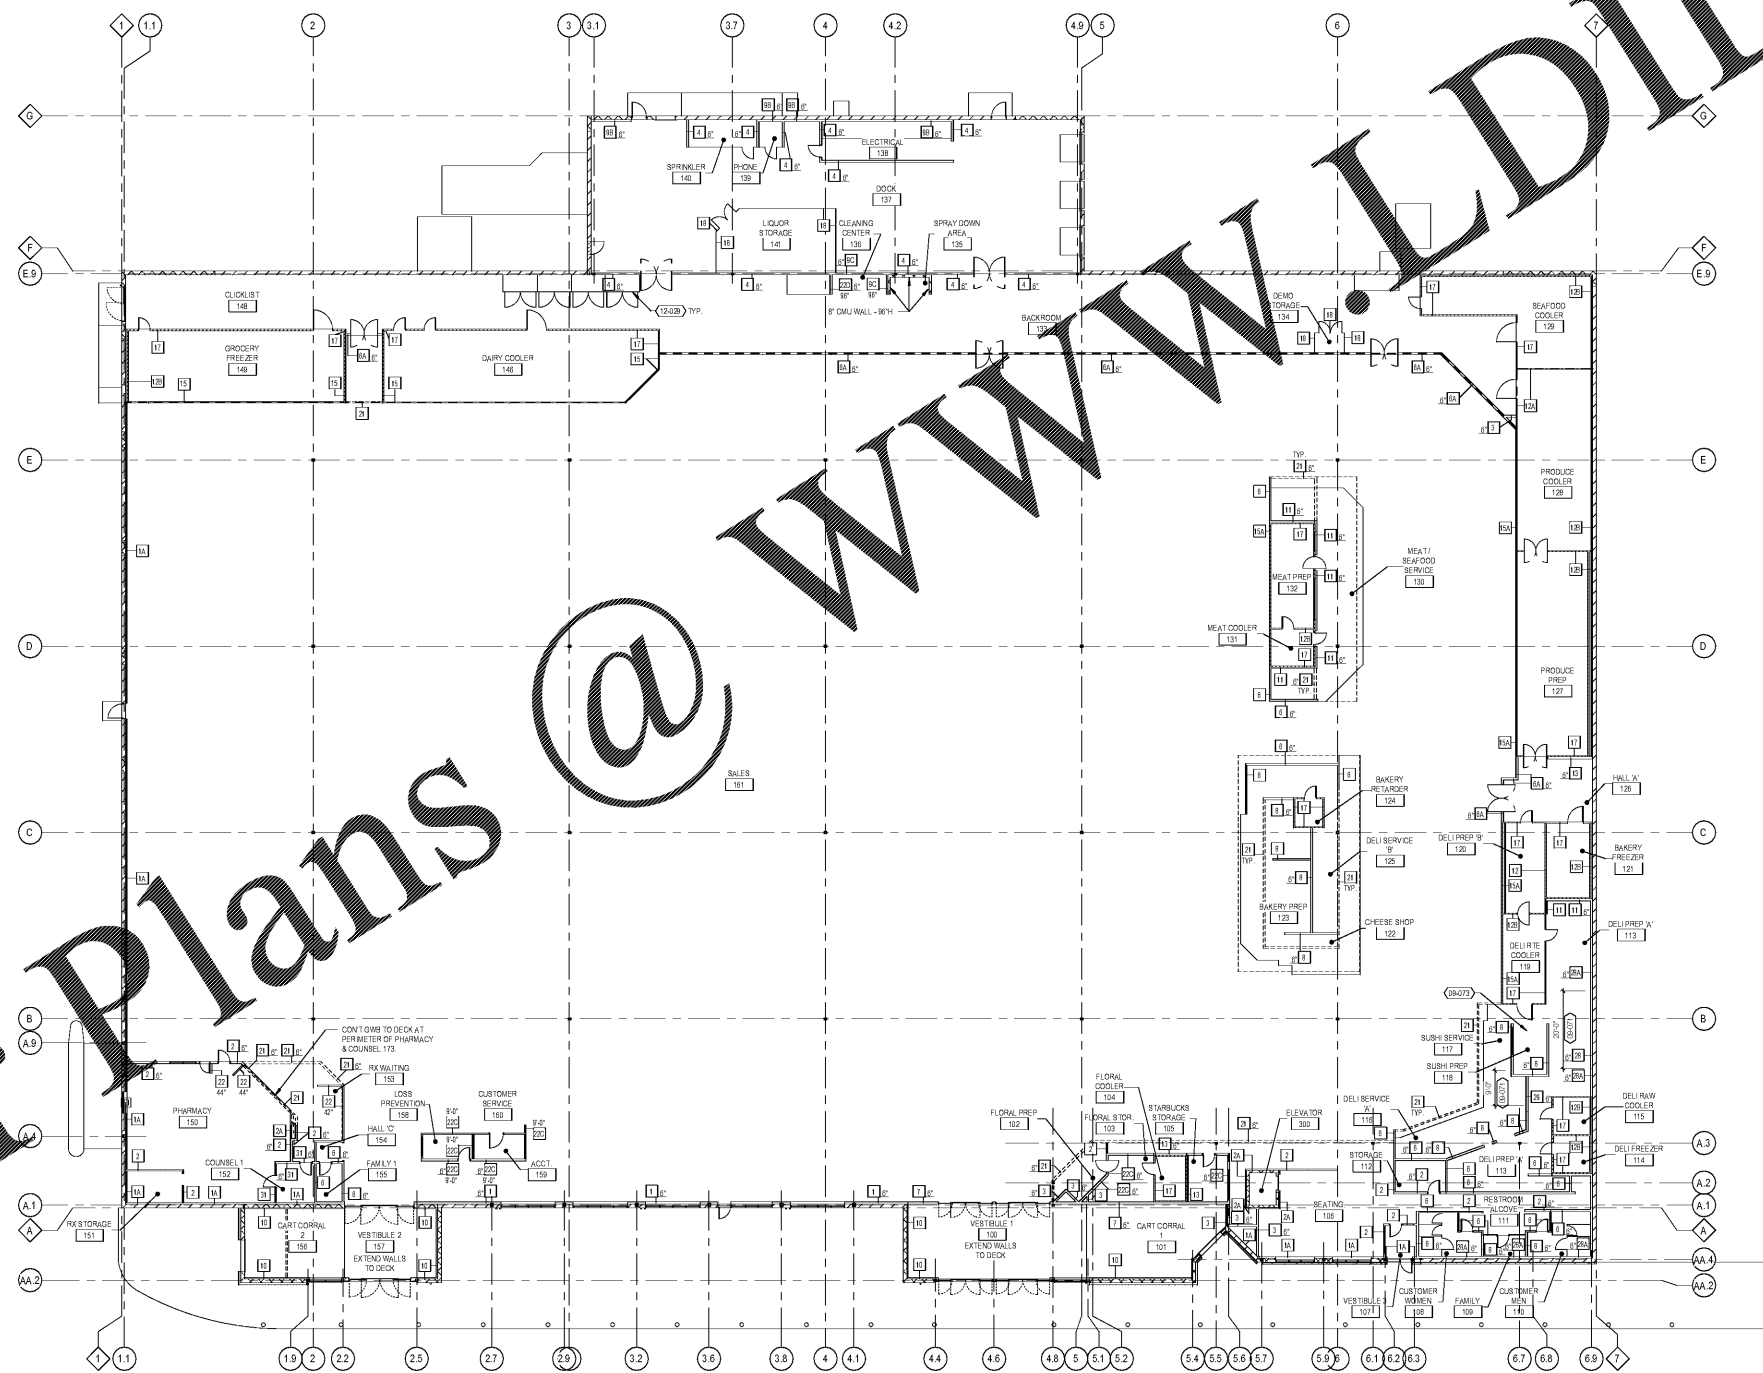

1 INTERIOR WALL TYPES PLAN
SCALE: 1/16" = 1'-0"

GENERAL NOTES

1. GYPSUM BOARD: 1/2" UNLESS NOTED OTHERWISE.
2. CEMENT BOARD: 1/2" UNLESS NOTED OTHERWISE. RE: SPECS.
3. METAL STUDS: 3/8" SPACED 24" O.C. UNLESS NOTED OTHERWISE. RE: SPECS.
4. DEFLECTION TRACK: 3" LONG LEG TO PROVIDE 1 1/2" OF VERTICAL MOVEMENT. DO NOT ATTACH METAL STUD WALL OR GYPSUM BOARD TO DEFLECTION TRACK. HOLD GYPSUM BOARD SHORT OF DECK BY 1/2".
5. FLOOR FINISH AND BASE: REFER TO INTERIOR DECOR PLANS & ROOM FINISH SCHEDULE.
6. IN ROOMS WITH CEILING EXTEND GYPSUM BOARD TO 8" ABOVE CEILING. METAL STUDS DO NOT NEED TO EXTEND TO DECK (U.N.D.) BUT CAN BE BRACED BACK TO STRUCTURE ABOVE AT 48" O.C. MAX.
7. FIRE BLOCKING: PROVIDE 1" ROCKWOOL OR SOLID WOOD BLOCKING (CONTRACTOR'S OPTION) BETWEEN STUDS @ CEILING LINE. F ROCKWOOL IS USED, FRICTION FIT BETWEEN EACH STUD.

WALL NOMENCLATURE

WALL TYPE BOX: X WALL TYPE D
 METAL STUD WIDTH: INDICATED LEFT OR RIGHT OF WALL (D BOX)
 LEFT BLANK: 3/8" METAL STUD WIDTH - STANDARD DEPT (UNLESS NOTED OTHERWISE)
 XX: EXTEND ASSEMBLY SHOWN DISTANCE ABOVE FLOOR
 EXAMPLE: WALL TYPE BOX X 3/8" STUD WIDTH 12" STUD WIDTH 12" FINISH HEIGHT

INTERIOR CONTROL JOINTS

- BY WALL CONTRACTOR TO INCLUDE CONTROL JOINTS PER STANDARDS AND AT CONDITIONS EXIST:
- 20.3.1 CONTROL JOINT SHALL BE INSTALLED WHERE A PARTITION, WALL OR CEILING TRAVERSES A CONSTRUCTION JOINT (EXPANSION, SEISMIC OR BUILDING CONTROL JOINT ELEMENT) IN THE BASE BUILDING STRUCTURE.
 - 20.3.2 CONTROL JOINTS SHALL BE INSTALLED WHERE A WALL OR PARTITION RUNS IN AN UNINTERRUPTED 3' TIGHT PLAN EXCEEDING 30 LINEAR FEET (9.14M).
 - 20.3.3 CONTROL JOINTS IN INTERIOR CEILING WITH PERIMETER RELIEF SHALL BE INSTALLED SO THAT LINEAR DIMENSIONS BETWEEN CONTROL JOINTS DO NOT EXCEED 30 FT (9.14M) AND TOTAL AREA BETWEEN CONTROL JOINTS DOES NOT EXCEED 900 SQ FT (84 SQ M).
 - 20.3.4 CONTROL JOINTS IN INTERIOR CEILING WITHOUT PERIMETER RELIEF SHALL BE INSTALLED SO THAT LINEAR DIMENSIONS BETWEEN CONTROL JOINTS DOES NOT EXCEED 30 FT (9.14M) AND TOTAL AREA BETWEEN CONTROL JOINTS DOES NOT EXCEED 900 SQ FT (84 SQ M).
 - 20.3.5 CONTROL JOINTS IN EXTERIOR CEILING AND SOFFITS SHALL BE INSTALLED SO THAT LINEAR DIMENSIONS BETWEEN CONTROL JOINTS DO NOT EXCEED 30 FT (9.14M) AND TOTAL AREA BETWEEN CONTROL JOINTS DOES NOT EXCEED 900 SQ FT (84 SQ M).

KEYNOTES

- 19471: EXTEND CEMENT BOARD 18" ABOVE AND BEYOND EXHAUST HOOD TOP AND SIDES. RE: 1934.
- 19473: FLOOR OVER SUBGRADE. RE: 1934/1934-1/1A.
- 12429: FENCED SECURE STORAGE WITH GATE. RE: 08040.

EXECUTED BY: GB
 REVIEWED BY: AF
 CONCERNANT: 600 West Broadway, Suite 220, Chicago, IL 60601
 DENVER: 1975 Broadway, Suite 100, Denver, CO 80202
 DALLAS: 1975 Broadway, Suite 100, Dallas, TX 75201
 LEASDALE: 200 West Leasdale, Suite 100, Leasdale, IL 60438
 SEATTLE: 900 2nd Avenue, Suite 2000, Seattle, WA 98104
 architecture + design

OWNER

 DATE: 03/10
 10/28/18: 60% OWNER REVIEW
 11/01/18: 100% BID PERMIT

PROJECT TITLE
KROGER STORE R543
 1050 W. Mercury Blvd.
 Hampton, VA 23666
 COMMISSION NO: 518344
 ISSUE DATE: 11/01/18
 SHEET TITLE
INTERIOR WALL TYPES PLAN
 SHEET NO:
A3.2

Order Plans @ www.LDILine.com

THIS DOCUMENT IS THE PROPERTY OF LDILINE, INC. AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. WITHOUT THE WRITTEN PERMISSION OF LDILINE, INC. THIS DOCUMENT CONTAINS TRADE SECRETS AND CONFIDENTIAL INFORMATION. IT CONTAINS MAY BE COPIED OR USED FOR OTHER THAN THE SPECIFIED PURPOSE. LDILINE, INC. IS NOT RESPONSIBLE FOR ANY DAMAGE TO PROPERTY OR PERSONS ARISING FROM THE USE OF THIS DOCUMENT.