


- GENERAL DIMENSION NOTES**
- A. REFER TO EQUIPMENT SCHEDULES ON SHEET E1.5.2a FOR MOUNTING HEIGHTS AND ADDITIONAL INFORMATION. ALSO SEE DETAILS ON SHEET E1.5.2b SERIES DRAWINGS WHERE APPLICABLE.
 - B. INSTALL ELECTRICAL OUTLETS FOR REFRIGERATION ISLAND CASES IN A STRAIGHT LINE ALIGNED WITH THE HUB DRAWING. COORDINATE W/FIELD DIMENSIONS SHOWN ON PLAN.
 - C. ALL DIMENSIONS INDICATED ON PLANS THAT ARE FROM INTERIOR PARTITIONS WHERE THE RETURN AIR SHUTT IS INDICATED ARE TAKEN FROM THE SALES AREA SIDE OF THE ROOF DECK HIGH PARTITION, NOT THE RETURN AIR SHUTT PARTITION.
 - D. FIELD COORDINATE UNDERSLAB CONDUIT AND RACEWAY LAYOUTS WITH ALL AFFECTED PARTIES PRIOR TO SLAB PLACEMENT.
 - E. FLUSH MOUNT ALL WALL OUTLETS IN FOOD PREP AREAS. OUTLETS LOCATED ABOVE STAINLESS STEEL TABLES SHALL BE A MINIMUM OF 42" AFF. MOUNT ALL WALL OUTLETS IN ALL PREP AREAS HORIZONTALLY.
 - F. PROVIDE 15 FEET OF SEAL-TIGHT FLEXIBLE CONDUIT FOR REFRIGERATED CASES SERVED FROM WALL JUNCTION BOXES AND 6 FEET FROM FOOD MOUNTED PLASTIC JUNCTION BOX FOR ISLAND REFRIGERATED CASES FOR CONNECTION TO CASES BY THE PHASE 3 EQUIPMENT CONTRACTOR.
 - G. ALL WALL MOUNTED OUTLETS SERVING REFRIGERATED CASES WITH RETURN AIR FLENUM ABOVE SHALL BE ACCESSIBLE (WITH ALL WIRING BLENDED) IF APPLICABLE.
 - H. DIMENSIONAL WORK INDICATED SHALL BE SCHEMATICALLY TYPICAL FOR ALL RELATED WORK INCLUDING CORRESPONDING WORK SHOWN ON EMB PLANS.
 - I. ALL ELECTRICAL AND COMMUNICATION JUNCTION/OUTLET BOXES SHOWN AGAINST THE WALL SHALL BE MOUNTED IN THE WALL. REFER TO THE ELECTRICAL EQUIPMENT SCHEDULE FOR MOUNTING INFORMATION.
 - J. IN GENERAL, RECEPTACLES SHOWN WITHOUT EQUIPMENT MARKING OR OTHER CALL OUT ARE CONVENIENCE OUTLETS THAT SHALL BE MOUNTED AT 18" AFF.
 - K. ALL DIMENSIONS SHOWN ON DIMENSION DRAWINGS ARE SHOWN FOR CONVENIENCE. REFER TO THE ELECTRICAL CONTRACTOR'S ELECTRICAL CONTRACT AND FIELD VERIFY EQUIPMENT AND WITH ALL DIMENSIONAL WORK WITH RESPECT TO EQUIPMENT AND WITH ALL AFFECTED PARTIES PRIOR TO DIMENSIONAL WORK.
 - L. SEE DETAIL E1.5.2b FOR DIMENSIONS FOR SPECIAL LIGHTING AND DIMENSIONAL REQUIREMENTS THAT APPLY TO REFRIGERATED CASES.

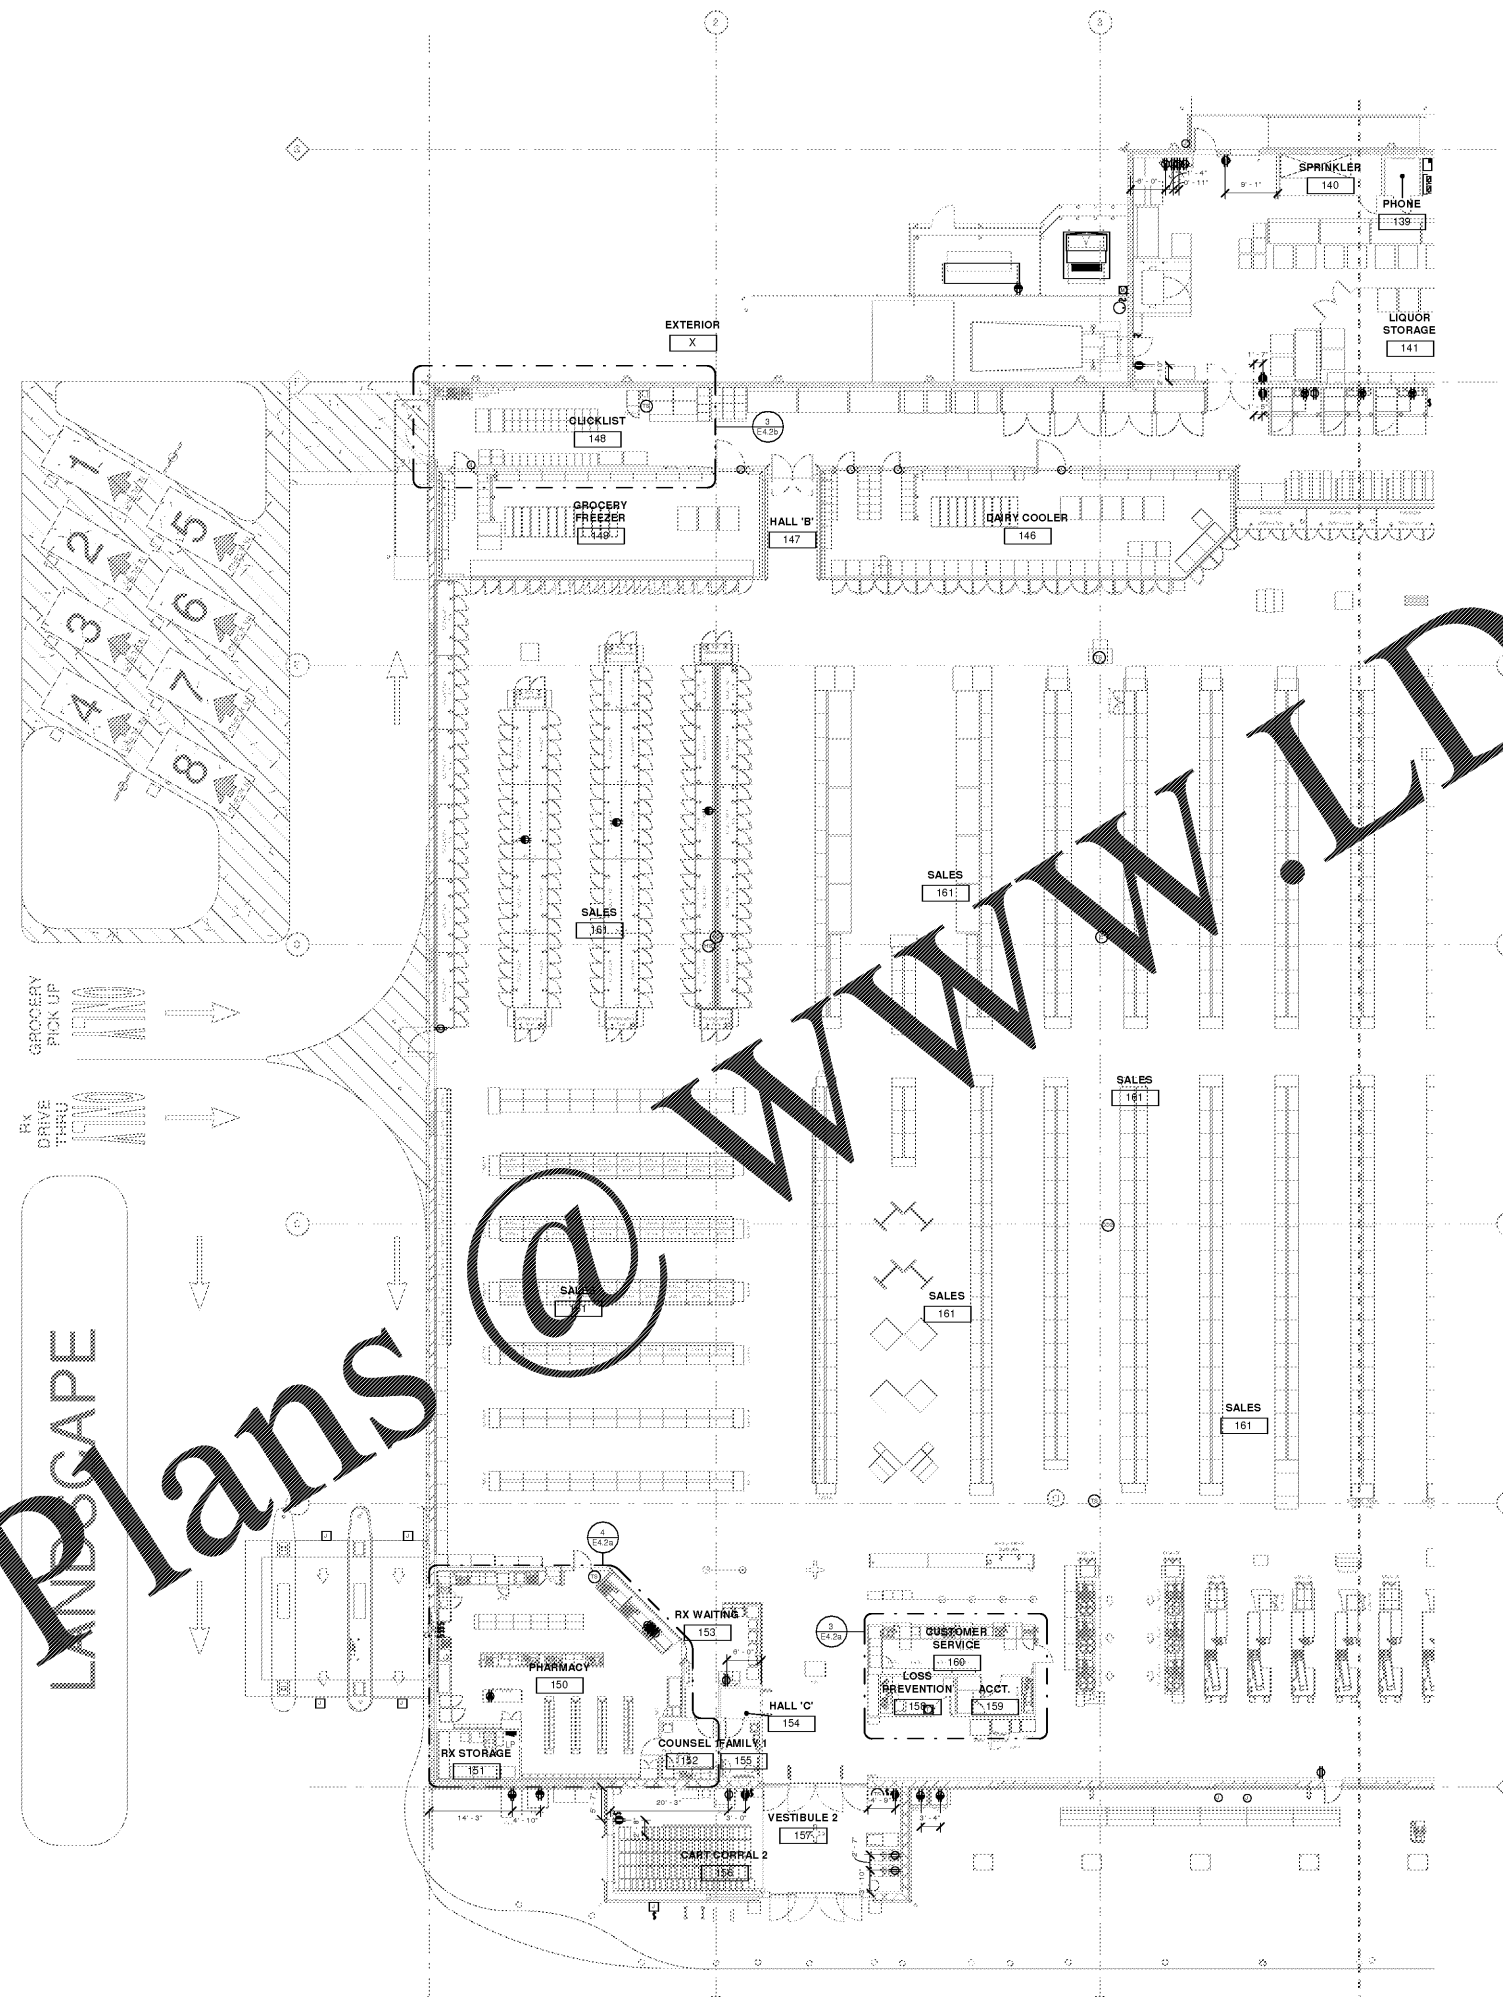

CR
 architecture + design
 creating extraordinary places
 www.cr-architects.com
 500-490-6848

SEKHL
 ENGINEERS
 MECHANICAL/ELECTRICAL ENGINEERS
 WWW.KHENGINEERS.COM
 LEWINGTON, KENTUCKY
 LOUISVILLE, KENTUCKY
 NEW YORK, NEW YORK
 150 ALEXANDRIA PARK SUITE 11
 FT. THOMAS, KENTUCKY 40321
 502-486-8255
 502-442-8256 FAX

OWNER

DATE	ISSUE
10/25/2018	5% OWNER REVIEW
11/01/2018	100% B/PERMIT

DATE	REVISION

PROJECT TITLE
KROGER STORE R543
 MERCURY BLVD.
 HAMPTON, VA
 COMMISSIONING: 5/17/15
 ISSUE DATE: 10/23/2018
 SHEET TITLE
ELECTRICAL POWER DIMENSION PLAN - WEST
 SHEET NO.
E1.5.2a
 ©2017 Architectural Lighting, Inc.

OWNERSHIP OF INSTRUMENTS OF SERVICE
 All rights, title, and interest in the drawings and information provided by the Consultant are instruments of service and shall remain the property of the Consultant. The Consultant, its employees, and other personnel shall not be permitted to reproduce, copy, or disseminate the drawings or information without the written consent of the Consultant. The Consultant, its employees, and other personnel shall not be permitted to use the drawings or information for any other project without the written consent of the Consultant.
 11/10/2018 2:28:53 PM

ELECTRICAL POWER DIMENSION PLAN - WEST
 3/32" = 1'-0"



2" REFERENCE LINE

Order Plans @ WWW.LDILLINC.COM