


OWNERSHIP OF INSTRUMENTS OF SERVICE
 All rights, title, and interest in the drawings and instruments prepared by the Consultant are reserved by the Consultant. No part of these drawings or instruments may be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written consent of the Consultant. The Consultant shall not be held liable for any errors or omissions in these drawings or instruments, including, but not limited to, those caused by the Client's failure to provide accurate information or data.

11/02/18 2:32:29 PM
 PREMISE ALARM - WEST
 3/32" = 1'-0"

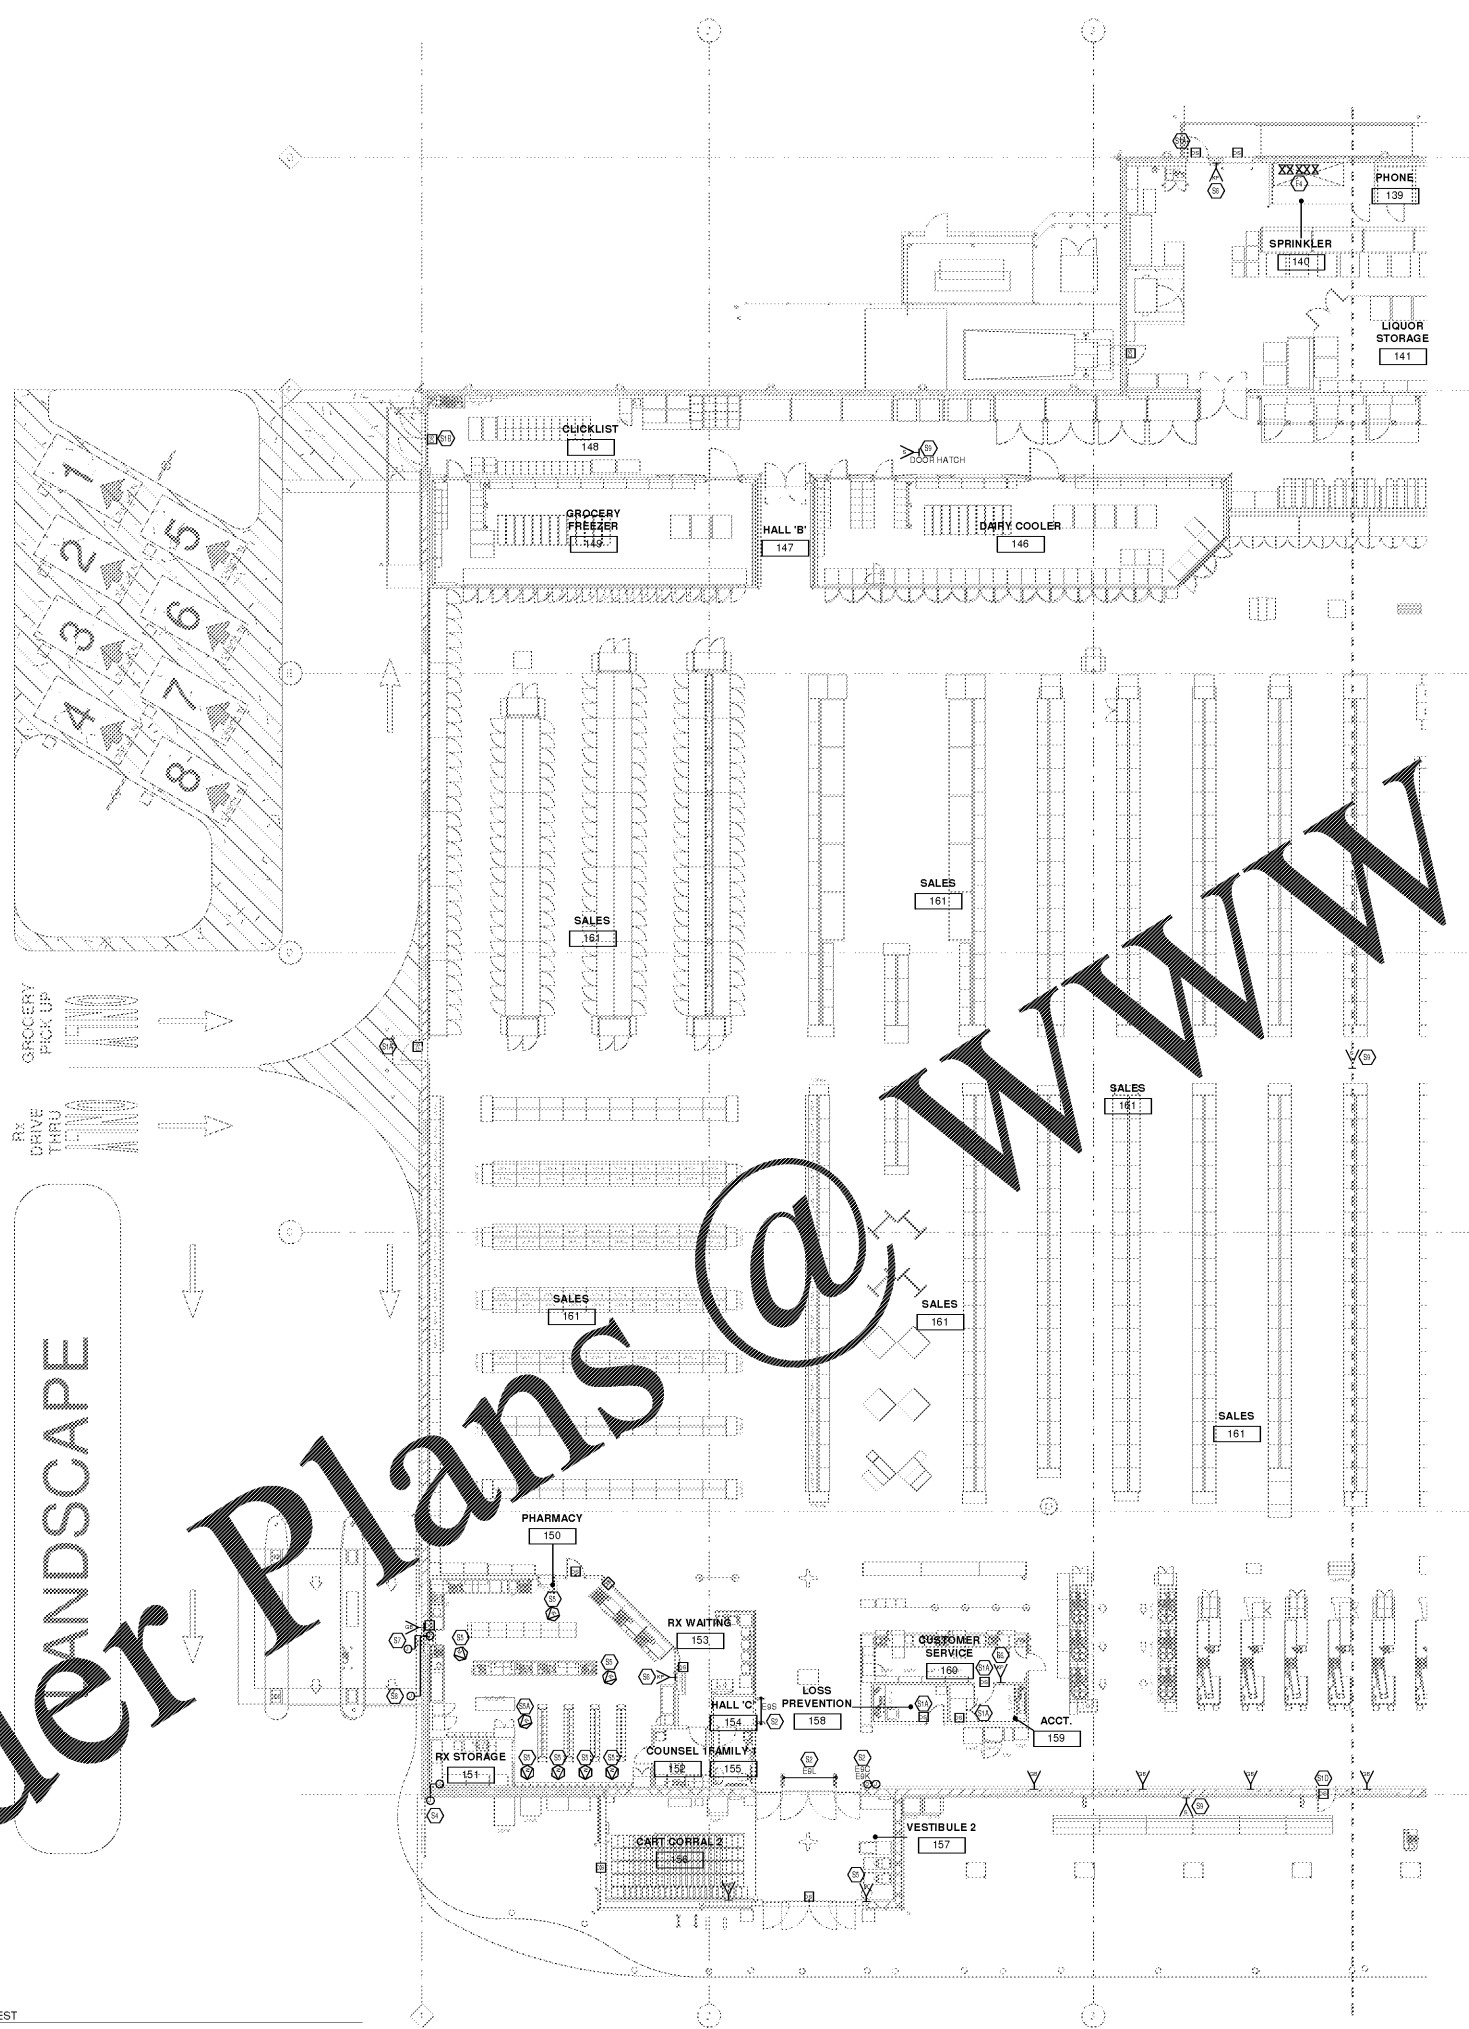

KEYED NOTES

74 PROVIDE MONITORING MONITOR MODULES, CONDUIT, WIRING, CONNECTIONS, PROGRAMMING, ETC.) OF THE FLOW SWITCHES AND TAMPER SWITCHES PROVIDED BY FIRE PROTECTION SPRINKLER CONTRACTOR AT THE FIRE RISER LOCATION. REFER TO SPEC SECTION 28 31 00 FOR REQUIRED UL LISTINGS. COORDINATE EXACT NUMBER OF FLOW AND TAMPER SWITCHES WITH FIRE SUPPRESSION SYSTEM SUPPLIER. TYPICALLY, THERE WILL BE ONE OF EACH FOR EACH SPRINKLER SYSTEM ZONE (APPROXIMATELY 3,000 SQUARE FEET PER ZONE).

75 PROVIDE JUNCTION BOX FOR PREMISE ALARM AT ALARMED EXIT DOOR AS INDICATED ON DETAIL. ESD ON ES-SERIES DRAWINGS. PROVIDE (1) 1/2" EMPTY CONDUIT FROM JUNCTION BOX UP TO 4" X 4" JUNCTION BOX IN JOIST SPACE. COORDINATE LOCATION WITH DECOR ELEMENTS AT ALL DOORS IN SALES & VESTIBULE AREAS. PROVIDE CONNECTION TO AUTOMATICALLY UNLATCH THE LOCK INSTANTLY IN THE EVENT OF A FIRE EMERGENCY OR LOSS OF POWER. SEE FIRE ALARM AND SECURITY SPEC SECTION FOR MORE DETAIL.

76 PROVIDE JUNCTION BOX FOR PREMISE ALARM AT ALARMED EXIT DOORS AS INDICATED ON DETAIL. ESD ON ES-SERIES DRAWINGS. PROVIDE (1) 1/2" EMPTY CONDUIT FROM JUNCTION BOX UP TO 4" X 4" JUNCTION BOX IN JOIST SPACE. COORDINATE LOCATION WITH DECOR ELEMENTS AT ALL DOORS IN SALES & VESTIBULE AREAS. THIS IS LIMITED TO DOOR CONTACTS.

77 PROVIDE JUNCTION BOX FOR PREMISE ALARM AT ALARMED EXIT DOOR AS INDICATED ON DETAIL. ESD ON ES-SERIES DRAWINGS. PROVIDE (1) 1/2" EMPTY CONDUIT FROM JUNCTION BOX UP TO 4" X 4" JUNCTION BOX IN JOIST SPACE. COORDINATE LOCATION WITH DECOR ELEMENTS AT ALL DOORS IN SALES & VESTIBULE AREAS. PROVIDE CONNECTION TO AUTOMATICALLY UNLATCH THE LOCK INSTANTLY IN THE EVENT OF A FIRE EMERGENCY OR LOSS OF POWER. SEE FIRE ALARM AND SECURITY SPEC SECTION FOR MORE DETAIL.

78 PROVIDE (1) 1/2" EMPTY CONDUIT BENEATH FLOOR SLAB FOR INTERCONNECTION OF THEFT DETECTION SECURITY EQUIPMENT COMPONENTS. PROVIDE (1) 3/4" EMPTY CONDUIT FROM FIRST WALL MOUNTED LOCAL CONTROLLER UP TO JOIST SPACE. PROVIDE (1) 1/2" EMPTY CONDUIT FROM WALL MOUNTED CONTROLLER TO LOCAL FLUSH WALL MOUNTED CONTROL INTERFACE KEYPAD. PROVIDE (1) 1/2" EMPTY CONDUIT FROM CONTROLLER TO FIRST PEDIESTAL AND (1) 1/2" EMPTY CONDUIT FROM FIRST PEDIESTAL TO SECOND PEDIESTAL. INSTALL CONDUITS BELOW SLAB WHERE APPLICABLE FOR CONDUIT. LOCAL CONTROLLER SHALL BE INSTALLED ON VESTIBULE SIDE OF WALL ABOVE CEILING AT ALL LOCATIONS WITH ACCESSIBLE ACoustical TILE CEILING OR AT 8' AT LOCATIONS WHERE THERE IS NO FINISHED CEILING. PROVIDE FLUSH WALL MOUNTED BACKBOXES FOR ALL APPLICABLE EQUIPMENT OUTLETS. FIELD COORDINATE ALL LOCATIONS AND SPECIFIC. SEE DETAIL ESD-02 AND ESD-03 ES-SERIES DRAWINGS. COORDINATE WORK WITH DECOR ELEMENTS AT ALL DOORS IN SALES & VESTIBULE AREAS.

79 PROVIDE WP OUTLET/JUNCTION BOX AT OUTDOOR SECURITY EQUIPMENT LOCATION ON ROOF OR HIGH ON WALL AS DETERMINED IN FIELD. PROVIDE (1) 1" EMPTY CONDUIT FROM THE OUTLET/JUNCTION BOX TO ACCESSIBLE INTERIOR JOIST SPACE. PROVIDE WP SERVICE REQUIREMENTS BY ALL SPECIFICATIONS IN ADVANCE.

80 SECURITY SYSTEM MOTION DETECTOR SHALL BE 90" AS MINIMUM. PLEASE NOTE: PROVIDE A 1" EMPTY CONDUIT AND JUNCTION BOX TO THE DETECTOR. PROVIDE ALL WIRE PER SECURITY SYSTEM MANUFACTURER REQUIREMENTS. PROVIDE DETAIL FOR WIRE TO BE INSTALLED ON SALES FLOOR. VERIFY LOCATIONS WITH ALL OTHER PROGRAMS TO BE INSTALLED ON SALES FLOOR.

80A SECURITY SYSTEM MOUNTING DETAIL TO BE MOULDED ABOVE PHARMACY CEILING SPACE. COORDINATE LOCATION WITH OTHER MECHANICAL TO ENSURE BEST POSSIBLE COVER.

81 SECURITY SYSTEM MOUNTING DETAIL TO BE MOULDED ABOVE PHARMACY CEILING SPACE. COORDINATE LOCATION WITH OTHER MECHANICAL TO ENSURE BEST POSSIBLE COVER.

82 PHARMACY WINDOW SECURITY SYSTEM SHALL BE PER MANUFACTURER REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION.

83 PHARMACY WINDOW SECURITY SYSTEM SHALL BE PER MANUFACTURER REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. REFER TO SPEC SECTION 28 31 00 FOR ADDITIONAL INFORMATION.

84 PHARMACY WINDOW SECURITY SYSTEM SHALL BE PER MANUFACTURER REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. REFER TO SPEC SECTION 28 31 00 FOR ADDITIONAL INFORMATION.

85 PHARMACY WINDOW SECURITY SYSTEM SHALL BE PER MANUFACTURER REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. REFER TO SPEC SECTION 28 31 00 FOR ADDITIONAL INFORMATION.

86 PHARMACY WINDOW SECURITY SYSTEM SHALL BE PER MANUFACTURER REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. REFER TO SPEC SECTION 28 31 00 FOR ADDITIONAL INFORMATION.

87 PHARMACY WINDOW SECURITY SYSTEM SHALL BE PER MANUFACTURER REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. REFER TO SPEC SECTION 28 31 00 FOR ADDITIONAL INFORMATION.

88 PHARMACY WINDOW SECURITY SYSTEM SHALL BE PER MANUFACTURER REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. REFER TO SPEC SECTION 28 31 00 FOR ADDITIONAL INFORMATION.

89 PHARMACY WINDOW SECURITY SYSTEM SHALL BE PER MANUFACTURER REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. REFER TO SPEC SECTION 28 31 00 FOR ADDITIONAL INFORMATION.

creating extraordinary places
 www.or-architects.com
 800-490-6846

CONSULTANTS

OR
 architecture + design

CONTRACT: 600 Vire Street
 DENVER, CO 80202
 1878 Broadway, Suite 400
 DENVER, CO 80202
 303-733-4888
 303-733-4888

MECHANICAL/ELECTRICAL ENGINEERS
 WWW.KHENGINEERS.COM

EXEKHL
 ENGINEERS

1501 ALEXANDRIA BLVD, SUITE 11
 FT. THOMAS, KENTUCKY 40325
 502-482-8255
 502-482-8256 FAX

OWNER

Kroger

DATE: 10/25/18
 11/01/18

ISSUE: 50% OWNER REVIEW
 100% BOPERMAT

DATE	REVISION

PROJECT TITLE
KROGER STORE R543

MERCURY BLVD
 HAMPTON, VA

COMMISSION NO: 517315
 ISSUE DATE: 10/23/2018
 SHEET TITLE:
PREMISE ALARM - WEST

SHEET NO:
ET1.2a

©2018 Architectural Resources, Inc.

Order Plans @ WWW.LDIDIRECT.COM