


**KEYED NOTES**

- 81A PROVIDE JUNCTION BOX FOR PREMISE ALARM AT ALARMED EXIT DOOR AS INDICATED ON DETAIL ESD-23 ON E-SERIES DRAWINGS. PROVIDE (1) 1/2" EMPTY CONDUIT FROM JUNCTION BOX UP TO 4" X 4" JUNCTION BOX IN JOIST SPACE. COORDINATE LOCATION WITH DECOR ELEMENTS AT ALL DOORS IN SALES & VESTIBULE AREAS. PROVIDE CONNECTION TO AUTOMATICALLY UNLATCH THE LOCK INSTANTLY IN THE EVENT OF A FIRE EMERGENCY OR LOSS OF POWER. SEE FIRE ALARM AND SECURITY SPEC SECTION FOR MORE DETAIL.
- 81C PROVIDE JUNCTION BOX FOR PREMISE ALARM AT ALARMED EXIT DOOR AS INDICATED ON DETAIL ESD-23C ON E-SERIES DRAWINGS. PROVIDE (1) 1/2" EMPTY CONDUIT FROM JUNCTION BOX UP TO 4" X 4" JUNCTION BOX IN JOIST SPACE. COORDINATE LOCATION WITH DECOR ELEMENTS AT ALL DOORS IN SALES & VESTIBULE AREAS. PROVIDE CONNECTION TO AUTOMATICALLY UNLATCH THE LOCK INSTANTLY IN THE EVENT OF A FIRE EMERGENCY OR LOSS OF POWER. SEE FIRE ALARM AND SECURITY SPEC SECTION FOR MORE DETAIL.
- 82 PROVIDE (1) 1" EMPTY CONDUIT BENEATH FLOOR SLAB FOR INTERCONNECTION OF THE DETECTION SECURITY EQUIPMENT COMPONENTS. PROVIDE (1) 3/4" EMPTY CONDUIT FROM FIRST WALL LOCATION LOCAL CONTROLLER UP TO JOIST SPACE. PROVIDE (1) 1/2" EMPTY CONDUIT FROM WALL MOUNTED CONTROLLER TO LOCAL FLUSH WALL MOUNTED CONTROL INTERFACE KEYPAD. PROVIDE (1) 3/4" EMPTY CONDUIT FROM CONTROLLER TO FIRST PEDestal AND (1) 1/2" EMPTY CONDUIT FROM FIRST PEDestal TO SECOND PEDestal. INSTALL CONDUITS BELOW SLAB WHERE AVAILABLE FOR CONCEALMENT. LOCAL CONTROLLER SHALL BE INSTALLED ON VESTIBULE SIDE OF WALL (ABOVE CEILING) AT LOCATIONS WITH ACCESSIBLE ACoustICAL TILE CEILING. AT 8' BY 8' AT LOCATIONS WHERE THERE IS NO FINISHED CEILING, PROVIDE FLUSH WALL MOUNTED KEYPAD FOR ALL LOCAL CONTROLLER EQUIPMENT. COORDINATE ALL LOCAL CONTROLLER AND SPECIFIC KEYPAD WITH DECOR ELEMENTS IN SALES & VESTIBULE AREAS.
- 84 PROVIDE VIDEO DETECTION CAMERA ON CHANGES IN WALL AS SHOWN (FIELD). PROVIDE (1) 1" EMPTY CONDUIT FROM VIDEO DETECTION CAMERA TO ACCESSIBLE INTERIOR JOIST SPACE. PROVIDE (1) 1/2" EMPTY CONDUIT FROM JOIST SPACE TO VIDEO DETECTION CAMERA HEAD IF REQUIRED. FIELD BY ADVANCE.
- 85 SECURITY SYSTEM MOTION DETECTOR. MOUNT AT 8'0" A.F.F. UNLESS OTHERWISE NOTED. PROVIDE (1) 1" EMPTY CONDUIT AND JOINT TO JOIST SPACE. PROVIDE ALL WIRING PER SECURITY SYSTEM MANUFACTURER'S REQUIREMENTS. DETECTOR HEAD WILL BE PENDANT MOUNTED ON SALES AREA. VERIFY LOCATIONS WITH ALL OTHER DISCIPLINES PRIOR TO ROUGH-IN.
- 86 SECURITY SYSTEM KEYPAD. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION.
- 87 SECURITY SYSTEM BIREN. VERIFY EXACT INSTALLATION REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION. REFER TO SPEC SECTION 28 31 00 FOR ADDITIONAL INFORMATION.
- 812 PROVIDE SECURITY SYSTEM MONITORING DEVICE FOR EQUIPMENT SHOWN PER SPEC SECTION 28 31 00. FIELD VERIFY EXACT LOCATION.

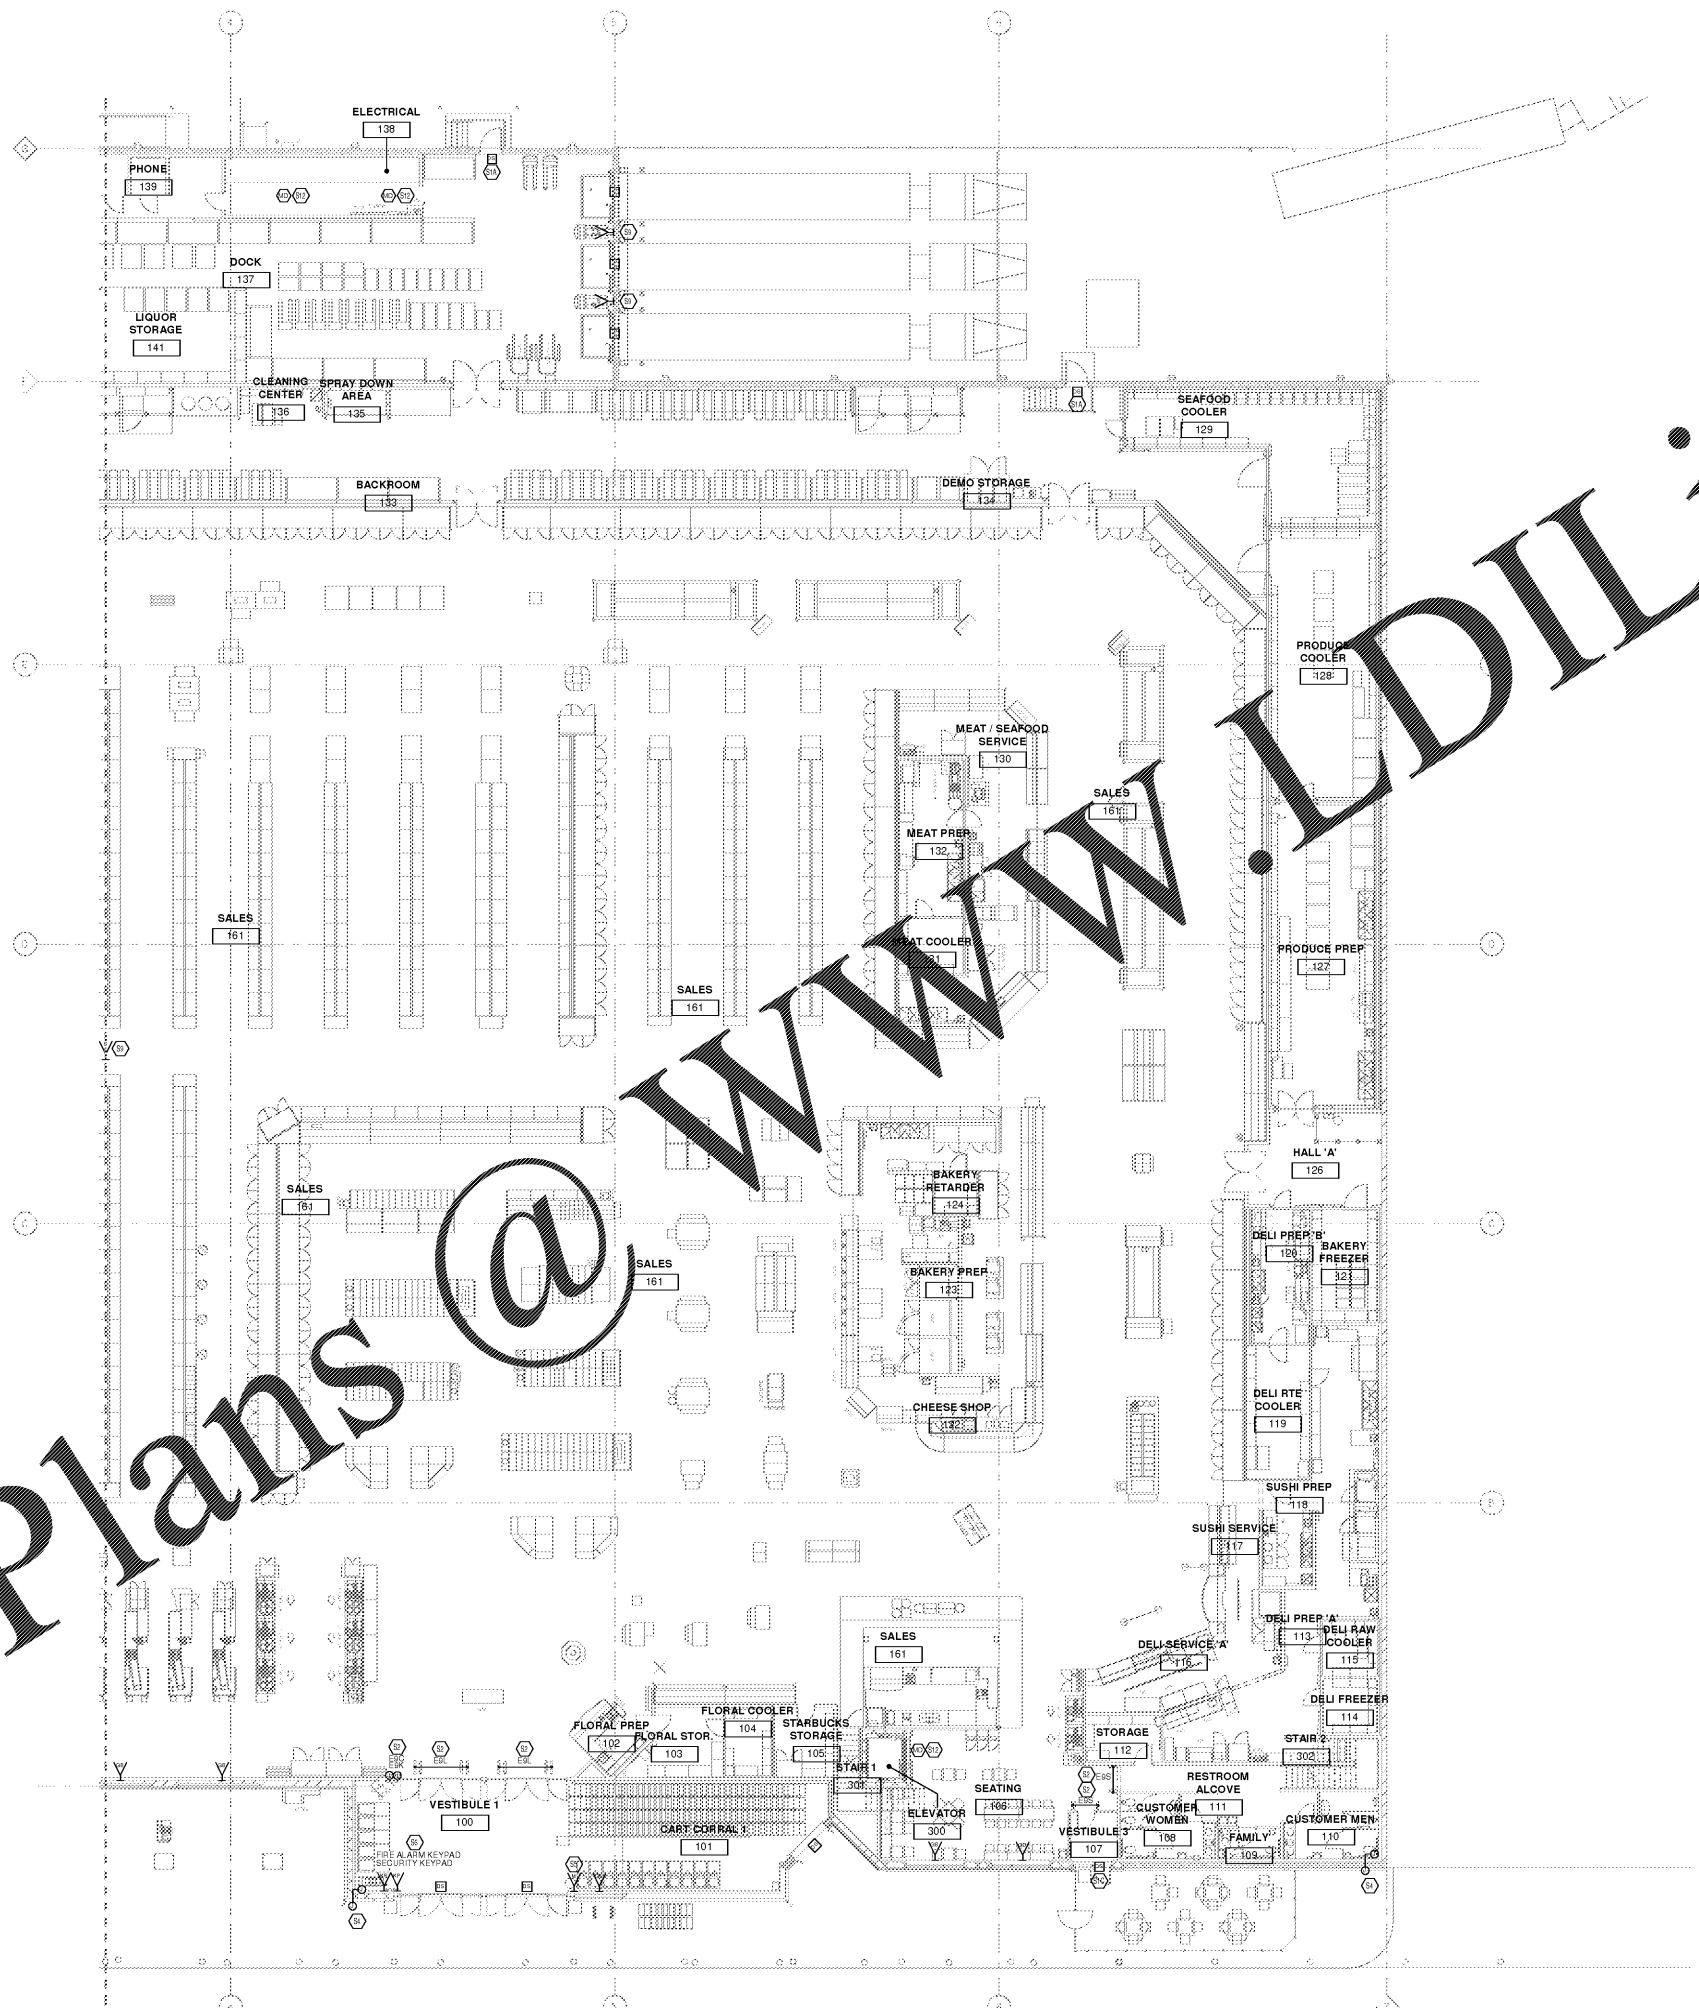

ORDERING OF MATERIALS OR SERVICE...  
 ALL RIGHTS RESERVED...  
 11/10/2018 2:32:44 PM

1 PREMISE ALARM - EAST  
 REFER TO SHEET ET1.2a FOR NOTES THAT MAY APPLY TO THIS SHEET.

CONSULTANTS  
**CR2**  
 architecture + design  
 creating extraordinary places  
 www.cr2architects.com  
 800-492-6842

MECHANICAL/ELECTRICAL ENGINEERS  
 WWW.KHENGERS.COM  
**KEKLH**  
 ENGINEERS  
 1501 ALEXANDRIA BLVD. SUITE 11  
 FT. THOMAS, KENTUCKY 40310  
 502-253-9255  
 859-442-8286 FAX

OWNER  
  
 DATE: 10/25/18  
 ISSUE: 11/01/2018  
 50% OWNER REVIEW  
 100% BOPERMAT

DATE	REVISION

PROJECT TITLE  
**KROGER STORE R543**  
 MERCURY BLVD.  
 HAMPTON, VA  
 COMMISSIONING: 517315  
 ISSUE DATE: 10/23/2018  
 SHEET TITLE  
**PREMISE ALARM - EAST**

SHEET NO.  
**ET1.2b**  
 ©2017 Kheel Architects, Inc.

Order Plans @ WWW.LDILLINE.COM