


KEYED NOTES  
 D4 CONNECT SENSOR TO NEAREST RLDS PANEL



CINCINNATI 603 Vine Street, Suite 200, Cincinnati, OH 45202  
 DENVER 1475 Broadway, Suite 1000, Denver, CO 80202  
 SEATTLE 805 3rd Avenue, Suite 400, Seattle, WA 98104

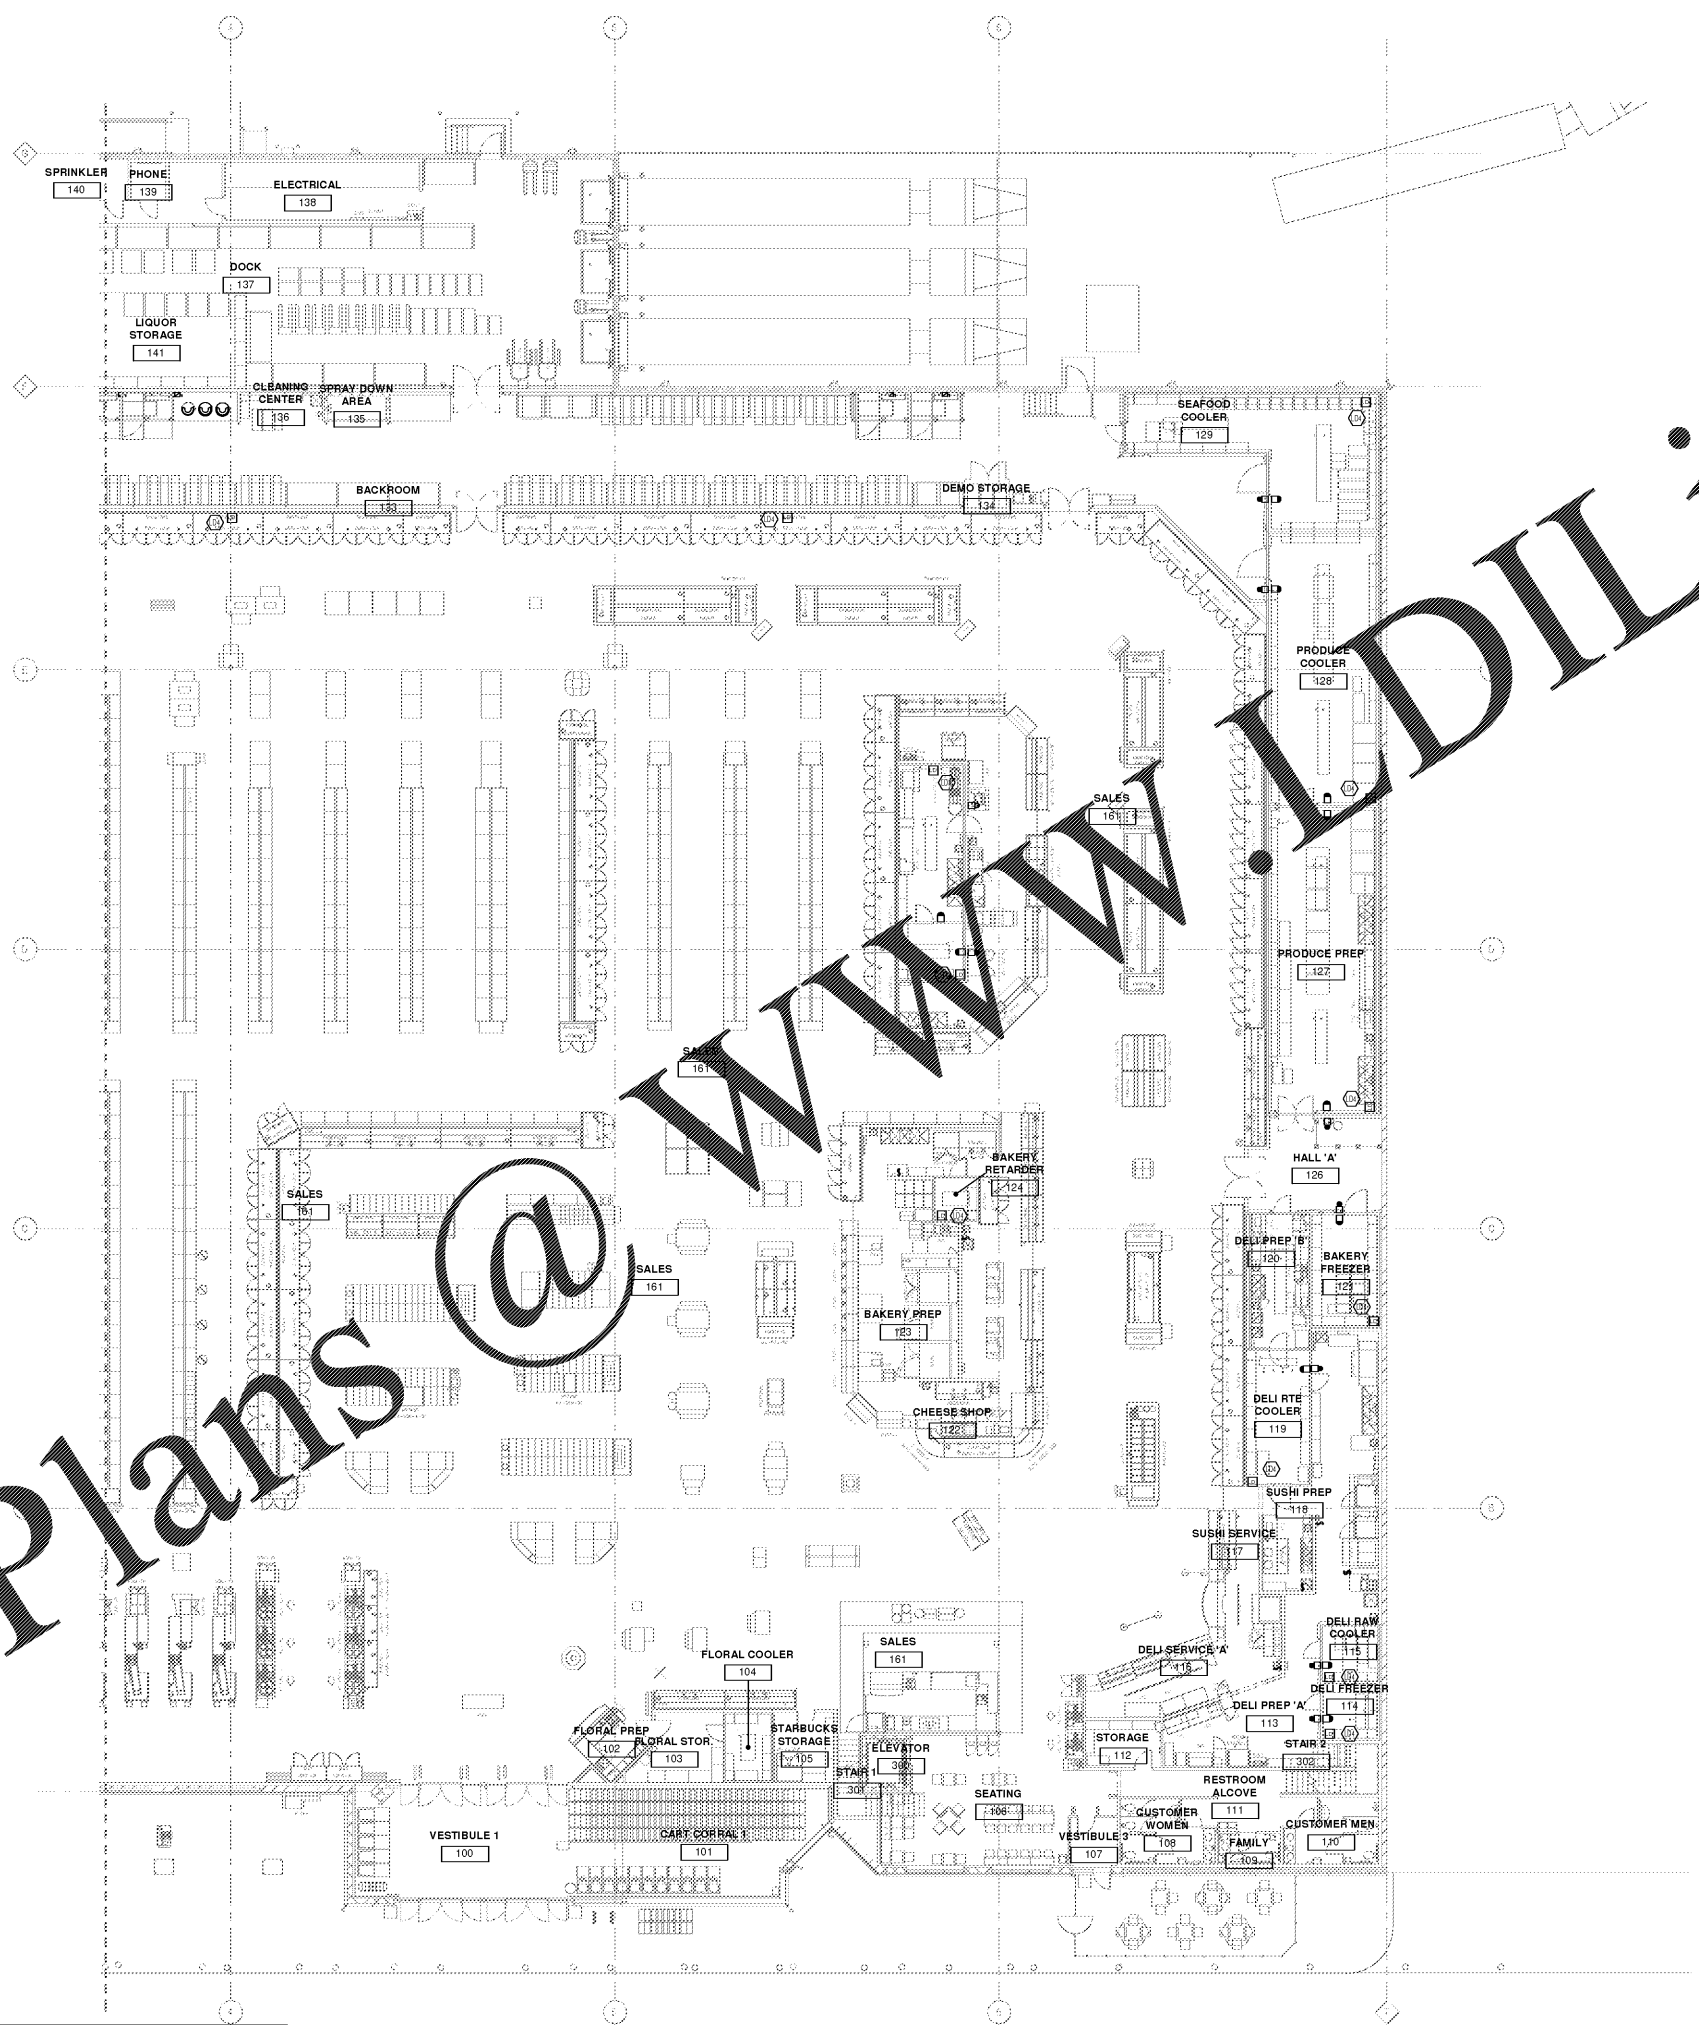

creating extraordinary places  
 www.cr-architects.com  
 502-492-6342

MECHANICAL/ELECTRICAL ENGINEERS  
 WWW.KHENGINEERS.COM  
 LEWISTON, KENTUCKY  
 LOUISVILLE, KENTUCKY  
 NEW YORK, NEW YORK

150 ALEXANDRIA BREEZES SUITE 11  
 FT. THOMAS, KENTUCKY 40310  
 502-492-6342  
 502-442-8286 FAX



DATE	ISSUE
10/25/18	5% OWNER REVIEW
11/01/18	100% BOPERMAT

DATE	REVISION

PROJECT TITLE  
**KROGER STORE R543**  
 MERCURY BLVD.  
 HAMPTON, VA

COMMISSIONING 517315  
 ISSUE DATE 10/23/2019  
 SHEET TITLE  
**REFRIGERATION LEAK DETECTION FLOOR PLAN - EAST**

SHEETING  
**EM1.2b**  
 2019 Jacobsen Architects, Inc.

OWNER/ENGINEER OF RECORD  
 All notes, plans, specifications, drawings, and data are the property of the Consultant and shall remain confidential. No part of this document may be reproduced or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of the Consultant. The Consultant, its employees, and its agents shall not be held liable for any damages, including consequential damages, arising out of the use of this document. 11/10/2018 2:31:52 PM

REFRIGERATION LEAK DETECTION FLOOR PLAN - EAST  
 3/32" = 1'-0"  
 REFER TO SHEET EM1.2a FOR NOTES THAT MAY APPLY TO THIS SHEET.

2" REFERENCE LINE



Order Plans @ [www.LDILine.com](http://www.LDILine.com)