




RULE JOY TRAMMELL RUBIO
 ARCHITECTURE | INTERIOR DESIGN
 300 Galleria Parkway Suite 740 Atlanta, Georgia 30329
 770-661-1492 (phone) 770-661-1493 (fax)
 www.rjtdesign.com

PRINTED
 DATE 11/01/18
 ISSUE/REVISION ISSUED FOR PERMIT


JB Electrical Design, P.C.
 Electrical Consulting Engineers
 9338 Birchmont
 Minneapolis, MN 55445
 763-888-0965
 jrb@jb-electrical.com
 JBELEP Reg. No. 2013-063
 ©2018 by JB Electrical Design, P.C.



LEVEL ONE FLOOR PLAN - LIGHTING
EXTENDED STAY AMERICA
 POOLER, GA

COMMISSION NO. 18-120.00
 DRAWING NO.

E201

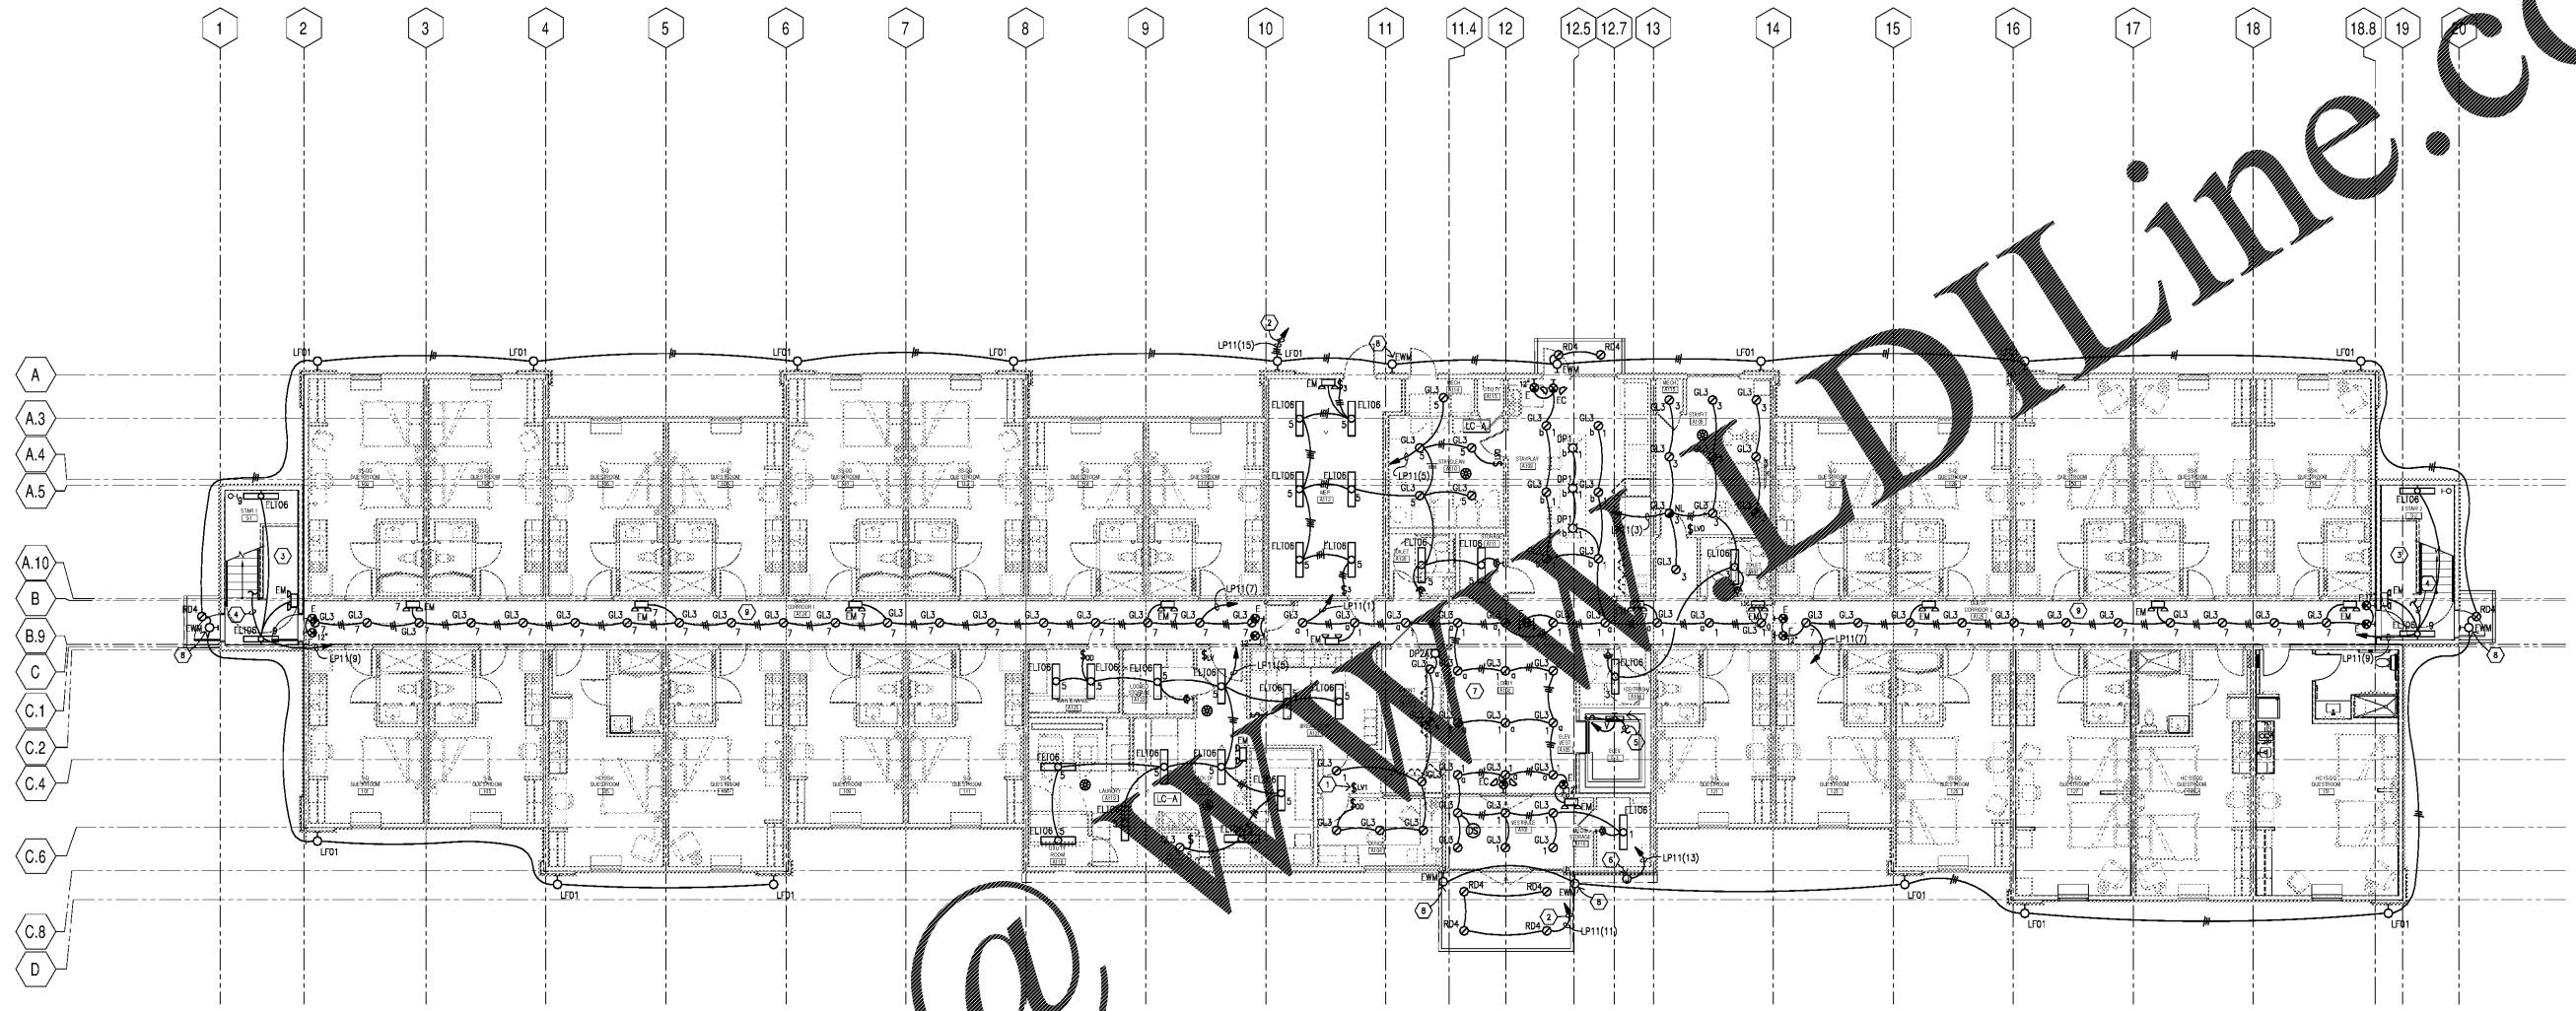

1 LEVEL ONE FLOOR PLAN LIGHTING
 E201 1/8" = 1'-0"



- SHEET NOTES**
- 1 MAN LIGHTING CONTROL STATION. SEE E701.
 - 2 ROUTE THROUGH LIGHTING CONTROL PANEL LCP-1. SEE DETAIL ON E701.
 - 3 LIGHTS IN STAIRWELL SHALL BE WIRED FOR ALWAYS ON OPERATION. TO LIGHTS IN STAIR AT LEVEL ABOVE.
 - 4 INSTALL LIGHTS AND SWITCH IN ELEVATOR PIT. PROVIDE WIRING TO RECEPTION IN PIT. COORDINATE LOCATION WITH EQUIPMENT.
 - 5 PROVIDE 120V CONNECTION TO SIGN. PROVIDE DISCONNECT AS REQUIRED BY NEC 500.
 - 6 PROVIDE DIMMING CONTROLLER FOR LIGHTING CONTROL IN THIS ROOM. ROUTE CIRCUIT THROUGH CONTROLLER. REFER TO LIGHTING CONTROL SYSTEM DIAGRAM ON E701.
 - 7 EXTERIOR EMERGENCY LIGHT. CIRCUIT TO UNSWITCHED CONDUCTOR.
 - 8 CORRIDOR LIGHTING SHALL BE CIRCUITED FOR ALWAYS ON OPERATION.

- GENERAL NOTES**
- A. SEE DRAWING E701 FOR LIGHT FIXTURE SCHEDULE.
 - B. EXIT, EMERGENCY, AND NIGHT LIGHTS SHALL BE CIRCUITED TO UNSWITCHED CONDUCTOR.
 - C. PROVIDE ALL BRANCH CIRCUIT WIRING AS REQUIRED FOR COMPLETE INSTALLATION AND OPERATION. PROVIDE ALL 0-10V WIRING AS REQUIRED FOR COMPLETE INSTALLATION AND OPERATION. 0-10V WIRING SHALL BE IN CONDUIT WHERE CEILINGS ARE EXPOSED OR BE PLENUM RATED CABLE ABOVE ACCESSIBLE CEILINGS AND COMPLY WITH NEC CLASS 2 WIRING METHODS.
 - D. PROVIDE A SEPARATE NEUTRAL FOR EACH CIRCUIT. MULTI-WIRE BRANCH CIRCUITS ARE NOT PERMITTED UNLESS NOTED OTHERWISE.
 - E. LIGHTING CONTROL SYSTEM OCCUPANCY SENSORS ARE SHOWN FOR BIDDING PURPOSES. SYSTEM SUPPLIER SHALL PROVIDE SHOP DRAWINGS INDICATING BEST SENSOR PLACEMENT AND QUANTITIES FOR PROPER COVERAGE AND OPERATION TO COMPLY WITH REQUIREMENTS.
 - F. REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT LOCATIONS OF LIGHT FIXTURES.
 - G. REFER TO ARCHITECTURAL DRAWINGS FOR LOCATIONS OF EXITS AND CHEVRON ARROW INDICATIONS.
 - H. VERIFY CEILING CONSTRUCTION WITH ARCHITECTURAL DRAWINGS AND GENERAL CONTRACTOR. PROVIDE ALL NECESSARY MOUNTING HARDWARE FOR COMPLETE INSTALLATION OF LIGHT FIXTURES.
 - I. WHERE RECESSED FIXTURES ARE INSTALLED IN FIRE RATED CEILINGS, PROVIDE FIRE RATED BOX OR ENCLOSURE AS REQUIRED BY CODE TO MAINTAIN RATING OF CEILING.
 - J. COORDINATE LIGHT FIXTURE LOCATIONS AND RACEWAY INSTALLATION WITH MECHANICAL EQUIPMENT AND DUCTWORK AND PIPING SYSTEMS PRIOR TO ROUGH-IN. LIGHT FIXTURE LOCATIONS TAKE PRECEDENCE.
 - K. CAULK/SEAL ALL WALL PENETRATIONS WITH APPROPRIATE SEALANT. PENETRATIONS THROUGH FIRE RATED WALLS/CEILINGS SHALL BE SEALED WITH AN APPROVED FIRESTOP SYSTEM FOR THE RATING OF THE ASSEMBLY.
 - L. DO NOT INSTALL CONDUITS EXPOSED ON EXTERIOR OF BUILDING. CONDUITS SHOWN ARE TO PROVIDE DESIGN INTENT OF CIRCUITING AND CONTROL.

Order Plans @