




RULE JOY TRAMMELL RUBIO
 ARCHITECTURE | INTERIOR DESIGN
 300 Galleria Parkway Suite 740 Atlanta, Georgia 30329
 770-661-1492 (phone) 770-661-1493 (fax)
 www.rjtdesign.com

PRINTED
 DATE 11/01/18
 ISSUE/REVISION
 ISSUED FOR PERMIT


JB Electrical Design, P.C.
 Electrical Consulting Engineers
 8330 Birchmont
 Minneapolis, MN 55445
 763-488-0965
 jrb@jb-electrical.com
 ILL. Reg. No. 2013-065
 ©2018 by JB Electrical Design, P.C.




LEVEL TWO FLOOR PLAN POWER & SYSTEMS
EXTENDED STAY AMERICA
 POOLER, GA

COMMISSION NO: 18-120-00
 DRAWING NO:

E302

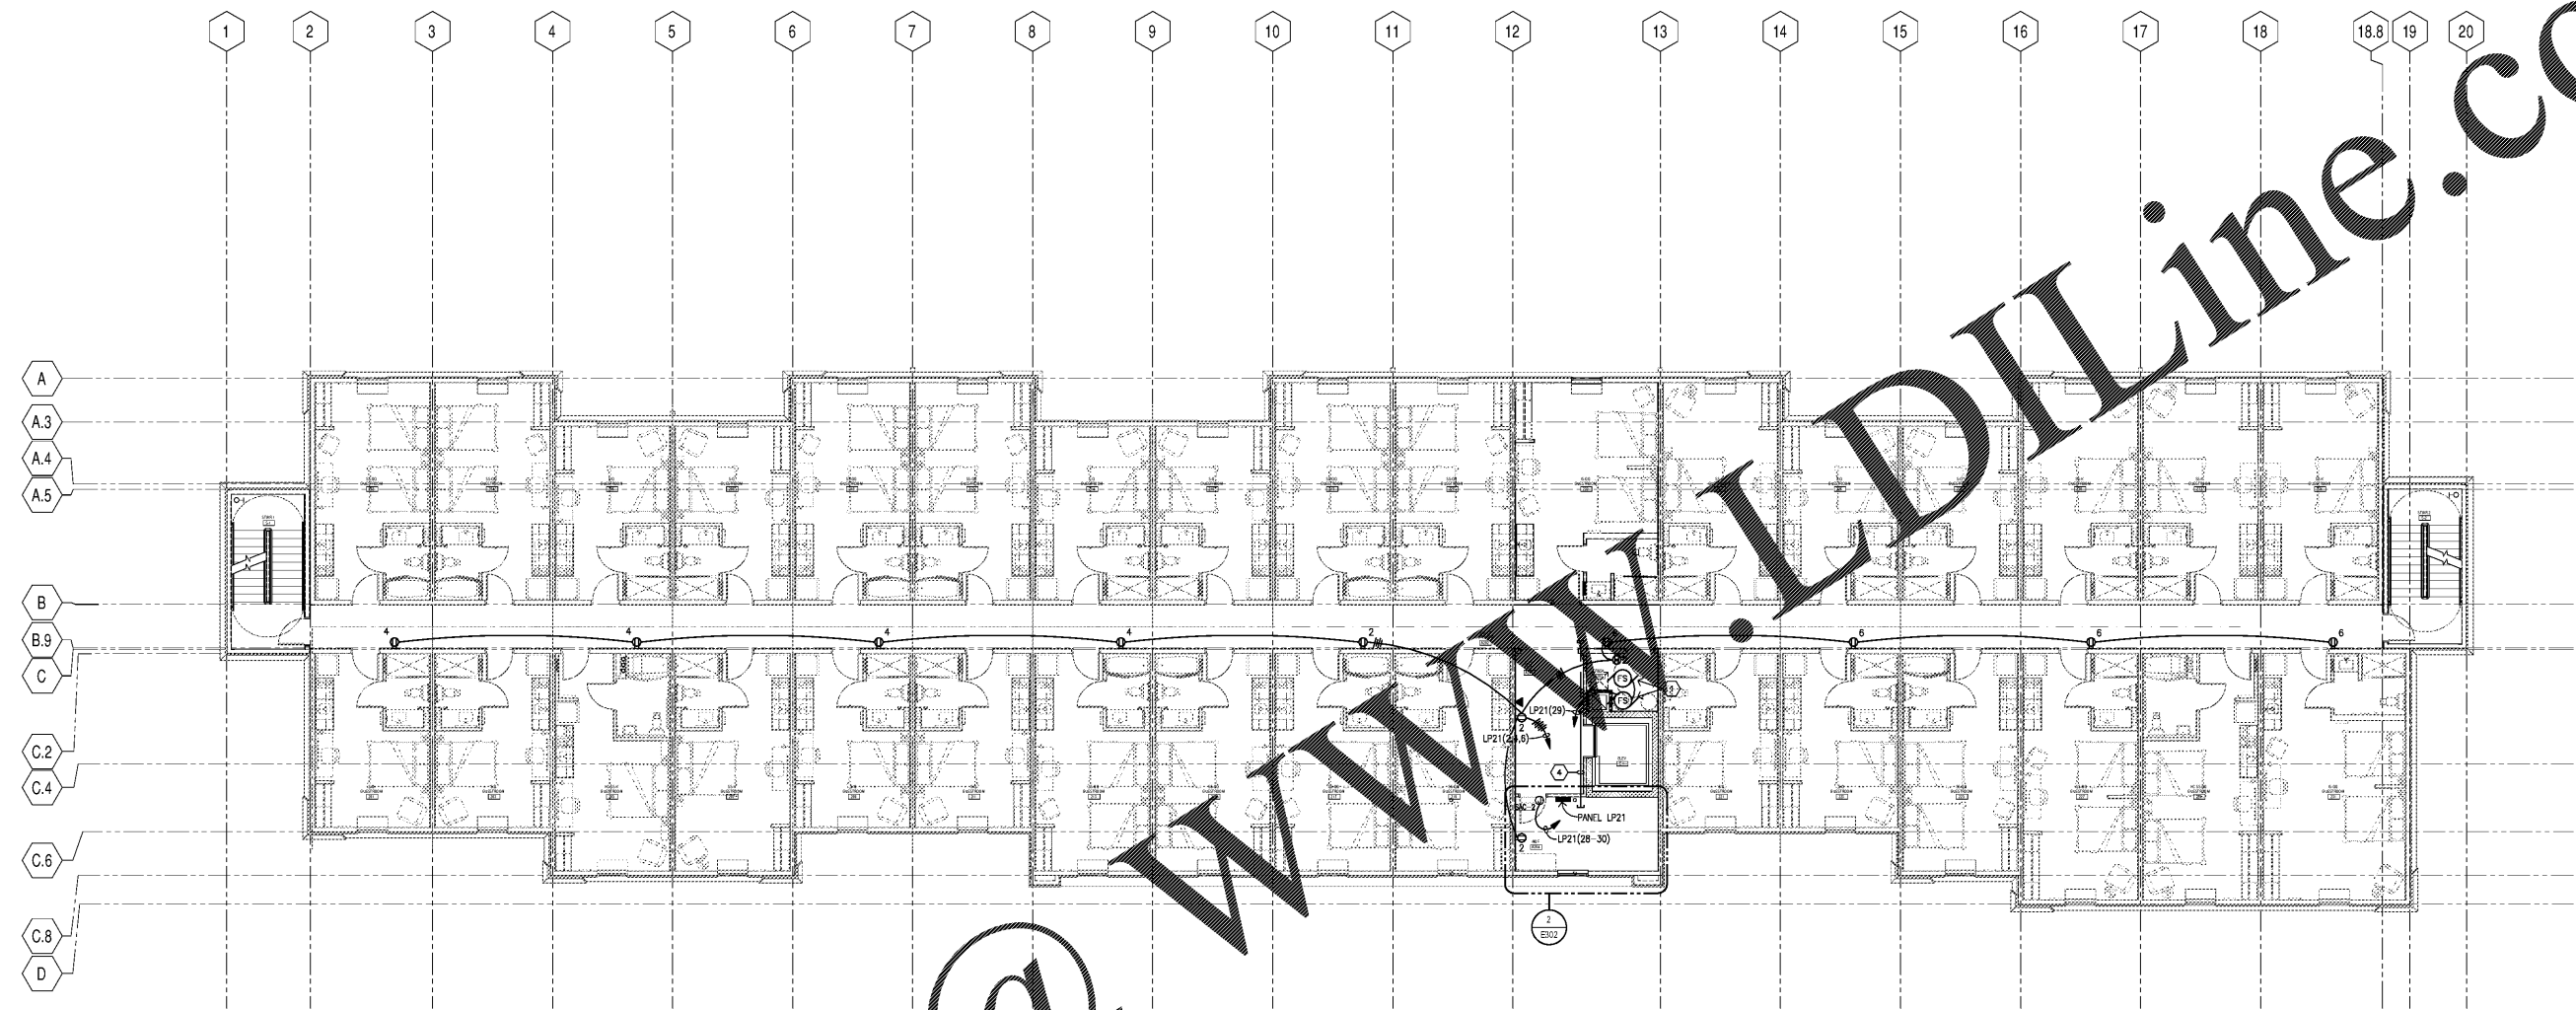

1 LEVEL TWO FLOOR PLAN - POWER & SYSTEMS
 E302
 1/8" = 1'-0"

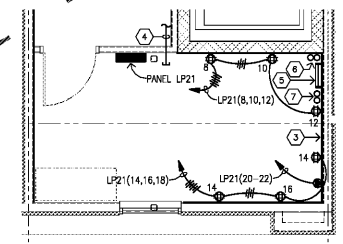

2 LARGE SCALE MDF ROOM - POWER & SYSTEMS
 E302
 1/4" = 1'-0"

- SHEET NOTES**
- ① COORDINATE FIRE/SMOKE DAMPER LOCATIONS WITH MECHANICAL CONTRACTOR.
 - ②
 - ③ PROVIDE 3/4" PLYWOOD BACKBOARD ON THREE WALLS IN THIS ROOM. REFER TO DETAIL 3/E301.
 - ④ PROVIDE (2) 4" C'S ABOVE CEILING IN CORRIDOR FOR LOW VOLTAGE CABLING. REFER TO DRAWING T101.
 - ⑤ PROVIDE GROUNDING BAR. SEE DETAIL 6/E301.
 - ⑥ INCOMING CONDUITS FROM BELOW.
 - ⑦ CONDUITS UP TO FLOOR ABOVE AND FLOOR BELOW. SEE DETAIL 4/E301.

- GENERAL NOTES**
- A. SEE DRAWINGS E301 FOR ONE-LINE DIAGRAM AND E311 AND E312 FOR PANEL SCHEDULES.
 - B. SEE DRAWING E301 AND E301 FOR DETAILS.
 - C. SEE ARCHITECTURAL DRAWINGS FOR WALL TYPES. SEAL ALL WALL PENETRATIONS WITH APPROPRIATE SEALANT. COORDINATE FIRE PROOFING REQUIREMENTS FOR PENETRATIONS AND PROVIDE UL LISTED FIRESTOP SYSTEM AS REQUIRED.
 - D. CONTRACTOR SHALL REVIEW MECHANICAL DRAWINGS AND COORDINATE ELECTRICAL EQUIPMENT LOCATIONS WITH MECHANICAL EQUIPMENT, DUCT WORK AND PIPING. COORDINATE EQUIPMENT CONNECTION REQUIREMENTS WITH SHOP DRAWINGS. MAKE ALL WIRING CONNECTIONS AS REQUIRED. PROVIDE DISCONNECTS AND SWITCHES AS REQUIRED.
 - E. ALL 120V CIRCUITS SHALL HAVE SEPARATE NEUTRALS. MULTI-WIRE BRANCH CIRCUITS ARE NOT PERMITTED UNLESS NOTED OTHERWISE.
 - F. GFCI RECEPTACLES SHALL BE WIRED TO PROTECT ONLY THAT DEVICE AND NOT DOWNSTREAM DEVICES UNLESS NOTED OTHERWISE.
 - G. REFER TO DRAWING E411 FOR LARGE SCALE GUEST ROOM PLANS.
 - H. DEVICE MOUNTING HEIGHTS ARE NOT SHOWN ON ELECTRICAL DRAWINGS. COORDINATE MOUNTING HEIGHTS OF DEVICE WITH ARCHITECTURAL ELEVATIONS PRIOR TO ROUGH-IN.
 - I. ADDITIONAL FIRE ALARM REQUIREMENTS ARE SHOWN ON THE LARGE SCALE ROOMS PLANS.
 - J. FIRE ALARM VISUAL DEVICES ARE RATED FOR 1500 UNLESS NOTED OTHERWISE.
 - K. WIRELESS ACCESS POINT (WAP) AND SECURITY CAMERA LOCATIONS AS REQUIRED SHALL BE DETERMINED BY OWNER.
 - L. 120V CIRCUITS THAT EXCEED 100-FT IN LENGTH SHALL BE INCREASED IN SIZE TO #10 WIRE. 120V CIRCUITS THAT EXCEED 150-FT IN LENGTH SHALL BE INCREASED IN SIZE TO #8 WIRE.
 - M. PROVIDE COMMUNICATIONS FOR HEARING IMPAIRED ROOMS. SEE LARGE SCALE GUEST ROOM DRAWINGS ON E411.
 - N. COORDINATE SMOKE DETECTOR LOCATIONS WITH CEILING ELEMENTS. DO NOT INSTALL ON ACCESS PANELS.
 - O. COORDINATE LOW VOLTAGE WORK WITH LOW VOLTAGE CONTRACTOR. REFER TO T (TECHNOLOGY) DRAWINGS FOR ADDITIONAL INFORMATION.

Order Plans @