


1 EPOS PLAN  
E5 SCALE: 1/4" = 1'-0"

2 ELECTRONIC HARDWARE CABINET ELEV.  
E5 SCALE: 1" = 1'-0"

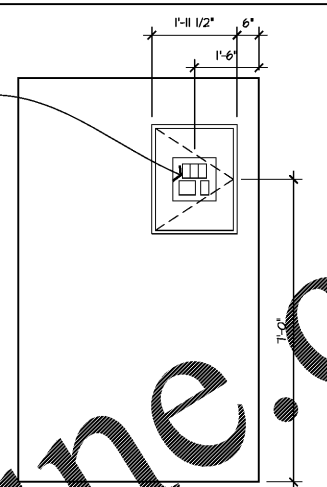

- KNOCK OUT PANEL IN BACK OF CABINET (12"x12"). ALL RECEPTACLES AND JUNCTION BOXES MUST BE INSTALLED WITHIN THIS AREA. ELECTRICAL CONTRACTOR TO PROVIDE THE FOLLOWING AT THIS LOCATION:
- 120V ISOLATED/INSULATED FOURPLEX RECEPTACLE
  - 120V CONVENIENCE DUPLEX OUTLET
  - 3 OPEN CONDUITS STUBBED UP TO AN ACCESSIBLE AREA ABOVE FINISHED CEILING.
- CONDUITS TO BE:
- 3/4" FOR TELEPHONE LINES
  - 1" FOR SECURITY SYSTEM CABLING
  - 1 1/2" FOR EPOS CABLING.

SYM	DESCRIPTION
CR	CASH REGISTER
VM	VIDEO MONITOR
J	JUNCTION BOX (SINGLE GANG)
PR	PRINTER
QT	DRIVE-THRU TIMER
TV	TELEVISION
DTCS	DRIVE THRU COMMUNICATIONS SYSTEM
DFP	DIGITAL FEATURE PANEL

SYM	DESCRIPTION
1/2"	(1) OR (2) CAT 5 CABLES
3/4"	(3) OR (4) CAT 5 CABLES
1"	(5) OR (6) CAT 5 CABLES
1 1/4"	(7) OR (8) CAT 5 CABLES

- GENERAL NOTES**
- ALL CAT 5 CABLE MAY BE PROVIDED AND INSTALLED BY EPOS VENDOR, SEE NATIONAL VENDORS LIST FOR CONTACT INFORMATION. COORDINATE INSTALLATION AND FIXTURES WITH EPOS VENDOR BY CONTRACTOR CHOSEN BY FRANCHISEE.
  - CABLING AND FIXTURES TO BE SCHEDULED AT END OF EQUIPMENT INSTALLATION TIME FRAME.
  - THE ELECTRICAL CONTRACTOR TO PROVIDE ALL CUTTING, TRENCHING, BACK FILLING, AND PATCHING AS MAY BE REQUIRED AND SHALL BE INCLUDED AS PART OF THE ELECTRICAL CONTRACTORS WORK.
  - ELECTRICAL CONTRACTOR PROVIDE AND INSTALL ALL REQUIRED CONDUIT, PULL BOXES, JUNCTION BOXES AND PULL STRINGS. ANY QUESTIONS REGARDING LOCATION OF JUNCTION BOXES TO BE DIRECTED TO ADQ ARCHITECTURE/CONSTRUCTION DEPARTMENT AT 800.985.6686 EXT. #5.
  - VERIFY LOCAL CODES REQUIRE A LOW VOLTAGE PERMIT.
- KEY NOTES**
- ALL MONITOR AND TERMINAL LOCATIONS WILL REQUIRE IN-WALL JUNCTION BOX WITH CONDUIT STUBBED INTO THE CEILING SPACE AND A MINIMUM OF ONE FEET OF EXCESS CABLE AT EACH END OF RUN. 1 1/2" GROMMETS AT INITIAL CASH REGISTER LOCATIONS.
  - THESE MONITORS AND TERMINALS WILL NEED A MINIMUM OF TWO FEET EXCESS CABLE AT EACH END OF RUN.
  - PROVIDE 1" CONDUIT WITH (1) 18 GAUGE WIRE AND (2) 22 GAUGE WIRE FROM THE MENU BOARD TO THE VEHICLE DETECTOR AND CENTER MODULE. THE (2) 22 GAUGE WIRES WILL RUN FROM THE SPEAKER POST TO THE CENTER MODULE. THE (1) 18 GAUGE WIRES WILL RUN FROM THE VEHICLE LOOP TO THE VEHICLE DETECTOR THEN TO THE CENTER MODULE.
  - CONDUIT TO BE RUN ABOVE CEILING AND DOWN INSIDE WALL TO JUNCTION BOX.
  - MENU BOARD JUNCTION BOX TO BE INSTALLED HORIZONTAL.
  - CONDUIT TO BE RUN THROUGH COUNTER BASE CABINET AFTER COUNTER INSTALLATION.
  - RUN CABLING DOWN FROM CEILING AT BUMP BAR LOCATION(S).
  - MOUNT JUNCTION BOX ABOVE CEILING.
  - CONDUIT TO BE RUN BELOW SLAB AND UP THROUGH FLOOR TO JUNCTION BOX.

NEW BUILDING FOR:  
  
  
 INTERSECTION OF DAVENPORT & ALABAMA AVENUE  
 BREMEN, MN 55114  
 CELL ID: 252 0065  
 AMERICAN DAIRY QUEEN  
 MINNEAPOLIS, MN U.S.A.  
 \*REGISTERED U.S. PATENT OFFICE, AMERICAN DAIRY QUEEN CORPORATION. THIS DRAWING, ITS DESIGN DETAIL AND INVENTION ARE THE PROPERTY OF AMERICAN DAIRY QUEEN INC. (ADQ) AND SHALL NOT BE COPIED IN ANY MANNER NOR DISCLOSED TO ANY OUTSIDE PARTY WITHOUT ADD CONSENT.



GEORGIA ENGINEER LICENSE  
 NUMBER PE025568  
 SPECIAL NOTICES  
 In the event the client consents to, allows, authorizes or approves of changes to any plans, specifications or other construction documents, and these changes are not approved in writing by the design professional, the client recognizes that such changes and the results thereof are not the responsibility of the design professional. Therefore, the client agrees to release the design professional from any liability arising from the construction, use or result of such changes. In addition, the client agrees to the fullest extent permitted by law, to indemnify and hold the design professional harmless from any damage, liability or cost (including reasonable attorney's fees and costs of defense) arising from such changes. All rights reserved. No part of this drawing may be reproduced by photocopy or by any other means, or stored, processed, or transmitted in or by any computer or other systems without the prior written permission of the Engineer.

ISSUE DATE: 10-26-18  
 REVISION DATE:  
 10-26-18 ORIGINAL ISSUE

EPOS PLAN  
 SHEET NUMBER:  
**E5**

Order Plans @ [www.ldiline.com](http://www.ldiline.com)