

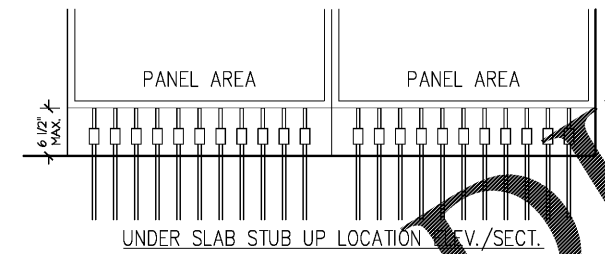
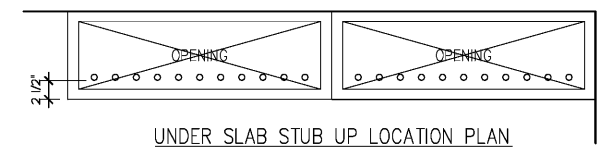


CAUTION - SERIES COMBINATION SYSTEM RATED 65,000 AMPERES. IDENTIFIED REPLACEMENT COMPONENTS REQUIRED.

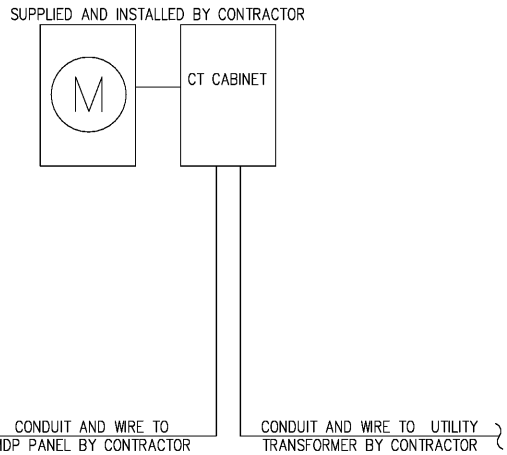

SSDi ENCLOSURE FRONT DOOR


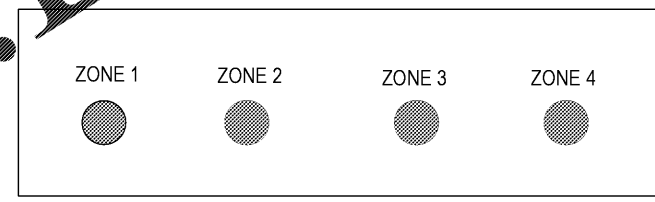


SIDE VIEW

FRONT VIEW

SECTION/PLAN VIEW

WWW.LDLine.com

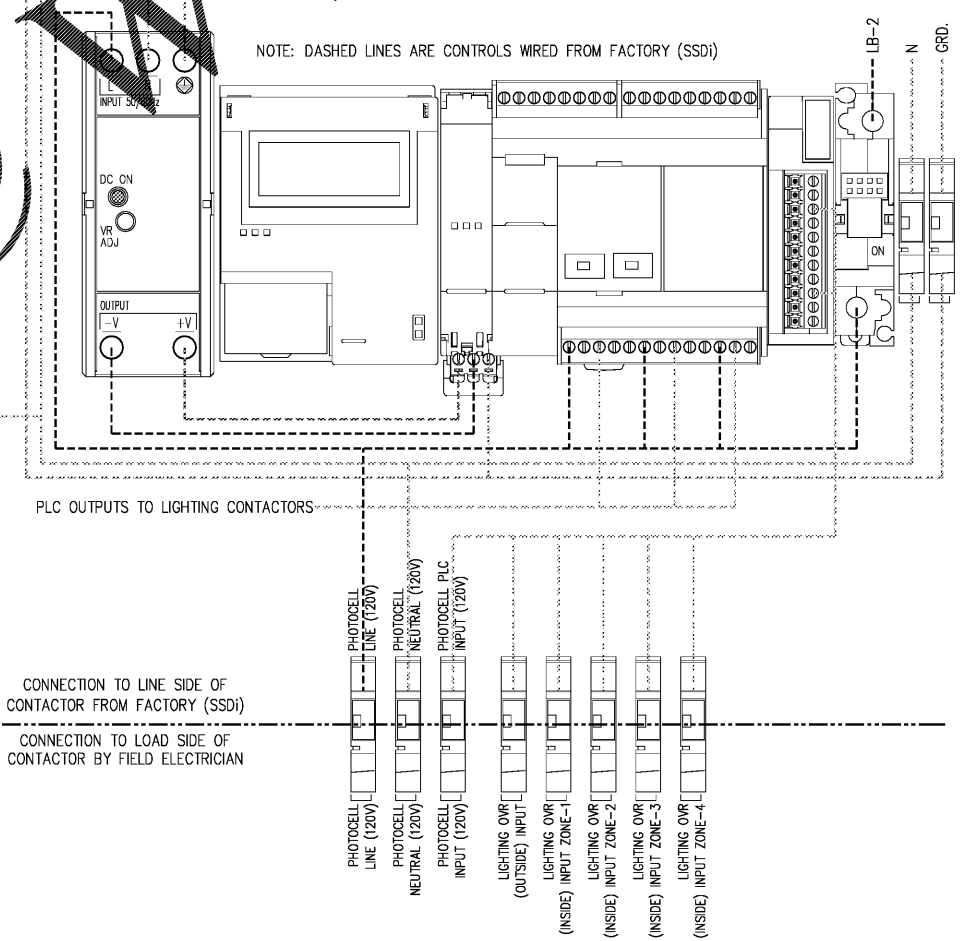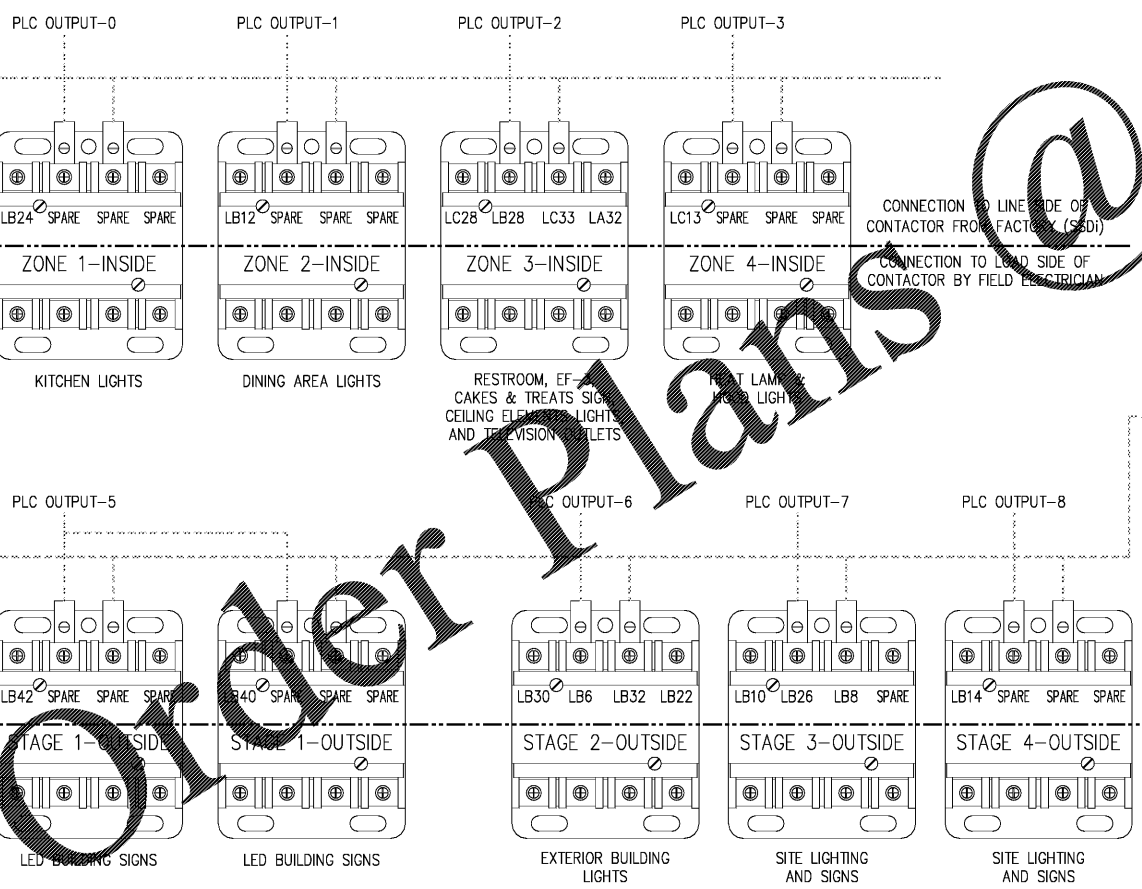

CONTRACTOR NOTE:  
EQUIPMENT CONDUCTORS  
TO BE SIZED ACCORDING TO  
THE PANEL SCHEDULE

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF SSDi. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF SSDi IS PROHIBITED.

**SSDi**  
Space Saver Distribution, Inc.  
P.O. Box 31380  
Las Vegas, Nevada 89173

UL LISTED

NEW BUILDING FOR:  
**DQ**  
**GRUBBERS**  
INTERSECTION OF DAYTON & ALABAMA AVENUE  
BREMEN, OHIO 43015  
CELL # 252 0065

AMERICAN DAIRY QUEEN  
MINNEAPOLIS, MN U.S.A.  
REGISTERED U.S. PATENT OFFICE, AMERICAN DAIRY QUEEN CORPORATION. THIS DRAWING, ITS DESIGN DETAIL AND INVENTION ARE THE PROPERTY OF AMERICAN DAIRY QUEEN INC. (ADQ) AND SHALL NOT BE COPIED IN ANY MANNER NOR DISCLOSED TO ANY OUTSIDE PARTY WITHOUT ADQ CONSENT.



GEORGIA ENGINEER LICENSE  
NUMBER PE025568

SPECIAL NOTICES  
In the event the client consents to, allows, authorizes or approves of changes to any plans, specifications or other construction documents, and these changes are not approved in writing by the design professional, the client recognizes that such changes and the results thereof are not the responsibility of the design professional. Therefore, the client agrees to release the design professional from any liability arising from the construction, use or result of such changes. In addition, the client agrees to the fullest extent permitted by law, to indemnify and hold the design professional harmless from any damage, liability or cost (including reasonable attorney's fees and costs of defense) arising from such changes. All rights reserved. No part of this drawing may be reproduced by photocopy or by any other means, or stored, processed, or transmitted in or by any computer or other systems without the prior written permission of the Engineer.

ISSUE DATE:	10-26-18
REVISION DATE:	10-26-18
	ORIGINAL ISSUE

CABINET LAYOUT  
& LIGHTING  
CONTROL

SHEET NUMBER:  
**E6**