

PLAN VIEW - Hood #1
11' 2.00" LONG 5430ND-2-ACPSP-F


ACPSP ships loose for field installation

1" LAYER OF INSULATION
FACTORY INSTALLED IN
1.00" END STANDOFF MEETS
0" REQUIREMENTS CLEARANCE
TO COMBUSTIBLE SURFACES.

INSTALLER MUST CONFIRM HOOD IS INSTALLED SUCH
THAT THE SPECIFIED WALL, ACTING AS AN END PANEL,
IS MATED TIGHT TO THE CORRECT END OF HOOD TO
ACHIEVE A REDUCED MINIMUM EXHAUST CFM LISTING.
NON-COMPLIANCE WILL NULLIFY THE ETL LISTING,
HOOD THE MANUFACTURER'S WARRANTY, AND HOLD THE
CONTRACTOR LIABLE FOR ANY AND ALL LOSSES, COSTS,
AND EXPENSES RELATED TO THE NON-COMPLIANCE OF
THE MANUFACTURER'S SPECIFIED INSTRUCTION. THE
WALL ACTING AS AN END PANEL MUST EXTEND NO LESS
THAN 20" FROM THE INTERSECTING WALL ON WHICH HOOD
IS MOUNTED AND MUST EXTEND NO LESS THAN 20" UNDER
BOTTOM OF HOOD TO BE ELIGIBLE FOR REDUCED
MINIMUM EXHAUST CFM LISTING.

LIGHTING FOR ACPSP Job # 3590126 - Hood #1
INPUT: 120V AC, 1 Phase, 50/60Hz, 3.5 Watts per light.
TO CONTROL LIGHTS WITH HOOD LIGHT SWITCH, WIRE PER
HOOD ELECTRICAL CONTROL PANEL SCHEMATIC.
TO CONTROL LIGHTS WITH BUILDING LIGHT SWITCH, WIRE
BLACK AND WHITE WIRE TO A 120VAC SERVICE.
END TO END ACPSPS REQUIRE 120VAC FIELD WIRING FROM
J-BOX TO J-BOX. REPLACE LIGHTS WITH LED LIGHTS ONLY.

IT IS THE RESPONSIBILITY
OF THE ARCHITECT/OWNER TO
ENSURE THAT THE HOOD IS
FROM LIMITED-COMBUSTIBLE
AND COMBUSTIBLE MATERIALS
IS IN COMPLIANCE WITH
LOCAL CODE REQUIREMENTS.

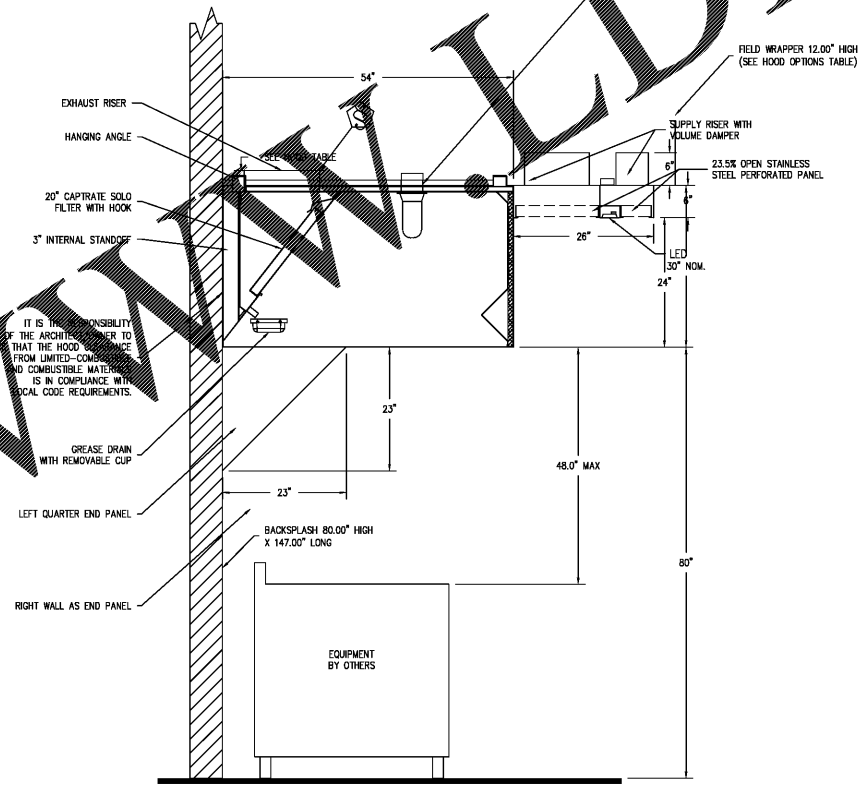

SECTION VIEW - MODEL 5430ND-2-ACPSP-F
HOOD - #1

REVISIONS	
DESCRIPTION	DATE

CAPTIVE
www.captiveaire.com
Iowa Office
2041 Grand Ave, Suite B, West Des Moines, IA 50266 PHONE: (515) 221-1188 FAX: (515) 227-6955 EMAIL: reg71@captiveaire.com

DQ - Bremen, GA
Davis Blvd & Alabama Ave,
BREMEN, GA, 30110

DATE: 10/22/2018
DWG.#: 3590126
DRAWN BY: jsievers
SCALE: 3/4" = 1'-0"
MASTER DRAWING

SHEET NO.
2

NEW BUILDING FOR:

INTERSECTION OF DAVIS BLVD & ALABAMA AVENUE
BREMEN, GA 30110
CELL ID: 252 0065

AMERICAN DAIRY QUEEN
MINNEAPOLIS, MN U.S.A.
REGISTERED U.S. PATENT OFFICE, AMERICAN DAIRY
QUEEN CORPORATION. THIS DRAWING, ITS DESIGN
DETAIL AND INVENTION ARE THE PROPERTY OF
AMERICAN DAIRY QUEEN INC. (ADQ) AND SHALL NOT BE
COPIED IN ANY MANNER NOR DISCLOSED TO ANY
OUTSIDE PARTY WITHOUT ADD CONSENT.



GEORGIA ENGINEER LICENSE
NUMBER PE025568

SPECIAL NOTICES
In the event the client consents to, allows, authorizes or
approves of changes to any plans, specifications or other
construction documents, and these changes are not approved
in writing by the design professional, the client recognizes that
such changes and the results thereof are not the responsibility
of the design professional. Therefore, the client agrees to
release the design professional from any liability arising from
the construction, use or result of such changes. In addition,
the client agrees to the fullest extent permitted by law, to
indemnify and hold the design professional harmless from any
damage, liability or cost (including reasonable attorney's fees
and costs of defense) arising from such changes. All rights
reserved. No part of this drawing may be reproduced by
photocopy or by any other means, or stored, processed, or
transmitted in or by any computer or other systems without the
prior written permission of the Engineer.

CAPTIVEAIRE
HOOD SHOP
DRAWINGS

SHEET NUMBER:
M4.2

Order Plans @