


NOTES

1. REFER TO DETAIL C3/E-501, B3/E-501 FOR WIRING.

D3 RTU Service Light Mounting Detail

SCALE: N.T.S.

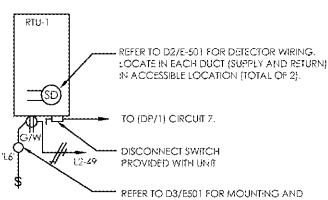


NOTES

1. COORDINATE LOCATION OF DISCONNECT WITH MECHANICAL CONTRACTOR. ROUTE CONDUIT THRU ROOF. SEAL ROOF PENETRATION WATER-TIGHT USING METHOD APPROVED BY ROOFING MANUFACTURER. DO NOT PENETRATE DRAIN PAN WITH CONDUITS.
2. REFER TO SHEET E-201 FOR LOCATION.

C3 RTU-1 Detail

SCALE: N.T.S.

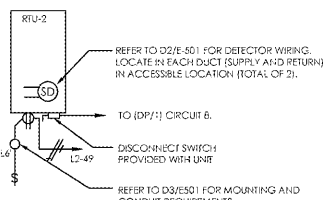


NOTES

1. COORDINATE LOCATION OF DISCONNECT WITH MECHANICAL CONTRACTOR. ROUTE CONDUIT THRU ROOF. SEAL ROOF PENETRATION WATER-TIGHT USING METHOD APPROVED BY ROOFING MANUFACTURER. DO NOT PENETRATE DRAIN PAN WITH CONDUITS.
2. REFER TO SHEET E-201 FOR LOCATION.

B3 RTU-2 Detail

SCALE: N.T.S.

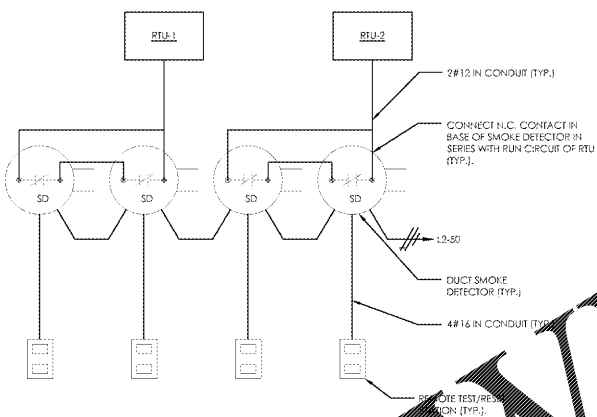


NOTES

1. REFER TO DETAIL B3/E-501 AND C3/E-501 FOR LOCATION OF SMOKE DETECTORS.
2. REFER TO DETAIL B1/E-401 FOR LOCATION OF REMOTE TEST STATIONS.
3. SMOKE DETECTORS FURNISHED AND INSTALLED BY M.C. ALL WIRING BY E.C.


D2 Duct Smoke Detector Wiring Detail

SCALE:

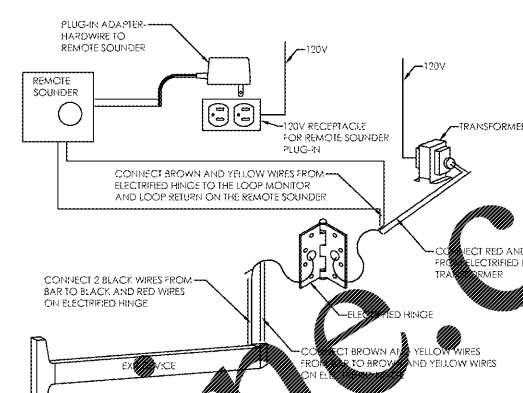


B4 Exit Device/Remote Sounder Detail

SCALE:

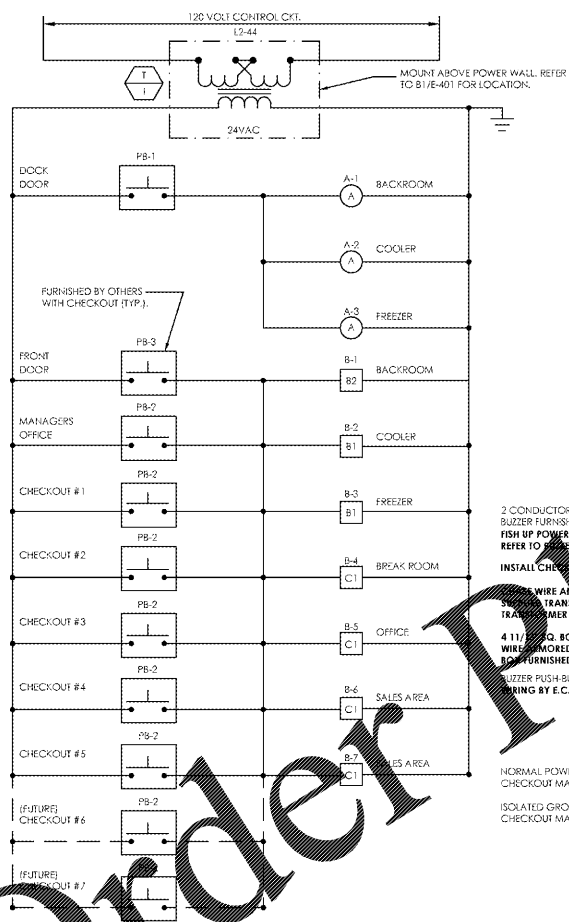

D1 Bell and Buzzer Wiring Diagram

SCALE: N.T.S.

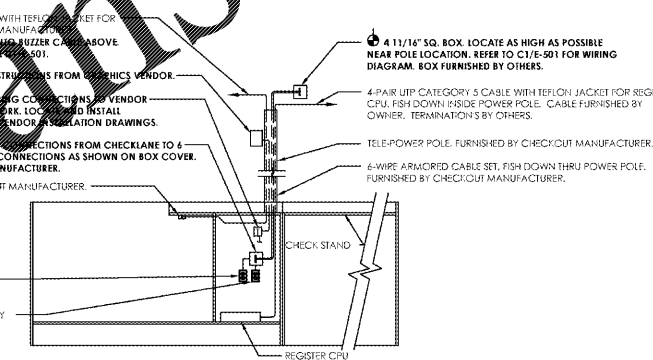


NOTES

1. **BOLD PRINT** TEXT IN DETAIL INDICATES WORK BY THE ELECTRICAL CONTRACTOR. **LIGHT PRINT** TEXT IN DETAIL INDICATES WORK BY OTHERS.
2. **ALL CONDUITS TO CHECKOUTS SHALL BE RUN AS HIGH AS POSSIBLE. COMBINE POWER CIRCUITS IN COMMON CONDUIT. PROVIDE DEDICATED 2" CONDUIT AND JUNCTION BOX ABOVE ALL CHECKOUTS FOR LOW VOLTAGE WIRING. COORDINATE FINAL CONDUIT ROUTING AND CONCEALMENT WITH ALDI REP FOR APPROVAL PRIOR TO ROUGH IN.**


C1 Checkout Wiring Detail

SCALE: N.T.S.

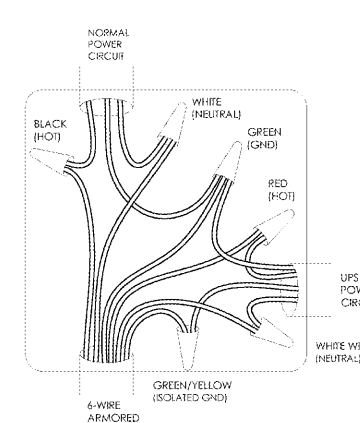

B1 Checkout Wiring Diagram

SCALE: N.T.S.

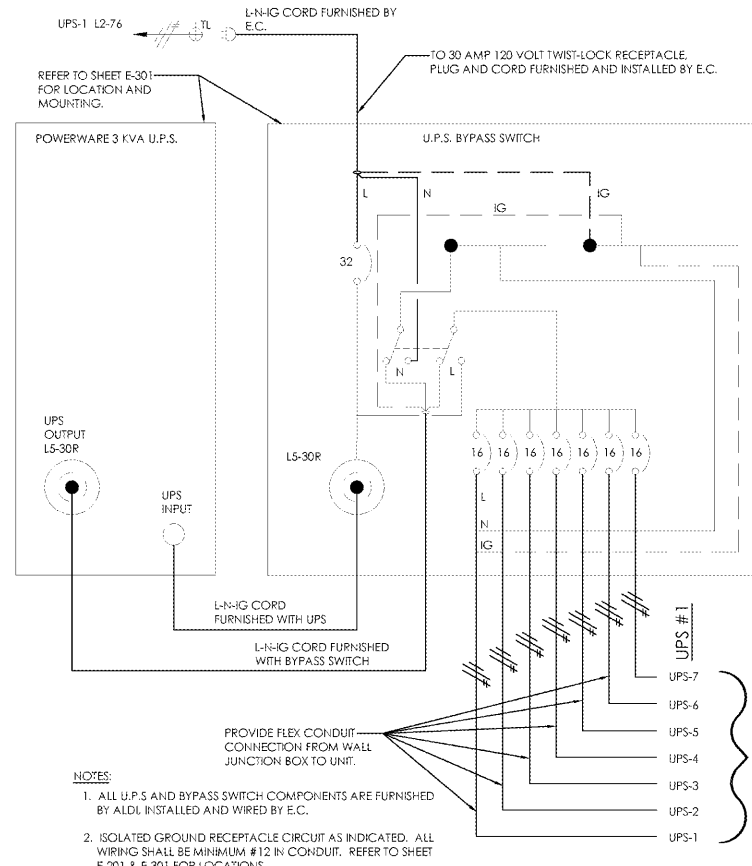

NOTES


1. ALL U.P.S. AND BYPASS SWITCH COMPONENTS ARE FURNISHED BY ALDI. INSTALLED AND WIRED BY E.C.
2. ISOLATED GROUND RECEPTACLE CIRCUIT AS INDICATED. ALL WIRING SHALL BE MINIMUM #12 IN CONDUIT. REFER TO SHEET E-201 & E-301 FOR LOCATIONS.
3. ALL UPS POWERED RECEPTACLES SHALL BE LABELED ON DEVICE FACEPLATE "UPS-#" WHERE # = CIRCUIT NUMBER.

A1 UPS Wiring Diagram

SCALE: N.T.S.



310 MILLS AVE. GREENVILLE, SC 29605
864.242.9881
 plans@narramore.net
 © 2018 NARRAMORE ASSOCIATES, INC.
 COPYRIGHT PROTECTED BY FEDERAL LAW



1587 DRY POND RD.
 JEFFERSON, GA 30549
 706.387.7722
 FAX: 706.387.7701

ALDI FOOD STORE # 61
 2589 Spring Road
 Smyrna, GA 30080

REVISIONS

PROJECT DATA
 V1.07 100x155 LW Expansion
PROJECT NUMBER
 18412
ISSUE DATE
 10-25-18

ALDI FOOD STORE #61
 Smyrna, GA

DEVITA
 ATLANTA • CHARLOTTE • GREENVILLE • RICHMOND
 877.4.DEVITA • corp@devitainc.com
 Devita & Associates, Inc. Project: 18102-35
 Drawn By: SMD Checked By: RAG

E-501

ELECTRICAL
 DETAILS