Order Plans @ WWW.LDLine.com

KEYNOTES

16.125 EXISTING LIGHT FIXTURES TO REMAIN UNLESS NOTED OTHERWISE.

16.126 EXISTING LIGHT FIXTURE TO BE DEMOLISHED.

16.129 CONNECT TO EXISTING CIRCUIT PREVIOUSLY SERVING AREA LIGHTING THAT WAS REMOVED. MAINTAIN EXISTING CIRCUIT CONTROL UNLESS NOTED OTHERWISE. PROVIDE CONSTANT HOT FOR EMERGENCY EXIT AND LOCALLY CONTROLLED LIGHT FIXTURES.

CONTRACTOR IS RESPONSIBLE FOR THE COMPLETE INSTALLATION OF THE LIGHTING SYSTEM AS INDICATED ON PLANS AND/OR AS MODIFIED TO ACCOMMODATE EXISTING OBSTRUCTIONS. IDENTIFY CONFLICTS PRIOR TO ROUGH-IN. WHERE CONFLICTS WITH EXISTING UTILITIES OCCUR ADJUST FIXTURE LOCATION AS REQUIRED. FIXTURES SHALL BE INSTALLED AS NEAR AS POSSIBLE TO LOCATIONS INDICATED ON PLANS WITH EVEN SPACING MAINTAINED.

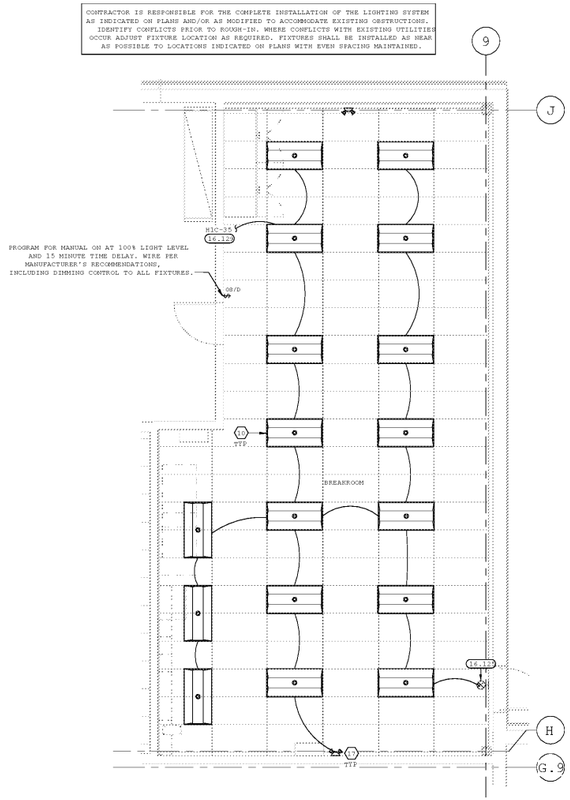

6 BREAKROOM LIGHTING PLAN
1/4" = 1'-0"

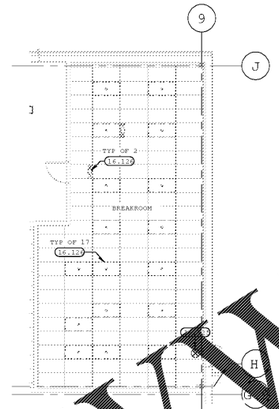

5 BREAKROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

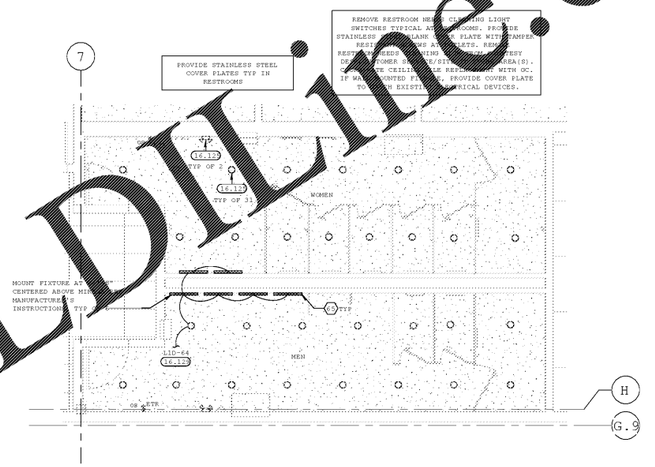

4 REAR RESTROOM LIGHTING PLAN
1/4" = 1'-0"

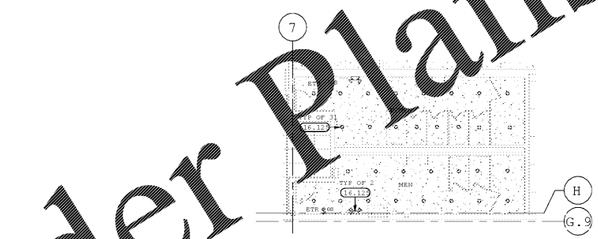

3 REAR RESTROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

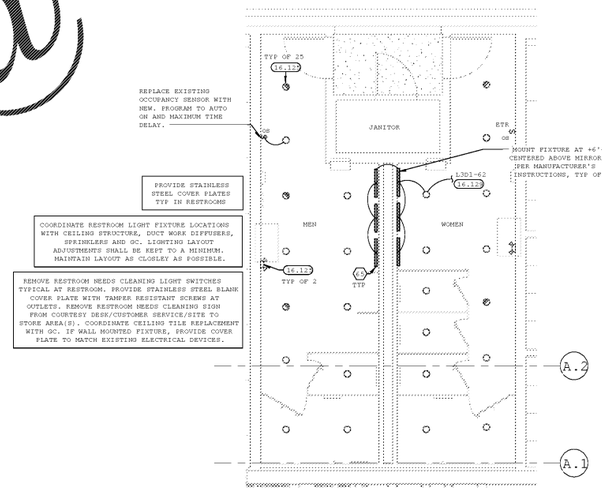

2 FRONT RESTROOM LIGHTING PLAN
1/4" = 1'-0"

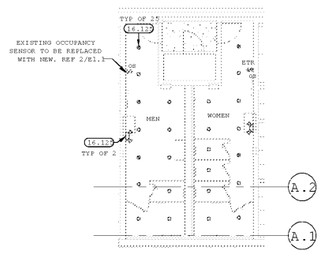

1 FRONT RESTROOM LIGHTING DEMO PLAN
1/8" = 1'-0"

3521 Prospect Ave
Orlando, FL 32814
(407) 894-5091
(407) 894-5097
www.ldline.com

CONSULTANTS

Walmart
JESUP, GA
STORE NO: 2630
2180278 | PROTO1 139
JOB NUMBERS:

ISSUE BLOCK

CHECKED BY:	JPM
DRAWN BY:	MD
PROTO CYCLE:	07/27/18
DOCUMENT DATE:	10/05/18

NOT FOR CONSTRUCTION

ENLARGED LIGHTING PLAN

SHEET: E1.1

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARISE WORKERS WITH THIS KNOWLEDGE.

20180278 SITE#2630 #1
C:\Users\mdavis\Desktop\...\20180278_2630_Jesup_GA_E1.1.dwg 10/5/2018 8:51:39 AM mdavis