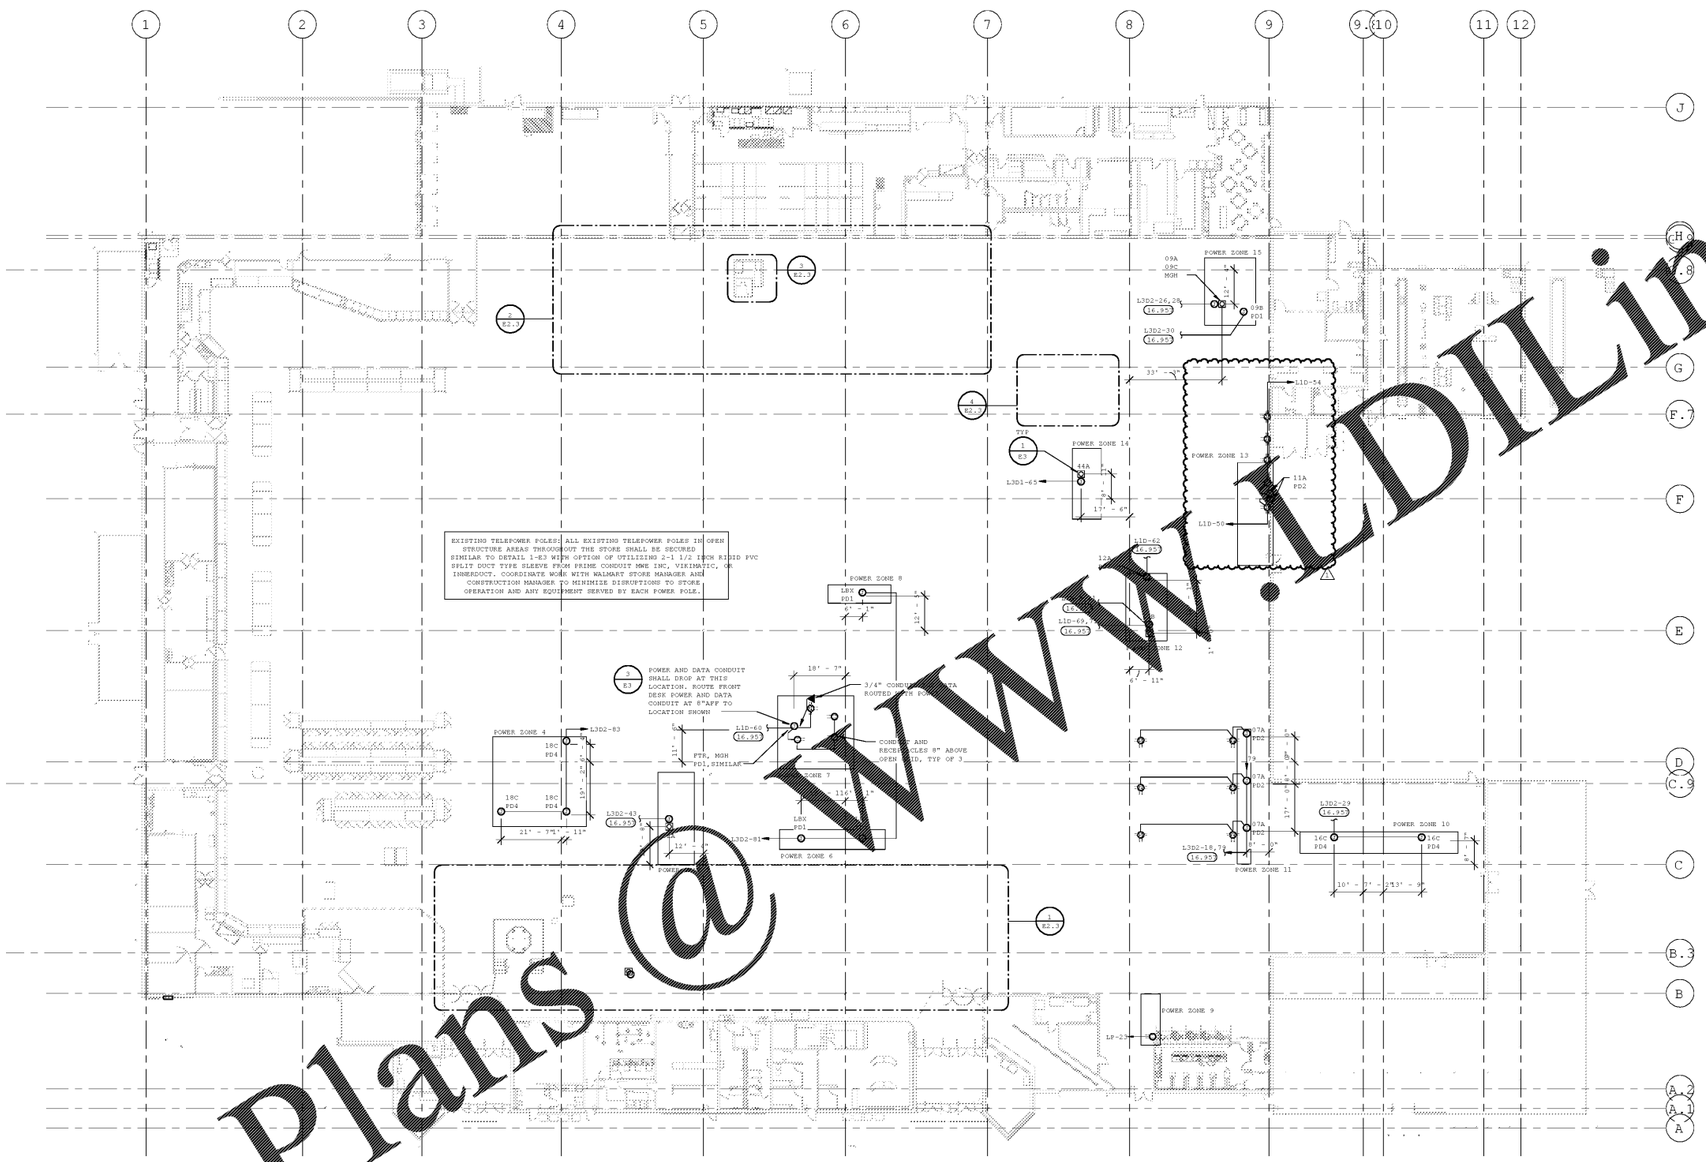

1 POWER DROP PLAN
1" = 20'-0"

POWER DROP SCHEDULE

07.26.17

NO.	DESCRIPTION
PD1	MOUNT RECEPTACLE(S) ON TOP OF DISPLAY UNIT (S)
PD2	MOUNT RECEPTACLE(S) 6" ABOVE BASE OF DISPLAY ON UNIT(S) SO THAT RECEPTACLE(S) AND CONDUIT DO NOT INTERFERE WITH SHELF HEIGHT ADJUSTMENTS
PD3	PROVIDE DIRECT CONNECTION TO EQUIPMENT
PD4	OPEN STRUCTURE: MOUNT RECEPTACLE AT BAR JOIST AND INSTALL FURNISHED CORD REEL. LAY-IN CEILING: PROVIDE RECESSED CEILING RECEPTACLE AND INSTALL FURNISHED CORD REEL BELOW CEILING. CORD REEL [illegible] TO CEILING FAN RATED JUNCTION BOX [illegible] TO LAY-IN CEILING WITH STEEL BOX HANGER. PROVIDE 1/4" THREADED STEEL ROD FROM JUNCTION BOX [illegible] OR CHANNEL [illegible] FOR SUPPORT.

POWER DROP NOTES

07.27.17

1. POWER DROPS WILL BE IDENTIFIED BY AN IPTV TAG OR POWER TAG, I.E. 44A, 46E, ETC. ALL CHECKOUT POWER SHOULD BE CONSIDERED POWER DROPS.
2. PROVIDE POWER ON THIS PLAN BASED ON THE FINAL MERCHANDISE LAYOUT MAY BE ISSUED TO SHOW FINAL LOCATIONS FOR THE POWER DROPS. IF THE MERCHANDISE PLAN DOES NOT CHANGE, THIS PLAN WILL NOT BE REISSUED. PROVIDE CIRCUITRY TO DISPLAY RACKS AS THE RACKS ARE SET. IN ADDITION, THE FOLLOWING POWER DROP NOTES APPLY:
   A. THERE WILL BE NO ADDITIONAL CHARGE FOR DROP RELOCATION WITHIN POWER DROP ZONES DEFINED ON DRAWING.
   B. AT CLOSE OF PROJECT THE GENERAL CONTRACTOR AND CONSTRUCTION MANAGER SHALL REVIEW ADDITIONAL OR DELETED POWER DROPS WITHIN EACH ZONE TO VERIFY ANY ADDITIONAL CHARGES OR CREDITS THAT APPLY DUE TO CHANGES.
   C. ADDING OR SUBTRACTING A POWER DROP TO ANY ZONE WILL RESULT IN A CHARGE OR CREDIT ACCORDING TO SPECIAL CONDITIONS.
3. PROVIDE JUNCTION BOX AND CIRCUITRY TO NEAREST JOIST ABOVE LOCATION SHOWN ON DRAWINGS. EXTEND CONDUIT AND CIRCUITRY FROM JUNCTION BOX TO ENDCAP OF DISPLAY RACK (AWAY FROM ACTION ALLEY).
4. PROVIDE CONDUIT, RECEPTACLE(S) AND FINAL CONNECTIONS AT DISPLAY RACK SHELVING PER POWER DROP SCHEDULE UNLESS NOTED OTHERWISE ON DRAWING. VERIFY EXACT HEIGHT AND LOCATION OF RECEPTACLE(S) WITH STORE PLANNING SET-UP SUPERVISOR PRIOR TO INSTALLATION.
5. POWER DROPS FED FROM TRACK BUSWAY: INSTALL PLUG-IN UNIT AT A POINT ON TRACK BUSWAY NEAREST POWER DROP(S).

KEYNOTES

16.957 CONNECT CIRCUIT(S) TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE NOTED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO USE TO ENSURE THAT THEY MEET REQUIRED SIZE, AND ALL U.L. RATINGS AND REPLACE AS REQUIRED.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUB-CONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

1953 Prospect Ave
Colorado, CO 80904
719-473-9000
719-473-9001
www.jpcolo.com
JOHN PEARCE & CO., INC.
ARCHITECTS

CERTIFICATION FOR BID SET

THIS SHEETSET HAS REVIEWED AND APPROVED BY THE ARCHITECT OF RECORD AS TO ITS COMPLIANCE WITH THE DESIGN INTENT OF THE CONTRACT DOCUMENTS. WITH ITS ISSUANCE, THE ARCHITECT OF RECORD ASSUMES NO LIABILITY FOR ANY ERRORS, OMISSIONS OR THE INTERPRETATION OF THE CONTRACT DOCUMENTS. THE PROJECT MANAGER HAS SPECIFIED THE ENGINEERS, ARCHITECTS OR THE ENGINEERING FIRMS WHO ARE RESPONSIBLE FOR THE DESIGN OF THE SYSTEMS. ANY SUBMITTAL REVIEWED BY THE ARCHITECT OF RECORD THAT DEVIATES FROM THE DESIGN INTENT OF THE CONTRACT DOCUMENTS MAY BE CONTRARY TO THE LAW.

CONSULTANTS

Walmart
JESUP, GA
STORE NO: 2630
JOB NUMBER: 21E2630 | PROTO: 133

ISSUE BLOCK		
1	PR#1	10/26/18

CHECKED BY:	JPM
DRAWN BY:	MD
PROTO CYCLE:	07/27/18
DOCUMENT DATE:	10/26/18

NOT FOR CONSTRUCTION

POWER DROP PLAN

SHEET: E2.1

Order Plans @ www.LDLine.com