KEYNOTES

16.410 COUNTER MOUNTED DEVICES: STUB OUT OF WALL AT +8". ROUTE FLEXIBLE METAL CONDUITS ALONG BACK WALL OF CABINET. MOUNT DEVICES WITHIN CABINET AT +8". EACH DATA BOX IS TO HAVE A SEPARATE CONDUIT ROUTED TO 12" ABOVE ACCESSIBLE CEILING SPACE. VERIFY ALL DEVICE LOCATIONS WITH STORE PLANNING SETUP SUPERVISOR PRIOR TO ROUGH-IN.

16.410B COUNTER MOUNTED DEVICES: ROUTE BRANCH CIRCUITRY THROUGH OWNER FURNISHED BLAKE POWER POLE. ROUTE FLEXIBLE METAL CONDUITS ALONG INSIDE BACK WALL OF CABINET.

16.471 FURNISH AND INSTALL NEW 20 AMP, 120 VOLT ISOLATED GROUND CIRCUIT IN EXISTING PANELBOARD PANEL BOARD AS INDICATED ON PLANS. PROVIDE 20A-1P CIRCUIT BREAKER IF NEEDED. E.C. SHALL VERIFY AND MATCH MANUFACTURER, SERIES AND AIC RATING OF EXISTING CIRCUIT BREAKERS. PROVIDE ISOLATED GROUND ORANGE COLORED RECEPTACLES. ISOLATED GROUND CIRCUITS WITH CIRCUIT NUMBER AND PANEL ENGRAVED ON FACE OF DEVICE. E.C. SHALL VERIFY PRIOR TO INSTALLATION THAT THE EXISTING PANELBOARD HAS SUFFICIENT CAPACITY TO ACCOMMODATE ADDITIONAL LOAD.

16.489 RELOCATE, EXTEND, AND RECONNECT CIRCUITRY AND ELECTRICAL DEVICES FOR RELOCATED EQUIPMENT. EQUIPMENT. VERIFY CONDITION OF CIRCUITRY, CONDUIT AND WIRE TO ENSURE THEY MEET ALL U.L. RATINGS AND REPLACE AS REQUIRED. VERIFY FINAL LOCATION OF RELOCATED/NEW EQUIPMENT WITH WALMART CONSTRUCTION MANAGER PRIOR TO ROUGH-IN.

INSECT CONTROL: PROVIDE BROWN DEVICE AND MATCHING COVERPLATE.

16.775 E.C. SHALL DISCONNECT, EXTEND, AND RECONNECT ALL ELECTRICAL CIRCUITRY. LABEL ALL ASSOCIATED PANELBOARD SCHEDULES TO REFLECT LOAD DESCRIPTIONS. VERIFY CONDITION OF BRANCH CIRCUIT, CONDUIT, AND WIRE PRIOR TO USE TO ENSURE THAT THEY MEET ALL U.L. RATINGS AND REPLACE AS REQUIRED. COORDINATE THIS PROCESS WITH CONSTRUCTION MANAGER TO MINIMIZE DOWNTIME.

16.957 CONNECT CIRCUIT(S) TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE NOTED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO USE TO ENSURE THAT THEY MEET REQUIRED SIZE, AND ALL U.L. RATINGS AND REPLACE AS REQUIRED.

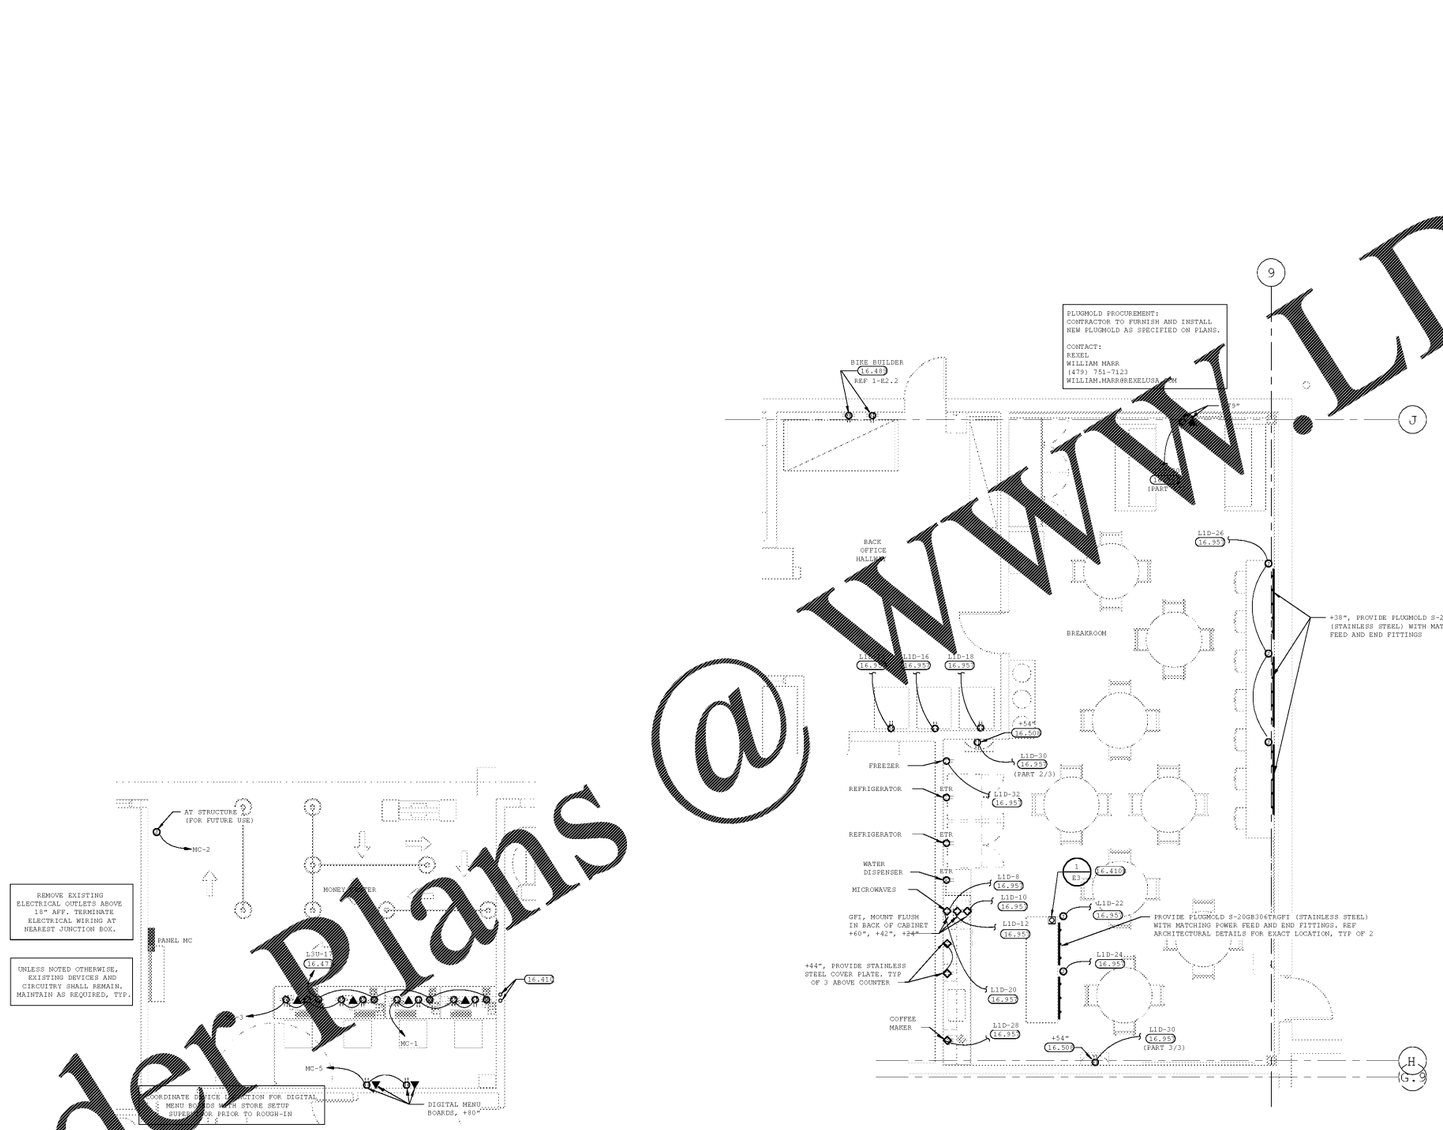

2 BREAKROOM POWER PLAN
1/4" = 1'-0"

3 MONEY CENTER POWER PLAN
1/4" = 1'-0"

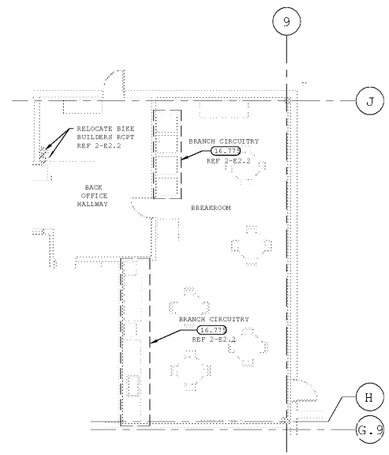

1 BREAKROOM POWER DEMO PLAN
1/8" = 1'-0"

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

1921 Prospect Ave.
Orlando, FL 32814
(407) 896-1500
FAX (407) 661-9656
www.ldi.com

STIPULATION FOR USE OF DRAWINGS
THESE DRAWINGS ARE PREPARED FOR THE USE OF THE OWNER AND HIS CONSTRUCTION REPRESENTATIVES IN CONNECTION WITH ITS SPECIFIC PROJECT AND ARE NOT TO BE USED FOR ANY OTHER PURPOSE OR PROJECT. ANY REUSE WITHOUT WRITTEN VERIFICATION OR ADAPTATION BY LDI, INC. FOR THE SPECIFIC PURPOSE INTENDED WILL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO LDI, INC. AND USER SHALL INDEMNIFY AND HOLD HARMLESS LDI, INC. AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY MODIFICATION OF THESE DRAWINGS MUST BE APPROVED IN WRITING BY LDI, INC. AND ANY UNAUTHORIZED MODIFICATION SHALL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO LDI, INC. AND USER SHALL INDEMNIFY AND HOLD HARMLESS LDI, INC. AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY MODIFICATION OF THESE DRAWINGS MUST BE APPROVED IN WRITING BY LDI, INC. AND ANY UNAUTHORIZED MODIFICATION SHALL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO LDI, INC. AND USER SHALL INDEMNIFY AND HOLD HARMLESS LDI, INC. AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY MODIFICATION OF THESE DRAWINGS MUST BE APPROVED IN WRITING BY LDI, INC. AND ANY UNAUTHORIZED MODIFICATION SHALL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO LDI, INC. AND USER SHALL INDEMNIFY AND HOLD HARMLESS LDI, INC. AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY MODIFICATION OF THESE DRAWINGS MUST BE APPROVED IN WRITING BY LDI, INC. AND ANY UNAUTHORIZED MODIFICATION SHALL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO LDI, INC. AND USER SHALL INDEMNIFY AND HOLD HARMLESS LDI, INC. AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY MODIFICATION OF THESE DRAWINGS MUST BE APPROVED IN WRITING BY LDI, INC. AND ANY UNAUTHORIZED MODIFICATION SHALL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO LDI, INC. AND USER SHALL INDEMNIFY AND HOLD HARMLESS LDI, INC. AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM. ANY MODIFICATION OF THESE DRAWINGS MUST BE APPROVED IN WRITING BY LDI, INC. AND ANY UNAUTHORIZED MODIFICATION SHALL BE AT USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO LDI, INC. AND USER SHALL INDEMNIFY AND HOLD HARMLESS LDI, INC. AGAINST ALL CLAIMS, DAMAGES, LOSSES AND EXPENSES ARISING OUT OF OR RESULTING THEREFROM.

CONSULTANTS

Walmart
JESUP, GA
STORE NO: 2630
JOB NUMBER: 21802378 | PROTO: 139

ISSUE BLOCK

CHECKED BY:	JPM
DRAWN BY:	MD
PROTO CYCLE:	07/27/18
DOCUMENT DATE:	10/05/18

NOT FOR CONSTRUCTION

ENLARGED POWER PLANS

SHEET: E2.2

Order Plans @ WWW.LDILine.com