GENERAL AUTO CENTER NOTES

1. SERVICE PIT: UNCLASSIFIED LOCATION PER NEC CHAPTER 5, CLASS 1 LIQUIDS ARE NOT TRANSFERRED, AND EXHAUST VENTILATION IS IN EXCESS OF 1 CFM PER SQUARE FOOT OF FLOOR AREA TAKEN FROM A POINT WITHIN 12" OF THE FLOOR.

KEYNOTES

16.149 REPLACE EXISTING LIGHT SWITCH WITH OCCUPANCY SENSOR.

16.957 CONNECT CIRCUIT(S) TO EXISTING BRANCH CIRCUITRY. MINIMUM WIRE SIZE AND PANELBOARD CIRCUIT ARE INDICATED. VERIFY SIZE, RATING AND CONDITION OF EXISTING BRANCH CIRCUIT CONDUIT AND WIRE PRIOR TO BIDDING TO ENSURE THAT THEY MEET REQUIRED SIZE AND ALL U.L. RATINGS AND CONDITIONS AS REQUIRED.

16.W13 WATER HEATER SHALL BE DIRECT EXISTING RECOVERY WATER HEATER. COORDINATE WITH MECHANICAL CONTRACTOR. B. FURNISH AND INSTALL NEW LOCK OFF ALL CIRCUIT BALANCING VALVES ON WATER HEATERS.

CONTRACTOR TO VERIFY THAT ALL LIGHT FIXTURES AND POWER DEVICES IN PIT AREA IN PROPER WORKING ORDER. REPAIR/REPLACE BROKEN OR DAMAGED LIGHT FIXTURES AND POWER DEVICES AS REQUIRED. NEW LIGHT FIXTURES ARE TO BE TYPE 6C FIXTURES AND ARE TO MATCH THE EXISTING FIXTURE HEIGHTS. COORDINATE ALL WORK WITH WALMART CONSTRUCTION MANAGER.

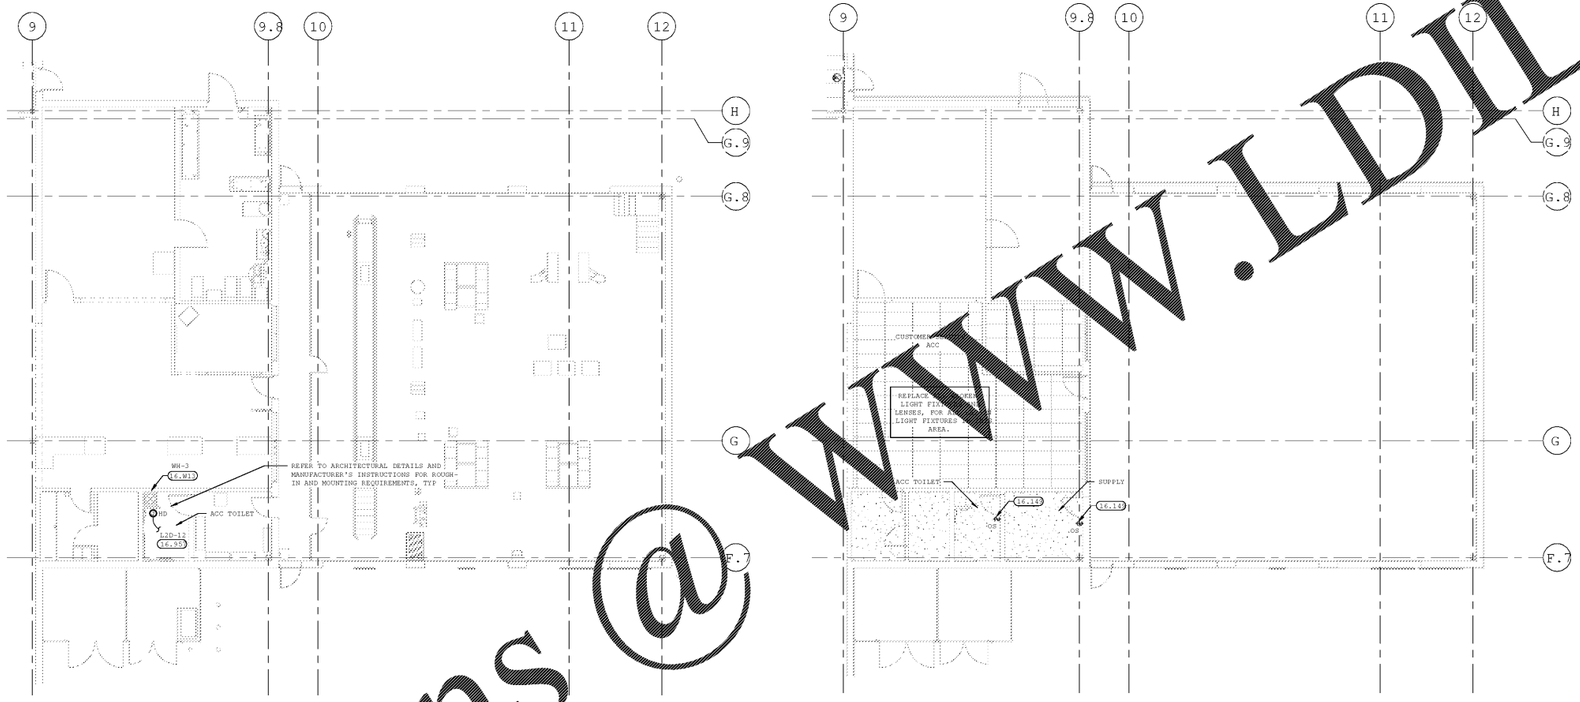

1 ACC LIGHTING PLAN
1/8" = 1'-0"

2 ACC POWER PLAN
1/8" = 1'-0"

Order Plans @ WWW.LDILine.com

1951 Prospect Ave.
Orlando, FL 32814
(407) 896-1500
FAX (407) 661-9656
www.gfa.com
Gabriel Fernandez Architect, P.A.

STIPULATION FOR USE OF DRAWINGS

THESE DRAWINGS ARE PREPARED FOR THE USE OF THE CONSTRUCTION INDUSTRY FOR THE PURPOSE OF CONSTRUCTING A SITE AS SHOWN HEREIN. ANY OTHER USE OF THESE DRAWINGS IS PROHIBITED WITHOUT THE EXPRESS WRITTEN CONSENT OF GABRIEL FERNANDEZ ARCHITECT, P.A. THE CONTRACTOR FOR THIS PROJECT ASSUMES THE RESPONSIBILITY OF CONSTRUCTING THIS PROJECT IN ACCORDANCE WITH THESE DRAWINGS. ANY DEVIATION FROM THESE DRAWINGS SHALL BE REPORTED TO THE ARCHITECT AND SHALL NOT BE CONSTRUCTED UNTIL APPROVED BY THE ARCHITECT. ANY CONSTRUCTION PERFORMED THAT IS CONTRARY TO THE ABOVE SHALL BE DONE AT THE CONTRACTOR'S RISK.

CONSULTANTS

Walmart
JESUP, GA
STORE NO: 2630
FOR NUMBERS: 2180278 | PROTO: 139

ISSUE BLOCK

CHECKED BY:	JPM
DRAWN BY:	MD
PROTO CYCLE:	07/27/18
DOCUMENT DATE:	10/05/18

NOT FOR CONSTRUCTION

ACC ELECTRICAL PLANS

SHEET: E5

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CONTRACTOR SHALL CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

EACH SUBCONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF ALL DRAWINGS AND SPECIFICATIONS IN THEIR RELATED FIELD. THE FAILURE TO ACQUAINT THEMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE THE RESPONSIBILITY OF PERFORMING THE WORK PROPERLY. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED BECAUSE OF CONDITIONS THAT OCCUR DUE TO FAILURE TO FAMILIARIZE WORKERS WITH THIS KNOWLEDGE.

10/05/2018 8:08:19 PM