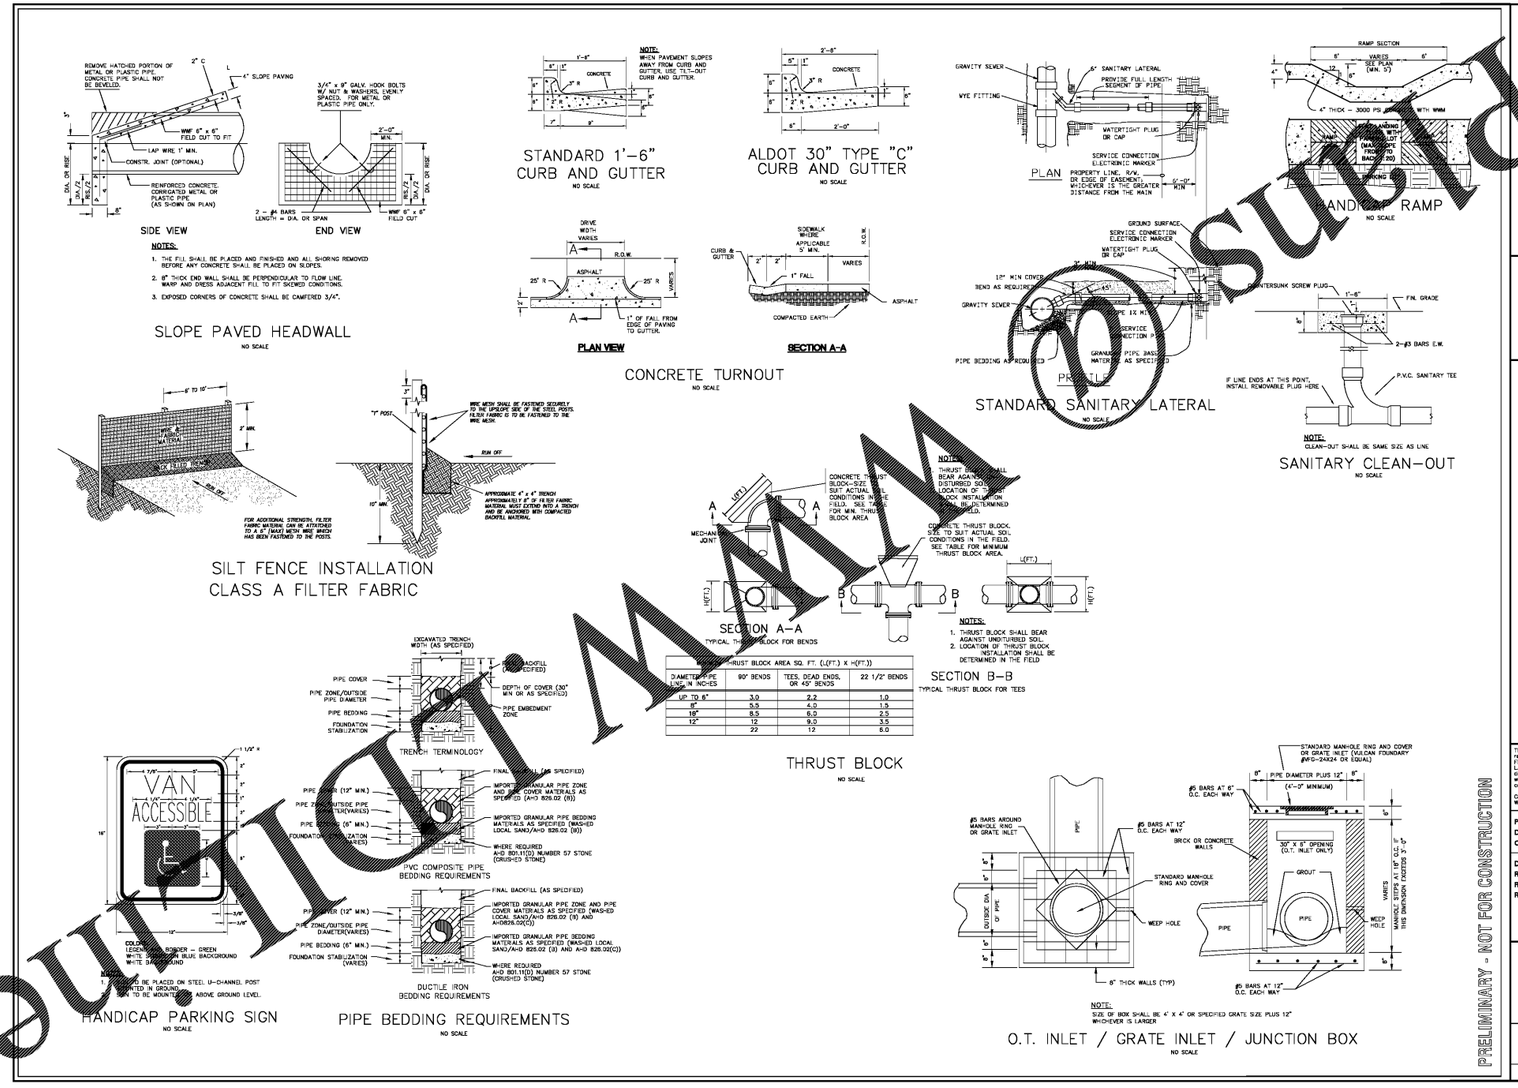

NOTES:

1. THE FILL SHALL BE PLACED AND FINISHED AND ALL SHORING REMOVED BEFORE ANY CONCRETE SHALL BE PLACED ON SLOPES.
2. 8" THICK END WALL SHALL BE PERPENDICULAR TO FLOW LINE. MARK AND DRESS ADJACENT FILL TO FIT SKEWED CONDITIONS.
3. EXPOSED CORNERS OF CONCRETE SHALL BE CHAMFERED 3/4".

NOTE: WHEN PAVEMENT SLOPES AWAY FROM CURB AND GUTTER, USE TILT-OUT CURB AND GUTTER.

NOTES:

1. THRUST BLOCK SHALL BEAR AGAINST UNDISTURBED SOIL.
2. LOCATION OF THRUST BLOCK INSTALLATION SHALL BE DETERMINED IN THE FIELD.

TYPICAL THRUST BLOCK FOR BENDS

DIAMETER OF PIPE LINE IN INCHES	THRUST BLOCK AREA SQ. FT. (L(FT.) X H(FT.)) 90° BENDS	TEES, DEAD ENDS, OR 45° BENDS	22 1/2° BENDS
UP TO 8"	3.0	2.2	1.0
10"	5.5	4.0	1.5
16"	8.0	6.0	2.5
12"	12	9.0	3.5
	22	12	6.0

TYPICAL THRUST BLOCK FOR TEES

NOTE: SIZE OF INSIDE OF INLET OR GRATE INLET SHALL BE 4' X 4' OR SPECIFIED GRATE SIZE PLUS 12" WHICHEVER IS LARGER

FLOWERS & WHITE
ENGINEERING, L.L.C.
P.O. BOX 2245, FAIRHOPE, AL 36533
PH: 251-990-9080 FAX: 251-434-5291

ALABAMA REGISTERED PROFESSIONAL ENGINEER
No. 27553
8/25/2018

PROPOSED BK & POPEYES FOR
PREMIER KINGS COMPANIES
SHORTER, ALABAMA

These documents and their reproductions are the property of Flowers & White, Engineering, L.L.C. Reproduction of these documents in any manner is strictly prohibited, without the express written consent.

Copyright 2018 - Flowers & White Engineering, L.L.C.

PROJ. #	18-020
DRAWN BY:	KJ
CHECKED BY:	KJ
DATE:	8-9-18
REV. 1	
REV. 2	
REV. 3	

SHEET TITLE: DETAILS

SHEET NUMBER: 8.0

SHEET 8 OF 9

PRELIMINARY - NOT FOR CONSTRUCTION

Order Plans Online.com