

OVERVIEW

PRECISELY THE EXHAUST HOOD IS PROVIDED BY BURGER KING FRANCHISE SYSTEMS WILL INCLUDE THE FOLLOWING:

1. METAL FAB EXHAUST HOOD
2. METAL FAB EXHAUST EXHAUST DUCT
3. METAL FAB EXHAUST FAN
4. METAL FAB EXHAUST

THE SUPPLEMENTARY EXHAUST SYSTEMS WILL INCLUDE THE FOLLOWING:

1. HOOD
2. EXHAUST
3. EXHAUST
4. EXHAUST

IF ANY OTHER HOODS ARE USED PRE-PAID FOR ANNUAL FIRE SUPPRESSION SYSTEM.

CONTACT INFORMATION

ANSUL INSTALLATION QUESTIONS
ANSUL, INC., ANN ARBOR, MI
OFFICE PHONE: 1-800-462-1286

GENERAL NOTES FOR INSTALLATION CREWS
SCALE: NO SCALE

CONTACT INFORMATION

SHIPPING INFORMATION
FOR THE FRYER HOOD SYSTEM - BURGER KING FRANCHISE SYSTEMS, INC. TECHNICAL SUPPORT
PHONE: 1-800-462-1286

HOOD INSTALLATION QUESTIONS
FRANCHISE SYSTEMS, INC. TECHNICAL SUPPORT
PHONE: 1-800-462-1286

AMEREX INSTALLATION QUESTIONS
THE HOOD IS FACTORY PRE-PAID FOR AN AMEREX FIRE SUPPRESSION SYSTEM. THE LOCAL AMEREX DISTRIBUTOR WILL ASSIST CONTACT WITH THE REGIONAL ADMINISTRATOR TO SET UP THE METAL FAB SYSTEM. IF YOU WANT TO BE TRAVEL FROM THE DISTRIBUTION CONTACT:

MARK SIKK
AMEREX CORPORATION, TRUSSVILLE, AL
1-205-467-8770

JOHN COOK FAN INSTALLATION
IF THERE ARE QUESTIONS FOR ISSUES WITH THE JOHN COOK FAN INSTALLATION CONTACT:

DAVID REE
JOHN COOK COMPANY, SPRINGFIELD, MO
1-417-869-5424

METAL FAB DUCT INSTALLATION
IF THERE ARE QUESTIONS FOR ISSUES WITH THE METAL FAB DUCT INSTALLATION CONTACT:

METAL FAB INC. MOBILE, AL
COMMERCIAL SERVICE, CHANDLER, NC
1-800-812-1820

FRYER HOOD LISTING AND APPROVAL REFERENCE




ETL
INTERTAK TESTING SERVICES, INC.
BROKEN HOOD IS ETL LISTED EXHAUST HOODS WITHOUT FAN. EXHAUST HOODS, 24 INCHES, TESTED EXCEEDS BY ACCORDANCE WITH UNDERWRITERS LABORATORIES STANDARDS UL710 AND UL2284

NFPA
NATIONAL FIRE PROTECTION ASSOCIATION
FRYER HOOD MEETS ALL REQUIREMENTS OF NFPA-96 "STANDARD FOR VENTILATION CONTROL AND FIRE PROTECTION OF COMMERCIAL COOKING OPERATIONS"

NSF
NATIONAL SANITATION FOUNDATION
MEETS ALL REQUIREMENTS OF NSF STANDARD NUMBER 2 FOOD SERVICE EQUIPMENT

MECHANICAL CODES
MEETS ALL REQUIREMENTS OF THE IBC, BOMA, SBCCI AND ALL.

LISTINGS AND APPROVALS
SCALE: NO SCALE

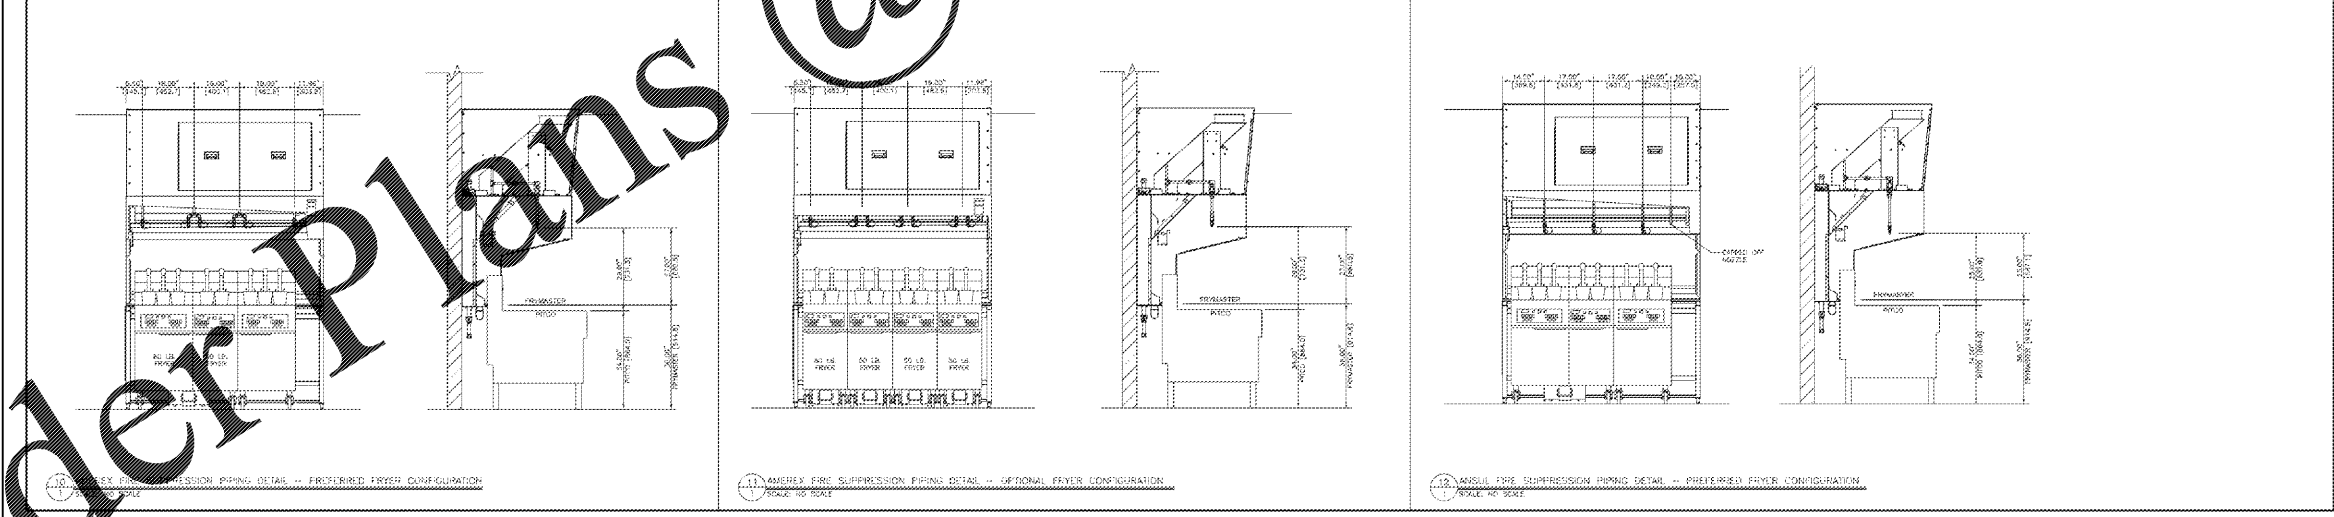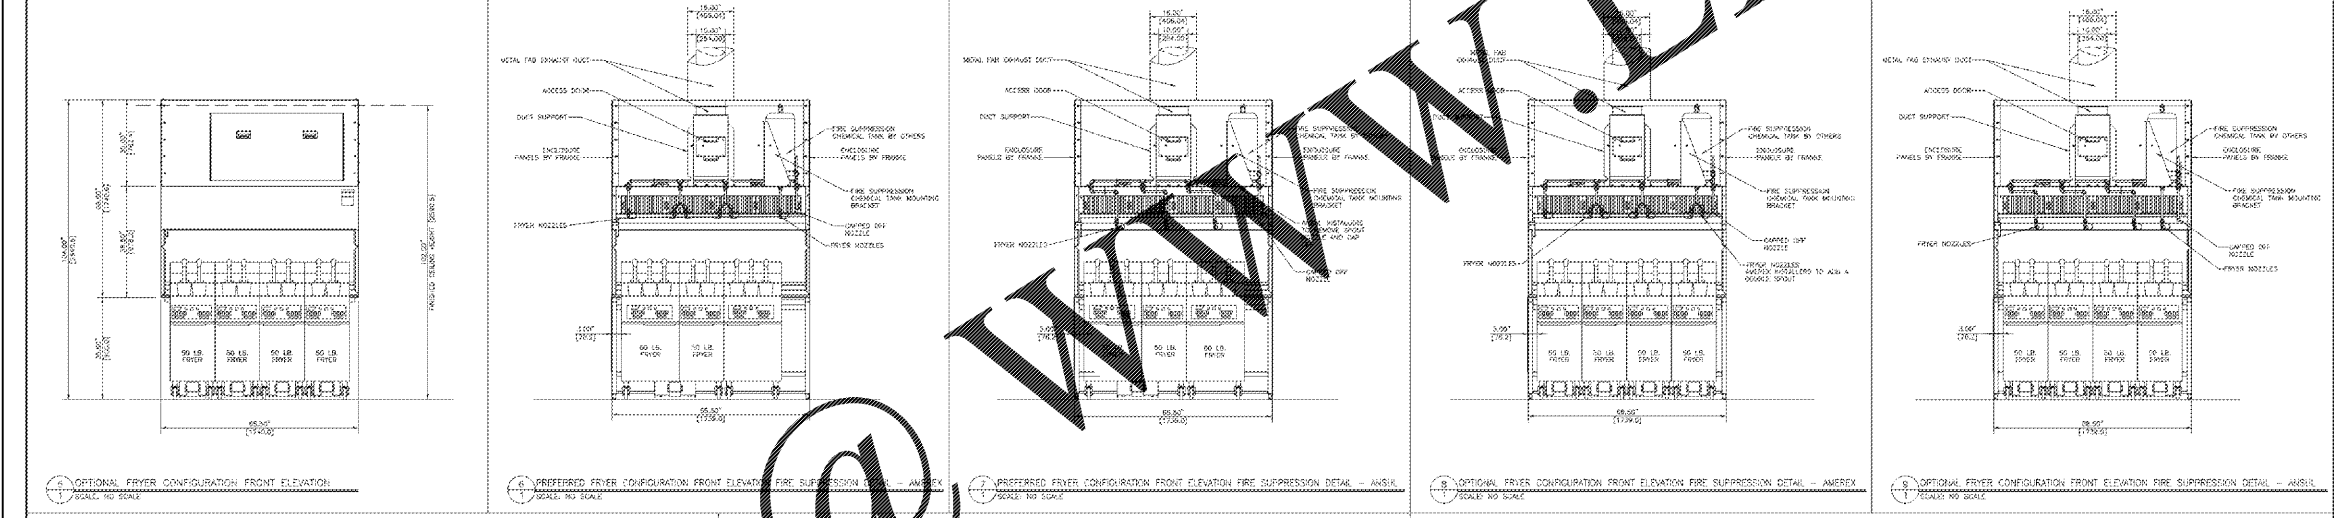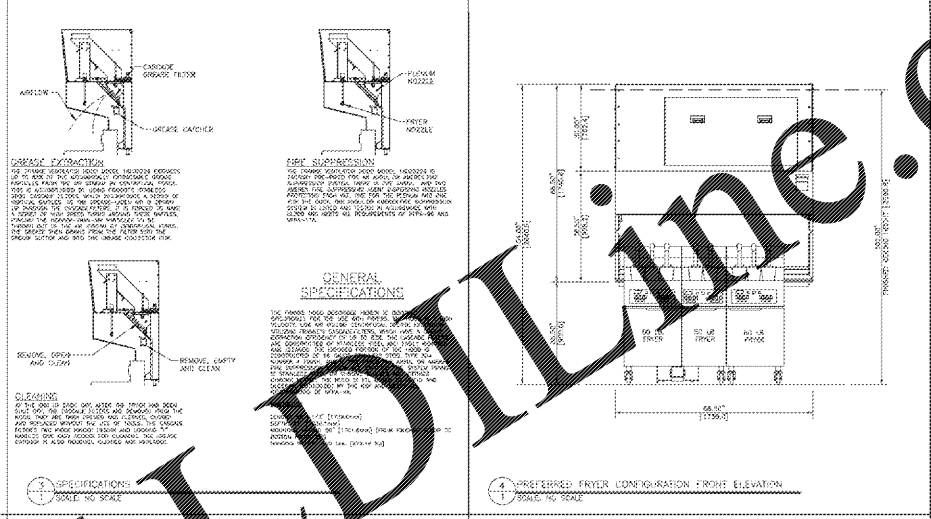

Revision #	Date	Description
B	12/16/14	D-SIZE ADDITION

STUVA

Franchise Development Systems, Inc.
200 Jackson Parkway
Ann Arbor, MI 48106-2152
Tel: 482-437-2000
www.stuva.com

BURGER KING
Franchise #
88-1/2" FRYER HOOD
INSTALLATION DETAILS

City: _____
State: _____
Zip Code: _____
County: _____

Electric Service (volts): _____
Gas Service (psi): _____
Plumbing (inches): _____
Fire Alarm (type): _____

Store Name: _____
Store # _____
Store Address: _____
Store Phone: _____

1 OF 3

Shane R. Hamilton P.E.
CONSULTING ENGINEER
1717 N. Howard Avenue
Tampa, FL 33607 (813) 251-6848

BURGER KING

CAMBRIDGE FRANCHISE HOLDINGS

IA ARCHITECTURE

LICENSED PROFESSIONAL ENGINEER
Shane R. Hamilton

STORE # _____
BUC-40-20/20 WAGE - SEPTEMBER 2016 DESIGN RELEASE
BURGER KING RESTAURANT
OFF OF I-40, THEN MAYBELLINE RD,
CALLOWAY, AR
TYPE-HOOD DETAILS (FRYER)

DRAWN BY: C.W.W.
NO DATE
REVISION

M 3