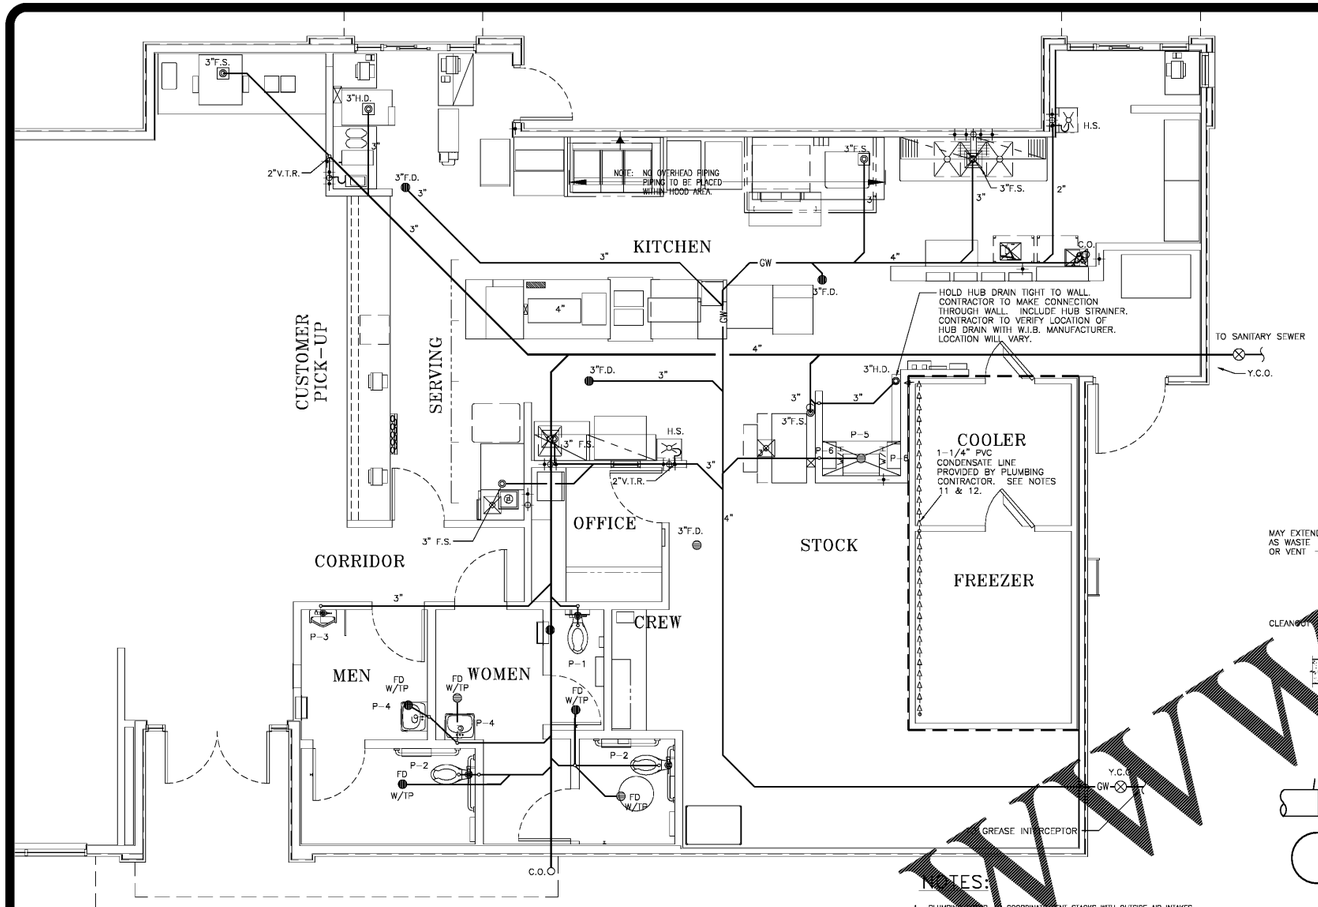

SANITARY AND GREASY WASTE PLAN

SCALE: 1/4" = 1'-0"

PLUMBING FIXTURE SCHEDULE					
MARK	FIXTURE	MANUFACTURER	MODEL NUMBER	MODEL NAME	VALVE
P-1	WATER CLOSET	AMERICAN STANDARD	2234.015	MADERA	SLOAN ROYAL #110
		KOHLER	4350	WELLCOMME	ZURN #Z6000AV-HET 1.25GPF
		ZURN	Z5655.001.01.00.00 -		
P-2	WATER CLOSET - ADA	AMERICAN STANDARD	3043.001	MADERA	SLOAN ROYAL #110
		ELJER	091-2175	PATRIOT	ZURN #Z6000AV-HET 1.25GPF
		ZURN	Z5655.001.01.00.00		
P-3	URINAL - ADA	AMERICAN STANDARD	6506.011	WASHBROOK	SLOAN ROYAL #186
		KOHLER	K-4960-ET	BARDON	ZURN #Z6003AV-EWS .50 GPF
		ZURN	Z5751.196.00		
P-4	LAVATORIES **	ZURN	Z5344		KOHLER K-15598 FAUCET -OR- ZURN #7440-XL FAUCET
		KOHLER	K-2054	SOHO	
P-5	MOP SINK	CAST IN PLACE			CHICAGO #897-CP -OR- AMERICAN STANDARD #8344.1 -OR- KOHLER #8907
P-6	WATER HEATER	RINNAI	RU98I		MINIMUM EFFICIENCY FACTOR EQUAL TO 0.80
P-7	TEMPERING VALVE	WATTS	N170L-M2		
P-8	FLOOR SINK	JOSAM	49300 (49320A AT 3-COMP SINK)		
		J.R. SMITH	3100 (3111 AT 3-COMP SINK)		
		ZURN	Z1810 (Z1900 AT 3-COMP SINK)		
P-9	FLOOR DRAIN	JOSAM	30000-50		
		J.R. SMITH	3010-AP		
		ZURN	Z415B-P		

NOTES:
1. COMPARABLE FIXTURES BY AMERICAN STANDARD, ELJER AND KOHLER ARE ACCEPABLE.
2. TOILET SEATS TO BE CHURCH 9500SS, KOHLER K-4731-C, OLSONITE #10C OR EQUAL.
3. IN SINGLE USE RESTROOMS ALL FIXTURES MUST BE ADA COMPLIANT.

** PROVIDE ASSE 1070 COMPLIANT THERMOSTATIC MIXING VALVES AT LAVATORIES, SET TO 109°F

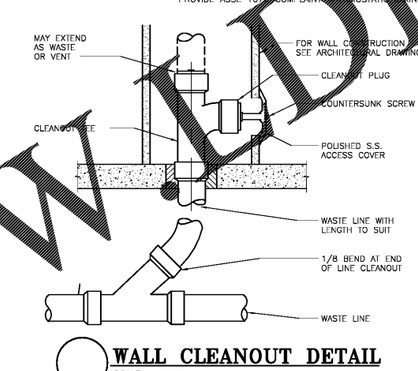

WALL CLEANOUT DETAIL

SCALE: NONE

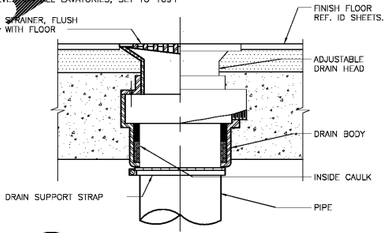

FLOOR DRAIN DETAIL

SCALE: NONE

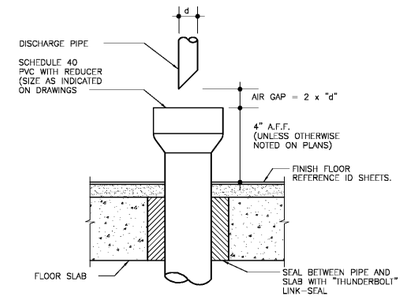

HUB DRAIN DETAIL

SCALE: NONE

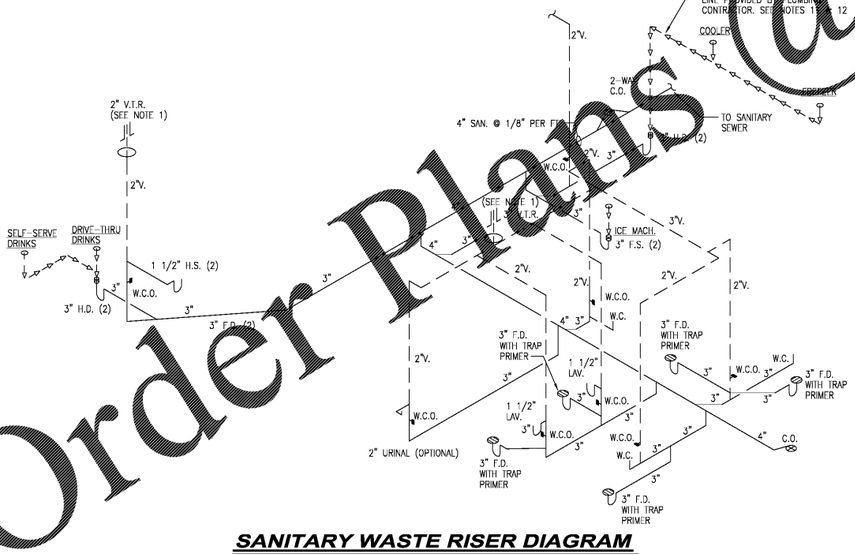

SANITARY WASTE RISER DIAGRAM

SCALE: NONE

NOTES:

1. PLUMBING CONTRACTOR TO COORDINATE VENT STACKS WITH OUTSIDE AIR INTAKES OF A/C UNITS. SUPPLY FANS TO MAINTAIN AT LEAST 10'-0" MIN. CLEARANCE OR AS PER LOCAL CODE REQUIREMENTS. FLAT VENTS ARE NOT ALLOWED.
2. INCREASE V.T.R.'S TO SIZE REQUIRED BY LOCAL CODES AND CONDITIONS AS REQUIRED FOR FROST ENCLOSURE. FLAT VENTS ARE NOT ALLOWED
3. RUN SYRUP LINES FROM SODA FACTORY TO DRINK DISPENSER ABOVE CEILING.
4. CAST IRON PIPE MAY BE USED UNDER SLAB IN LIEU OF PVC ONLY IF REQUIRED BY CODE.
5. PROVIDE CONDENSATE LINES FROM A/C UNITS ABOVE CEILING ACCORDING TO LOCAL CODE REQUIREMENTS.
6. RESEAL FLOOR DRAINS ACCORDING TO LOCAL REQUIREMENTS.
7. SAFEWASTE PIPING ABOVE AND ALONG FLOOR SHALL BE SIZED IN ACCORDANCE WITH LOCAL CODE REQUIREMENTS.
8. COORDINATE SAFEWASTE LINE CONNECTIONS WITH EQUIPMENT ROUGH-IN.
9. P.V.C. (SCHEDULE 40) PIPE CAN BE USED FOR VENTS AND WASTE ONLY IF APPROVED BY LOCAL BUILDING CODES. SEE SPECS. FOR ADD'L. INFO.
10. SEE FOUNDATION PLAN FOR EXACT LOCATION OF FLOOR DRAINS AND FLOOR SINKS.
11. IF WALK-IN-BOX CONDENSATE LINE IS REQUIRED BY LOCAL CODE, PLUMBING CONTRACTOR SHALL FURNISH AND INSTALL 1 1/4" CONDENSATE LINE, AND SEAL AROUND ALL PENETRATIONS THROUGH THE WALK-IN-BOX.
12. HEAT TAPE IS PROVIDED BY WALK-IN-BOX MANUFACTURER AND INSTALLED BY ELECTRICAL CONTRACTOR. IT IS TO BE SELF-LIMITING TYPE, "TROSTEX" OR EQUAL.

LEGEND

LEGEND MAY CONTAIN ITEMS NOT USED IN THIS BUILDING. CONTRACTOR TO VERIFY.

GW	GREASY WASTE LINE
SS	SANITARY WASTE LINE
RAIN	RAIN WATER LINE
	SAFEWASTE PIPING
	F.C.O.- FLOOR CLEANOUT
	F.D.- FLOOR DRAIN
	F.S.- FLOOR SINK
	HUB OR FUNNEL DRAIN
	V.T.R.- VENT THRU-ROOF
	FIXTURE TRAP
	W.C.O.- WALL CLEAN OUT
	VENT PIPING

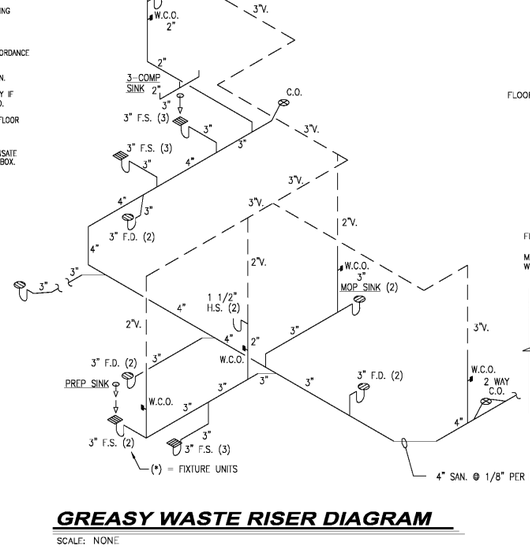

GREASY WASTE RISER DIAGRAM

SCALE: NONE

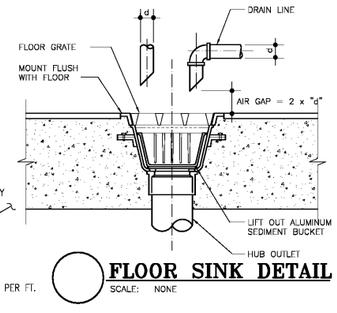

FLOOR SINK DETAIL

SCALE: NONE

Order Plans @ WWW.DLine.com

NO.	DATE	REVISION
	08/18/18	RELEASED FOR CONSTRUCTION

DRAWN BY: MRW
CHECKED BY: JMH

PREMIER KINGS, INC.
5529 CARMICHAEL ROAD
MONTGOMERY, ALABAMA 36117
PHONE:
LINDSEY@SKALABAMA.COM

hendon huckestein architects, PC
architecture . planning . interior design
2126 Monk Avenue
Birmingham AL 35203
Phone (205) 322-1751
Fax (205) 322-1778
email info@hhainc.com
www.hhainc.com

PROJECT #: 18026.18
ROC-60 20/20 IMAGE: APRIL 2015 DESIGN RELEASE

BURGER KING RESTAURANT

--
SHORTER, AL

SANITARY AND GREASY WASTE PLAN & RISER

P-1