


- ① 0-18V CONTROL CABLE REQUIRED TO EACH DIMMED LUMINAIRE
- ② NOT USED
- ③ NOT USED
- ④ LUMINAIRE IS LOCATED WITHIN PRIMARY SIDE-LIGHTED AREA AND IS DIMMED BY PHOTOSENSOR
- ⑤ NOT USED
- ⑥ EMERGENCY SECTION

② SPECIFIC NOTES
NO SCALE


WARD SCOTT ARCHITECTURE
5 Seven West Street
Tuscaloosa, AL 35701
www.ward-scott.com

Smith Stegall
4 Jackson P.O.
Consulting Engineers
Lighting
Tuscaloosa, Alabama 35701
Phone/Fax 206 348 4401
E-mail info@smithstegall.com

STATE OF ALABAMA
1948
3528
REGISTERED PROFESSIONAL ENGINEERS ASSOCIATION

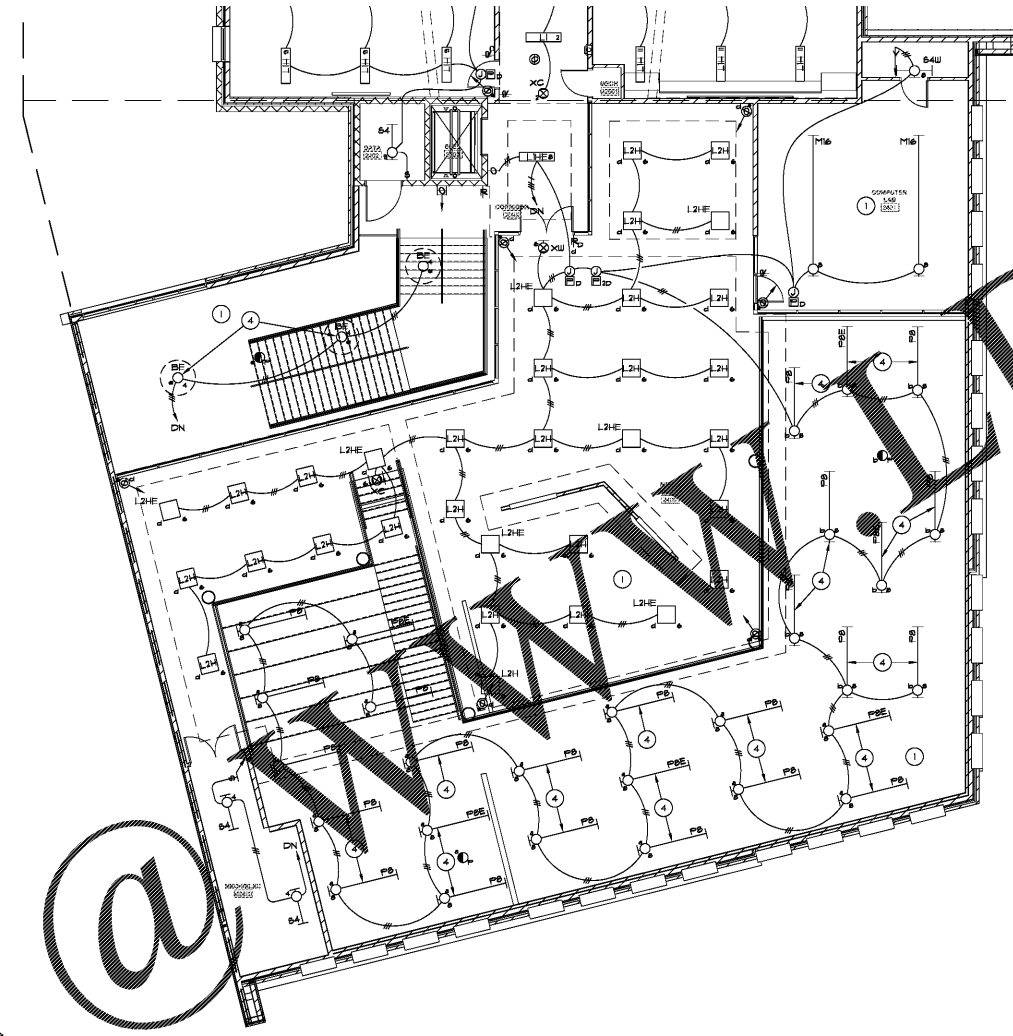

① SECOND FLOOR LIGHTING PLAN - AREA D2
1/8" = 1'-0"

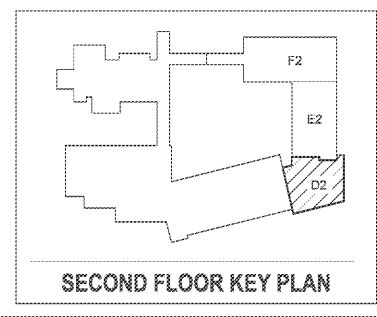

CONSTRUCTION DOCUMENTS		
DATE:	11-16-18	
PROJ NO:	17-072	
REVISIONS		
#	DESC	DATE
SECOND FLOOR LIGHTING PLAN - AREA D2		
E220		

Copyright Ward Scott Architecture, Inc. All Rights Reserved 11/19/2018 4:39:10 PM Z:\1844 - Northport Middle School\1844 - Electrical.dwg

Order Plans @ WARDSCOTTLINE.COM