POWER NOTES

1. RECESSED DUPLEX OUTLET FOR TWO-STATION WALL MOUNT WATER COOLERS. VERIFY ROUGH-IN HEIGHT AND LOCATION REQUIREMENTS WITH EQUIPMENT SPECIFICATIONS.
2. E.C. SHALL PROVIDE ARLINGTON BOX, TVBU505 AT 80" AFF. PROVIDE RECEPTACLE AT CENTER OF THE WALL.
3. RUN (3) 20A 120V CIRCUITS IN (1) 1" CONDUIT (6-#10, 3-#10 G. IN (1) 1" C.) FROM FLOOR BOX "F" UNDERSLAB TO NEAREST WALL. (2) DEDICATED FOR POS AND (1) FOR GENERAL PURPOSE.
4. RUN (2) 1" C TO FLOOR BOX FROM J-BOX "C" IN OFFICE WITH PULL STRING FOR DATA CABLE. SEE DETAIL 2/E111.
5. PROVIDE 1"C THROUGH ROOF FOR SATELLITE CONNECTION. PROVIDE WITH WEATHERHEAD. SECURE CONDUIT MINIMUM 2 LOCATIONS TO STRUCTURE. COORDINATE WITH ROOFING CONTRACTOR FOR PROPER FLASHING.
6. PROVIDE 3'X3'X3/4" PAINTED PLYWOOD BACKBOARD 6" BELOW CEILING. SEE DETAIL 2/E111.
7. PROVIDE (3) 1"C THROUGH WALL ABOVE OFFICE CEILING. SEAL CONDUIT PENETRATIONS.
8. PROVIDE 4'X4'X3/4" PLYWOOD BACKBOARD, 36" AFF. TO BOTTOM, PAINT ALL SIDES AND EDGES FOR BATTERY CHARGER.
9. PROVIDE 4'X4'X3/4" PLYWOOD BACKBOARD, PAINTED FOR TELEPHONE TERMINAL BOARD. RUN #6 COPPER GROUND TO MAIN GROUNDING BAR.
10. PERMANENTLY CONNECTED EQUIPMENT SHALL BE PROVIDED WITH A LOCKABLE BREAKER CAPABLE OF BEING LOCKED IN THE OFF POSITION IN ACCORDANCE WITH NEC 422.31(B). EXTEND LIQUIDTIGHT FLEXIBLE METAL CONDUIT FROM JUNCTION BOX TO EQUIPMENT, AS REQUIRED.
11. WR/GFI RECEPTACLE IS FACTORY INSTALLED. EC SHALL ROUTE ALL CIRCUITS TO RECEPTACLE VIA BOTTOM POWER ENTRY IN CURB.
12. SAFETY DISCONNECT SWITCHES ARE FACTORY INSTALLED IN ALL RTU'S. EC SHALL ROUTE CIRCUITS TO DISCONNECT SWITCH VIA BOTTOM ENTRY OF CURB.
13. 2" C. STUB UP TO TELEPHONE PANEL – ROUTE 2" C. BELOW GRADE TO STREET FOR SERVICE ENTRANCE. SEE CIVIL FOR REQUIRED CONDUIT STUB-UPS. COORDINATE FINAL CONNECTION POINT WITH LOCAL TELEPHONE COMPANY.
14. SWITCHED SHOW WINDOW RECEPTACLE. E.C. SHALL VERIFY EXACT LOCATION AND REQUIREMENTS WITH OWNER PRIOR TO ROUGH-IN.
15. PROVIDE (1) CAT5 CABLE AND (1) COAX CABLE. SEE DETAIL 2/E111.
16. E.C. SHALL PROVIDE DISCONNECT AS REQUIRED PER EQUIPMENT NAME PLATE DATA. COORDINATE FINAL LOCATION AND MOUNTING HEIGHT WITH GENERAL CONTRACTOR.
17. E.C. SHALL PROVIDE A WALL SWITCH TO CONTROL EXHAUST FAN (EF-3) OPERATION. THE EXHAUST FAN IS TO BE INTERLOCKED WITH THE EXHAUST FAN DAMPER AND THE MAKE UP AIR DAMPER ACTUATORS SO THAT THE DAMPERS ARE ACTIVATED AND OPEN WHEN THE EXHAUST FAN IS OPERATING.
18. AUDIO VISUAL DEVICE BY MECHANICAL CONTRACTOR. E.C. SHALL PROVIDE CONDUIT AND J-BOX AS REQUIRED. COORDINATE WITH MECHANICAL CONTRACTOR.

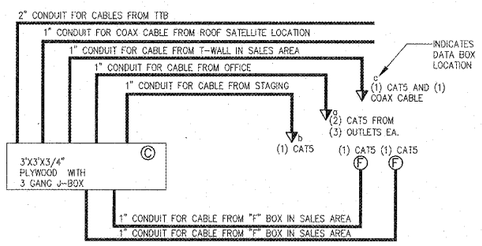

NOTE:

COAX CABLE AND LOW VOLTAGE CABLE PROVIDED AND INSTALLED BY OTHERS.

2 / E111 3-GANG J-BOX IN OFFICE DETAIL

SCALE: NTS

NOTE:

SEE SHEET E001 FOR GENERAL NOTES AND LEGENDS.

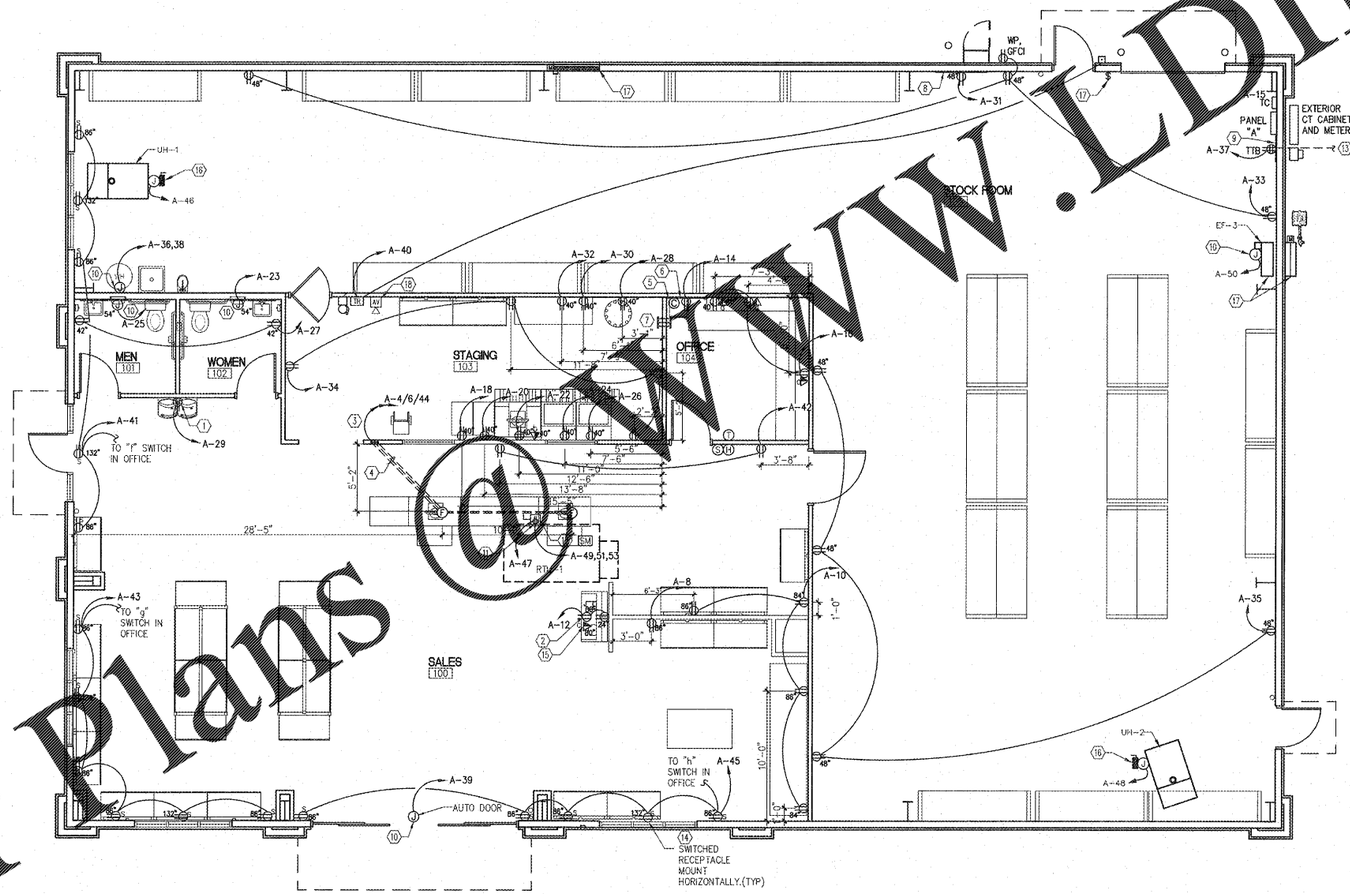

1 / E111 ELECTRICAL FLOOR PLAN

SCALE: 3/16" = 1'-0"

Order Plans @ WWW.LDILine.com

LMHT Project No. 18153

THIS DRAWING IS THE PROPERTY OF THE ARCHITECT AND MAY NOT BE REPRODUCED OR USED WITHOUT HIS WRITTEN PERMISSION

LMHT Associates
Architecture Engineering Interiors
1065 Cantamena Hill Drive
Suite 150 Kernersville, N.C.
phone: 919.344.0097 fax: 919.344.0399

LMHT ENGINEER LICENSE NUMBER - C-1369

PROJECT: SHERWIN WILLIAMS
3609 RAMSEY STREET
FAYETTEVILLE, NC 28311

DRAWING: ELECTRICAL POWER PLAN

Revisions

REVISION DATE

PROJECT DATE 11/19/2019

Drawn By JP

Checked By DRS

Sheet No. E111