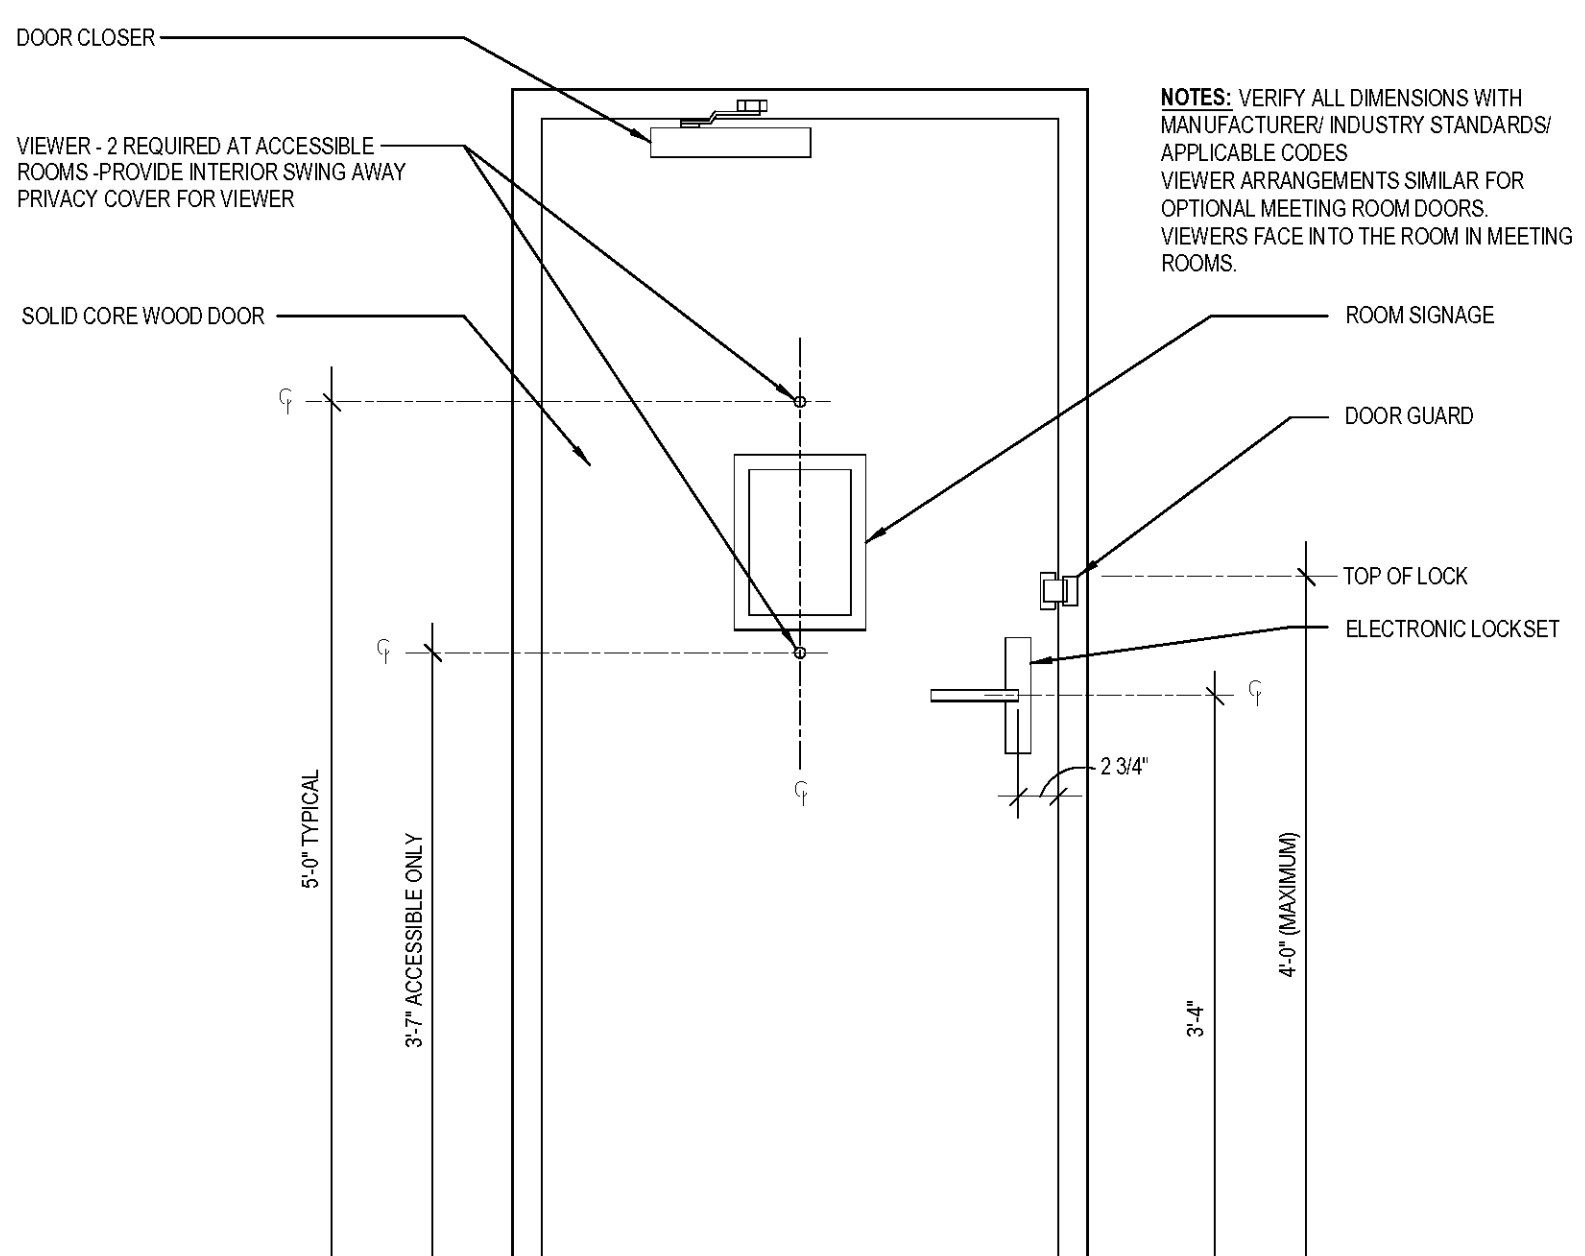

NOTES: VERIFY ALL DIMENSIONS WITH MANUFACTURER/ INDUSTRY STANDARDS/ APPLICABLE CODES
VIEWER ARRANGEMENTS SIMILAR FOR OPTIONAL MEETING ROOM DOORS.
VIEWERS FACE INTO THE ROOM IN MEETING ROOMS.

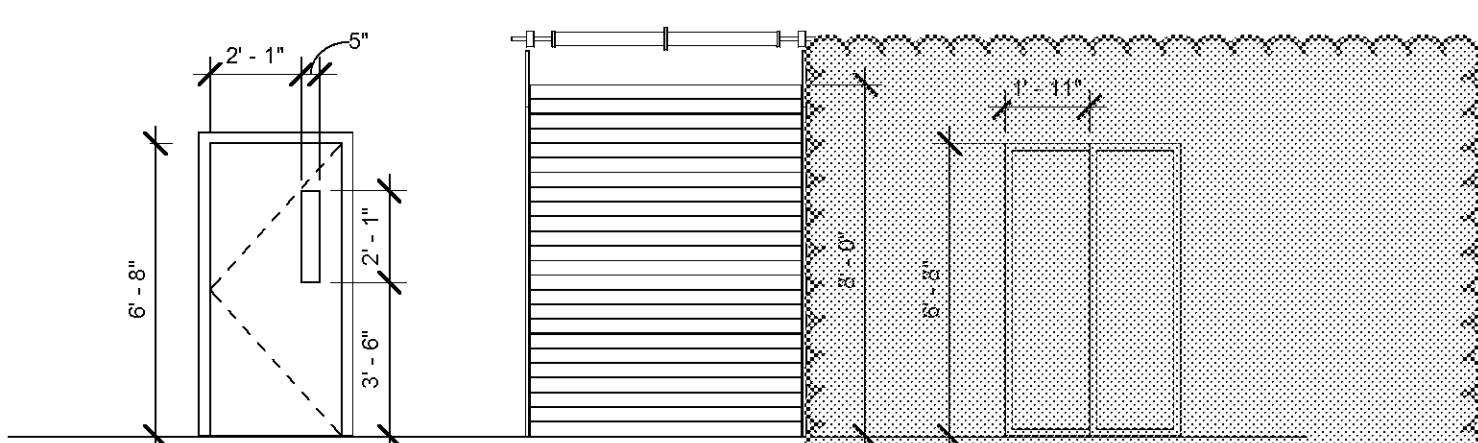

D10 HOLLOW METAL PAINTED WITH VISION GLASS

D11 PREFINISHED METAL OVERHEAD DOOR

D12 SLIDING ALUM FRAME GLASS SHOWER DOOR

Push/pull plates are required at multi-stall restrooms. Direct line of sight into multi-occupant restroom toward the urinal or water closet is prohibited.

Showers (not tubs) require a bypass sliding door system with a 72"/1.83 minimum walk-through clearance. Doors must be frameless with smooth, tempered frosted glass, 3/8 mm minimum thick, with either tubular pull handles (8"/200 mm long or more, mounted vertically) or towel bar handles (mounted horizontally). Stabilizer bars for bracing are not allowed. System frame must be aluminum or stainless steel.
Metal component finishes must match finishes of bath fixtures and accessories - refer to 2012.04.8.

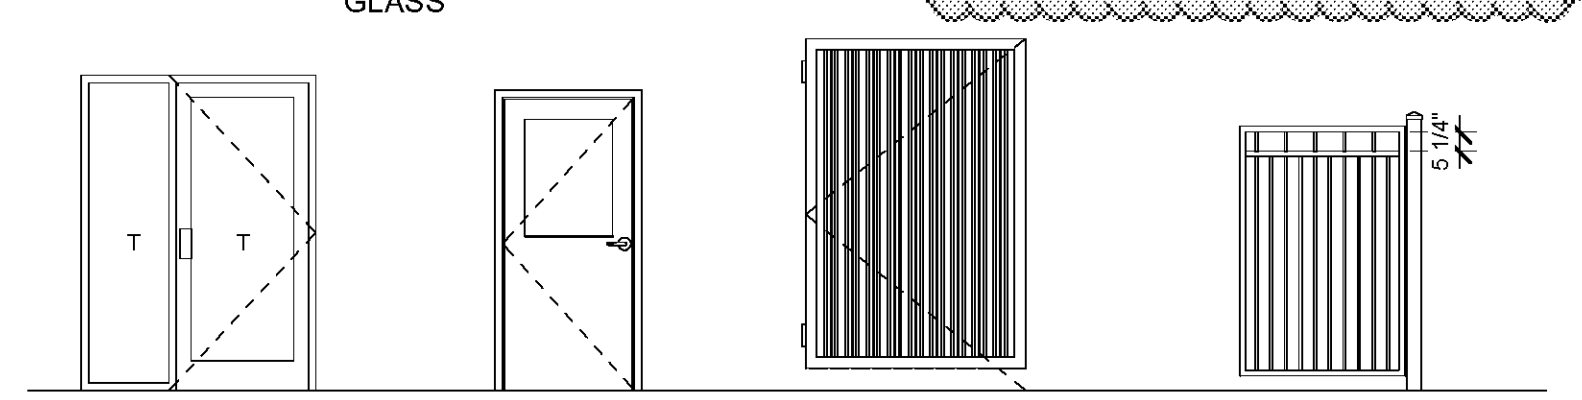

D13 ALUM. STOREFRONT W TEMPERED GLASS

D14 ALUM. STOREFRONT W TEMPERED GLASS

D15 METAL WITH PRIVACY PANEL DUMPSTER AREA DOOR

D16 PREFINISHED METAL POOL FENCE DOOR SELF-LATCHING AND LOCKABLE GATE

Door Schedule

Mark	Width	Height	Door Types	Door Material	Frame Material	Thickness	Fire Rating	Comments
102	7' - 0"	7' - 2"	D8	ALUM.	ALUM.	1 3/4"		PANIC HARDWARE
103	7' - 0"	7' - 2"	D8	ALUM.	ALUM.	1 3/4"		CARD KEY AND PANIC HARDWARE
104	3' - 0"	7' - 0"	D13	ALUM.	ALUM.			CARD KEY AND PANIC HARDWARE
107	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	
108	3' - 0"	7' - 0"	D13	ALUM.	ALUM.		20 MINS.	CARD KEY AND PANIC HARDWARE
110	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	90 MINS.	LOCK SET
113	3' - 0"	6' - 8"	D10	S.C. WOOD	H.M.	1 3/4"	90 MINS.	CARD KEY AND PANIC HARDWARE
114	3' - 0"	7' - 0"	D13	ALUM.	ALUM.			CARD KEY AND PANIC HARDWARE
120	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		KEYPAD LOCK
121	4' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	LOCK SET
122	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	LOCK SET
124	2' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		
126	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	LOCK SET
127A	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	KEYPAD LOCK
127B	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	LOCK SET
130	3' - 6"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	LOCK SET
131	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		LOCK SET
132	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	LOCK SET
133A	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	90 MINS.	
133B	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	90 MINS.	
134	4' - 0"	6' - 8"	D1	H.M.	H.M.	1 3/4"		INSULATED AND LOCK SET
135	3' - 6"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	LOCK SET
136A	7' - 0"	7' - 2"	D8	ALUM.	ALUM.	1 3/4"		PANIC HARDWARE
136B	7' - 0"	7' - 2"	D8	ALUM.	ALUM.	1 3/4"		CARD KEY AND PANIC HARDWARE
143	3' - 0"	6' - 8"	D4	ALUM.	ALUM.			CARD KEY AND PANIC HARDWARE
146A	3' - 0"	6' - 8"	D10	S.C. WOOD	H.M.	1 3/4"	90 MINS.	PANIC HARDWARE
146B	3' - 0"	6' - 8"	D1	H.M.	H.M.	1 3/4"		CARD KEY AND PANIC HARDWARE, INSULATED
147	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	90 MINS.	LOCK SET
148	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	KEYPAD LOCK
149	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	
150	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"	20 MINS.	
151	3' - 6"	6' - 8"	D1	H.M.	H.M.	1 3/4"		INSULATED AND LOCK SET
152	6' - 0"	7' - 0"	D11	H.M.	H.M.	1 3/8"		LOCK SET
156	3' - 6"	6' - 8"	D1	H.M.	H.M.	1 3/4"		INSULATED AND LOCK SET
157	3' - 0"	6' - 8"	D1	H.M.	H.M.	1 3/4"		INSULATED AND LOCK SET
158	3' - 0"	6' - 8"	D1	H.M.	H.M.	1 3/4"		PRIVACY LOCK, INSULATED
201	3' - 0"	6' - 8"	D10	S.C. WOOD	H.M.	1 3/4"	90 MINS.	PANIC HARDWARE
227	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		LOCK SET
230	3' - 0"	6' - 8"	D10	S.C. WOOD	H.M.	1 3/4"	90 MINS.	PANIC HARDWARE
301	3' - 0"	6' - 8"	D10	S.C. WOOD	H.M.	1 3/4"	90 MINS.	PANIC HARDWARE
327	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		LOCK SET
330	3' - 0"	6' - 8"	D10	S.C. WOOD	H.M.	1 3/4"	90 MINS.	PANIC HARDWARE
401	3' - 0"	6' - 8"	D10	S.C. WOOD	H.M.	1 3/4"	90 MINS.	PANIC HARDWARE
427	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		LOCK SET
430	3' - 0"	6' - 8"	D10	S.C. WOOD	H.M.	1 3/4"	90 MINS.	PANIC HARDWARE
537	3' - 0"	6' - 8"	D1	H.M.	H.M.	1 3/4"	90 MINS.	LOCK SET
A	3' - 0"	6' - 8"	D2	S.C. WOOD	H.M.	1 3/4"	20-Minute	CARD KEY AND DOOR CLOSURE
B	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		PRIVACY LOCK
B1	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		PRIVACY LOCK AND ADA COMPLIANT
C	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		PRIVACY LOCK
D	5' - 0"	6' - 8"	D12	GLASS	ALUM.			TEMPERED GLASS
E	3' - 0"	6' - 8"	D1	S.C. WOOD	H.M.	1 3/4"		DOUBLE DOOR DEAD BOLT FROM BOTH SIDES
F	3' - 0"	6' - 8"				1 3/4"		TOILET PARTITION DOOR AS PER MANUFACTURER'S SPEC.

Grand total: 270

Ensure the office door has a tamper-proof, 180 degree, one way door viewer.

Ensure all guest room entry doors have closers with an integral stop.

Cross reference the door hardware to the door schedule. A door and hardware construction submittal is required for review.

Only Front Desk System
Front Desk, Guest Cards, 2 Day Training
Set #1: Guestroom Entry Door
1.5 PR Hinges
1 Advance Card Lock - Wing Lever
1 Door Closer - w/ 90° Stop
1 Perimeter Gasketing
1 Vinyl Threshold
1 Door Bottom - Notched
1 Door Sweep
1 Privacy Latch
1 One Way Viewer ((2) @ Accessible Rooms)
Smoking Guestroom Entry Doors (substitute the following)
1 Door Bottom - Unnotched
Set #2: Bathroom Pocket Doors
1 Pocket Door Kit
1 Privacy Lock
1 Finger Pull
Accessible Bathroom Pocket Doors
1 Pocket Door Kit
1 Sliding Dr Pull w/Latch
Set #3: Connecting Doors
2 PR Spring Hinge
1 PR Hinges
2 Connecting Latch
2 Conn. DR Deadbolt
2 Perimeter Gasketing
1 Vinyl Threshold
2 Door Bottom - Unnotched
2 Door Sweeps
2 Door Guard w/ Edge
2 Wall Stop
Set #4: Bedroom Do[illegible]
1.5 PR Hi[illegible]
1 Privacy [illegible]
1 Wall Stop
Set #5: [illegible] Swing D[illegible]
1.5 [illegible]ges
1 Pri[illegible]
1 Rolle[illegible]per
Set #6: Sliding [illegible] Entry Door
1 Remote [illegible]
1 Intercom[illegible]
Security Ca[illegible]
[illegible]ance Of Hardware part of Door Unit
Set #7: [illegible] Exercise Room
[illegible]ance Card Lock - Wing Lever
[illegible] Continuous Hinge
1 Door Closer
Set #8: Exterior Aluminum Vestibule Swinging Doors
1 Remote Reader
1 Intercom/Buzzer
2 Continuous Hinges
2 Panic Devices
2 Push/Pulls
2 Door Closers
1 Threshold
2 Door Sweeps
1 Weatherstrip
Set #9: Aluminum Pool Lobby
1 Remote Reader
1 Continuous Hinges
1 Panic Devices
1 Push/Pulls
1 Door Closers
Set #10: Interior Aluminum Vestibule Swinging Doors
2 Continuous Hinges
2 Panic Devices
2 Push/Pulls
2 Door Closers
1 Threshold
2 Door Sweeps
1 Weatherstrip
Set #11: Hollow Metal Elevator Equipment Door
1.5 PR Hinges
1 Store Room Lock
1 Door Closer
1 Weatherstrip
1 Threshold
1 Door Sweep
1 Rain Drip
Set #12: Exterior Aluminum Egress Door
1 Rim Panic Interface
1 Continuous Hinges
1 Panic Devices
1 Push/Pulls
1 Door Closers
1 Threshold
1 Door Sweeps
1 Weatherstrip
Set #13:
3 PR Hinges
1 Store Room Lock
2 Flush Bolt
2 Door Closer
1 Weatherstrip
Set #14:
1.5 PR Hinges
1 Store Room Lock
1 Door Closer
1 Weatherstrip
1 Wall Stop
Set #15:
1.5 PR Hinges
1 Rim Exit Device
1 Door Closer
1 Weatherstrip
1 Wall Stop
Set #16:
1.5 PR Hinges
1 Rim Panic Interface
1 Rim Exit Device
1 Door Closer
1 Weatherstrip
1 Threshold
1 Door Sweep
1 Rain Drip Cap
Set #17:
1.5 PR Hinges
1 Advance Cardlock - Wing Lever
1 Door Closer
1 Weatherstrip
1 Wall Stop
Set #18:
1.5 PR Hinges
1 Office Lock
1 Wall Stop
Set #19:
2 PR Hinges
1 Advance Cardlock - Wing Lever
1 Door Closer
1 Weatherstrip
1 Wall Stop
Set #20:
1.5 PR Hinges
1 Advance Cardlock - Wing Lever
1 Door Closer
1 Weatherstrip
1 Wall Stop
Set #21:
1.5 PR Hinges
1 Privacy Set
1 Weatherstrip
1 Wall Stop
2 Kick Plate
Set #22:
1.5 PR Hinges
1 Rim Exit Device
1 Door Closer
1 Weatherstrip
1 Magnetic Hold Open
Set #23:
4 PR Swing Clr Hinges
1 Latchset
2 Wd Auto Flush Bolt
1 Coordinator
2 Door Closer
1 Weatherstrip
1 Magnetic Hold Open
Set #24:
2 PR Hvy Wt Hinges
1 Advance Cardlock - Wing Lever
1 Door Closer
1 Weatherstrip
1 Wall Stop
Set #25:
2 PR Hinges
1 Latchset
1 Door Closer
1 Weatherstrip
1 Magnetic Hold Open
Set #26:
1.5 PR Hinges
1 Store Room Lock
1 Wall Stop
Set #27:
1.5 PR Hinges
1 Advance Cardlock - Wing Lever w/ Weather Pack
1 Door Closer
1 Weatherstrip
1 Threshold
1 Door Sweep
1 Rain Drip

GENERAL DOOR NOTES:

1. ALL DOOR HARDWARE SHALL BE US 32D FINISH (U.N.O.)
2. ALL DOOR CYLINDERS TO BE IC CORE FORMAT TO MATCH PROPERTY STANDARDS.
3. REFER TO SHEET A10.02 FOR DOOR HEAD & JAMB INFO.
4. REFER TO SHEET A10.03 FOR WALL TYPES - CROSS REFERENCE AGAINST DOOR FRAME THROAT THICKNESS
5. ALL DOORS SHALL BE PRE-FINISHED (SHOP OR FACTORY)
6. TOPS, BOTTOMS & SIDES OF ALL DOORS SHALL BE PAINTED OR STAINED TO MATCH DOOR.
7. PROVIDE CONSTRUCTION CYLINDERS DURING CONSTRUCTION. FOR DOORS REQ'D TO BE LOCKED REPLACE CONSTRUCTION CYLINDERS PRIOR TO HOTEL OPENING. COORDINATE W/ GENERAL CONTRACTOR.
8. ALL DOOR[illegible] MASTER K[illegible] COORDINATE KEYING [illegible] OWNER.
9. [illegible] LOCKSETS & CYLINDERS ARE [illegible] W/ FINAL CORES. PERMANENT KEYING BY DOOR SUB[illegible]
10. [illegible] 'EXIT' DOORS MUST BE OPERABLE FROM THE INSIDE W/OUT [illegible] OF A KEY, SPECIAL KNOWLEDGE, OR EFFORT.
11. ALL [illegible] DOOR [illegible] & SIDELITES SHALL BE CLEAR TEMPE[illegible]
12. GLAZING AT EXTERIOR DOORS & SIDELITES SHALL BE INSULATED TEMPERED LITES.-- REFER TO ELEVATIONS
13. ALL DOOR HARDWARE SHALL COMPLY W/ ACCESSIBILITY REQ'S FOR ACCESSIBILITY. - FEDERAL, STATE & LOCAL ACCESSIBILITY CODE(S).
14. ALL FULL/HALF VISION DOORS SHALL BE A MEDIUM STILE (U.N.O.)
15. ALL RATED DOORS SHALL BE PROVIDED W/ MIN. REQ.'D DOOR HARDWARE REGARDLESS IF NOT SHOWN ON SCHEDULE. IF DIRECTION INDICATED OR NOTED IS SPECIFICALLY IN CONTRADICTION TO WHAT IS REQ'D. IN RATED DOORS, CONTACT ARCHITECT.
16. WHERE UNDERCUT NOT SPECIFIED, STANDARD UNDERCUT OF 3/4" FOR HM & WOOD DOORS.
17. 1 1/2" PAIR BUTT HINGES PER DOOR LEAF UP TO 7'-0". SOLID CORE WOOD OR HM DOORS FROM 7'-0" TO 10'-0" PROVIDE 2 PAIR BUTT HINGES PER DOOR LEAF. DOORS 10'-1" TO 14'-0" IN HEIGHT, PROVIDE 2 1/2 PAIR HINGES PER DOOR LEAF.
18. PROVIDE (3) SILENCERS IN SINGLE LEAF DOORS, (2) SILENCERS IN DOUBLE LEAF DOORS UNLESS PAIR OF DOORS HAS MIDDLE MULLION THEN PROVIDE A TOTAL (6) SILENCERS
19. LOCKSET SHALL OPERATE WHERE TURNING KEY UNLATCHES DOOR WHEN PUSHBUTTON IS ENGAGED & TURNED, KEY OPERATION WILL BE REQ'D @ ALL TIMES. RELEASING PUSHBUTTON UNLOCKS DOOR.
20. REFER TO INTERIOR ELEVATIONS FOR DOOR FINISHES. DOORS SPECIFIED W/ A MILLWORK FINISH SHALL BE FINISHED BY MILLWORK CONTRACTOR TO MATCH MILLWORK IN THAT ROOM/AREA.
21. PROVIDE REMOTE CARD READERS @ ALL EXTERIOR DOORS, INCLUDING MAIN ENTRY, & @ EXERCISE ROOM, INDOOR POOL, GUEST LAUNDRY & @ LINEN STORAGE ROOMS.
22. ALL EXTERIOR HOLLOW METAL DOORS SHALL BE GALVANIZED & INSULATED.
23. ALL EXTERIOR DOORS SHALL BE PROVIDED W/ AN ALUMN. DRIP EDGE ANCHORED TO UNDERSIDE OF WALL CONSTRUCTION (DOORS AS PART OF AN ALUMN. STOREFRONT SYSTEM W/ A TRANSOM LITE DO NOT REQUIRE DRIP EDGE - NOR DO DOORS THAT ARE PROTECTED UNDER CANOPIES.
24. ALL EXTERIOR DOORS SHALL HAVE THE TOP OF THE DOOR SLAB CONSTRUCTED IN SUCH A WAY TO SHED & THEREFORE PREVENT WATER FROM COLLECTING/SITTING W/IN THE TOP OF THE DOOR SLAB. JOINTS SHALL BE MINIMIZED @ THE TOP OF DOOR SLAB, ANY CONSTRUCTION JOINTS SHALL BE FULLY WEATHER TIGHT.
25. GLAZING @ EXTERIOR DOORS & SIDELITES SHALL BE INSULATED TEMPERED LIGHTS.-- REFER TO ELEVATIONS & WINDOW SCHEDULE(S) FOR GLASS COLOR & SPECS.
26. SIGNAGE SHALL BE INSTALLED ON THE WALL ADJACENT TO THE LATCH SIDE OF DOORS. CENTERLINE OF SIGN SHALL BE 60"A.F.F. TO THE CENTERLINE OF THE SIGN AS INDICATED.
27. REFER TO HOME 2 SUITES BY HILTON STANDARDS MANUAL FOR ADDITIONAL INFO REGARDING DOOR & DOOR HARDWARE REQ'S.
28. ALL DOOR HARDWARE SETS LISTED ARE RECOMMENDED ITEMS. REFER TO THE STANDARDS MANUAL FOR REQ'S.
29. **ALL** DOORS MUST HAVE A 32" MIN. CLEAR WIDTH OPENING WHEN DOOR IS FULLY OPEN.
30. THRESHOLDS @ ACCESSIBLE DOORS TO MEET ALL APPROPRIATE ACCESSIBILITY REQS. ACCESSIBLE DOORS INCLUDE ALL PUBLIC ACCESS SPACES, ALL PUBLIC EXTERIOR DOORS, ALL EGRESS DOORS, & EMPLOYEE DOORS THAT ARE INDICATED W/ A CLEAR FLOOR AREA.
31. EXTERIOR DOORS MUST HAVE WEATHER-STRIPPING W/ THE APPROPRIATE TYPE OF THRESHOLD.
32. OUT-SWINGING EXTERIOR METAL DOORS MUST HAVE CLOSED TOPS.
33. ALL ROOFTOP EXITS (DOORS & HATCHES) MUST BE EQUIPPED W/ A PANIC BAR OR OTHER RELEASING DEVICE, LATCHING HARDWARE, & ALARM THAT IS MONITORED IN THE SECURITY DISPATCH OFFICE OR PBX. THESE DOORS MUST HAVE A SIGN ON THE INSIDE FACE INDICATING THE DOOR IS ALARMED & TO BE USED IN EMERGENCY SITUATIONS ONLY, IF ACCESSIBLE TO THE PUBLIC.

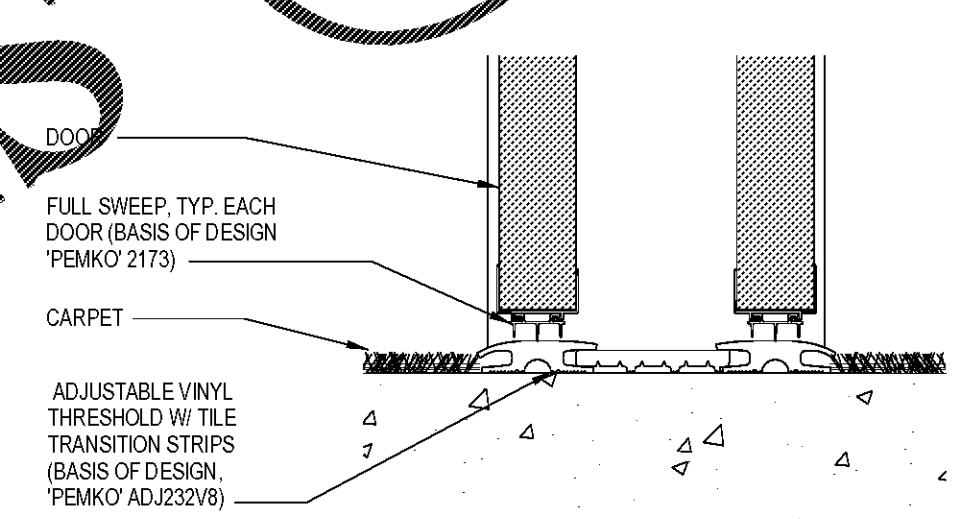

6 A10.1_Threshold Detail at Connecting Door
1/4" = 1'-0"

7 A10.1_Threshold Detail at Guestroom Entry Door
1/4" = 1'-0"

a. PROVIDE (2) DOORS FOR EACH COMMUNICATING DOOR LOCATION

b. SLIDING AUTOMATIC ENTRANCE: BASIS OF DESIGN IS BESAM UNISLIDE OC-S, OVERHEAD CONCEALED FIXED SIDELITE, NARROW STILE SINGLE SLIDE DOOR SYSTEM

c. ALUMINUM DOOR WITHIN STOREFRONT FRAME BASIS OF DESIGN IS KAWNEER 500 WIDE STILE DOORS. DOORS & FRAMES TO BE PAINTED,
ALL HARDWARE & TRIM TO BE CLEAR ANODIZED ALUMINUM OR US32D. REFER TO ELEVATIONS.

d. DOORS ON MAGNETIC HOLD OPENS TO TIED INTO FIRE ALARM SYSTEM AND TO RELEASE WHEN ALARM IS ACTUATED

e. POCKET DOOR KIT - BASIS OF DESIGN IS JOHNSON DOOR KIT MODEL 2000

f. POCKET DOOR KIT - BASIS OF DESIGN IS JOHNSON DOOR KIT MODEL 2060

g. PROVIDE (1) REMOTE READER AND (1) INTERCOM/BUZZER--REFER TO HARDWARE SET #8/A10.01 FOR MANUFACTURER AND MODEL

h. SLIDING POCKET DOORS MUST HAVE A CLEAR OPENING WIDTH OF 32" WHEN FULLY OPEN - HARDWARE MAY NOT PROTRUDE INTO CLEAR OPENING

REFER TO 1/A702

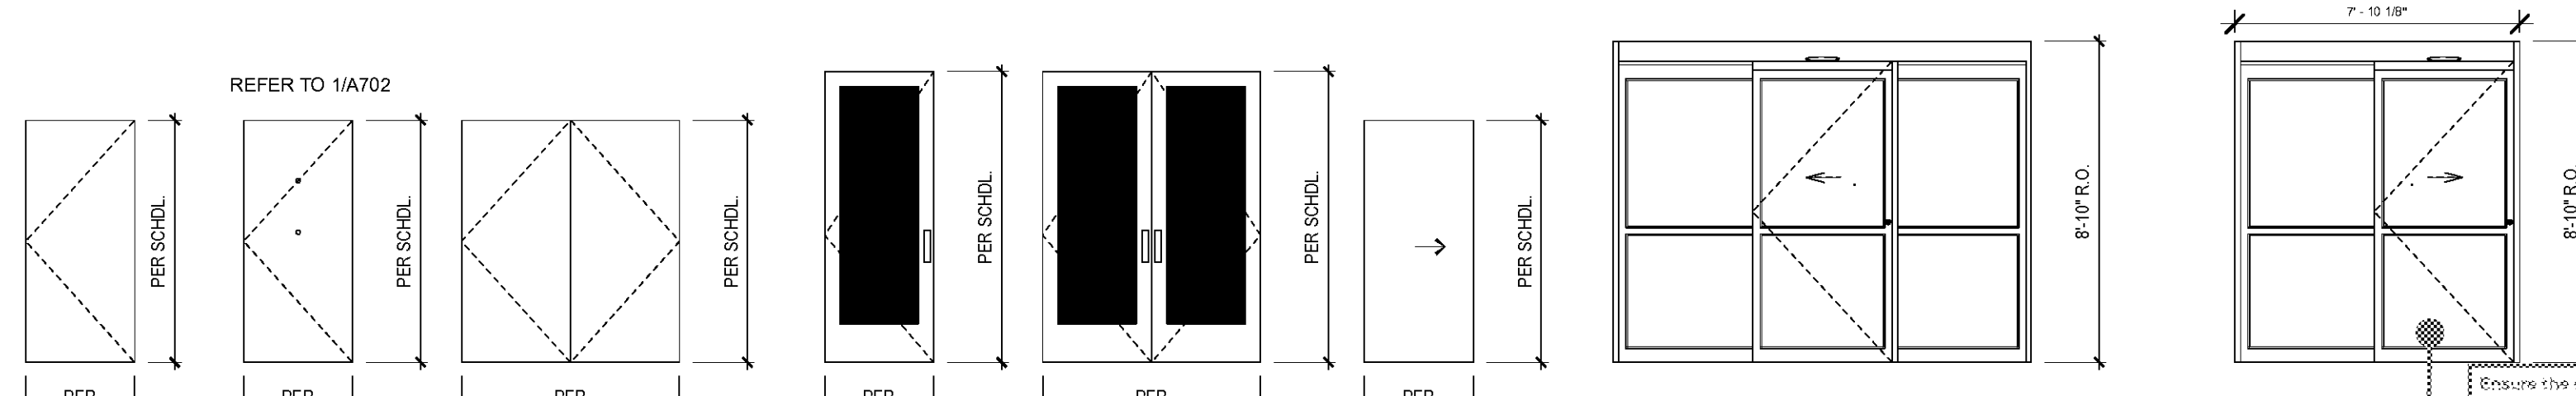

D1 FLUSH DOOR
D2 GUEST ROOM ENTRY
D3
D4 ALUM STOREFRONT
D5 ALUM STOREFRONT
D6 FLUSH POCKET
D7 ALUM SLIDING
D8 ALUM SLIDING

Ensure the automatic entry sliding door provides a minimum 4'-0" wide opening.

MISHRA ARCHITECTURE PLLC
6800 South Creek Rd. Charlotte, NC 28277
Ph:(704) 625-6554 Fax:(704) 919-5822
Email: ashish@mishraarch.com
WEB: www.mishraarch.com

CIVIL:
Choctaw Engineering, Inc.
112 Truxton Avenue
Fort Walton Beach, FL 32547
Phone: (850) 862-6211
Fax: (850) 863-8059
Email: msiner@choctaweng.com

STRUCTURAL:
Whisonant Engineering Services, LLC
122 Nut Tree Court
Lexington, SC 29074
Phone: (803) 957-4008
Email: bill@weslex.com

MEP:
Allied Consulting Engineers
2905-D Queen City Drive
Charlotte, NC 28208
Phone: (704) 399-3943
Email: dbelk@allied-engineers.com

REVISIONS		
No.	Date	Description

Information contained on this drawing and in all digital files associated is authorized for use on the project named herein only and is the property of MISHRA ARCHITECTURE PLLC and may not be reproduced in any manner without express written or verbal permission from authorized individuals. Original drawing is 24"x36" and scales are as indicated.© 2008 MISHRA ARCHITECTURE PLLC

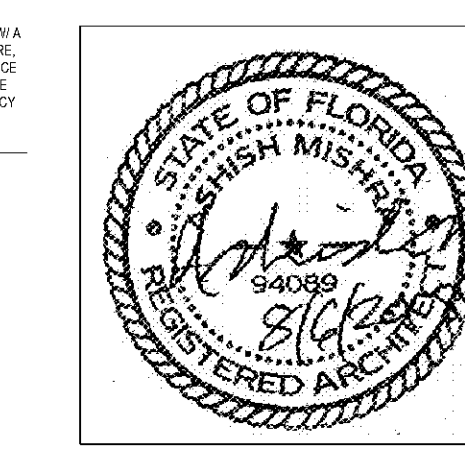

KEY PLAN

VTM Hotels, LLC

Home2Suites

2630 Wilde Lake Blvd.
Pensacola, FL 32526

Drawing Title
Door Schedule

Phase
Construction Documents

Project No.	17-101
Prepared by	Author
Checked by	Checker
Date	Aug 06,2018

Sheet No. A702

Home2Suites

Review

8/8/2018 10:33:03 PM

Order Plans @ www.LDILine.com