


REVISIONS		
No.	Date	Description

Information contained on this drawing and in all digital files associated is authorized for use on the project named herein only and is the property of MISHRA ARCHITECTURE PLLC and may not be reproduced in any manner without express written or verbal permission from authorized individuals. Original drawing is 24"x36" and scales are as indicated. © 2008 MISHRA ARCHITECTURE PLLC



KEY PLAN

VTM Hotels, LLC

Home2Suites

2630 Wilde Lake Blvd.
 Pensacola, FL 32526

Drawing Title
First Floor Firewall Plan

Phase
 Construction Documents

Project No. 17-101
 Prepared by Author
 Checked by Checker
 Date Aug 06, 2018

Sheet No.
A801

Review

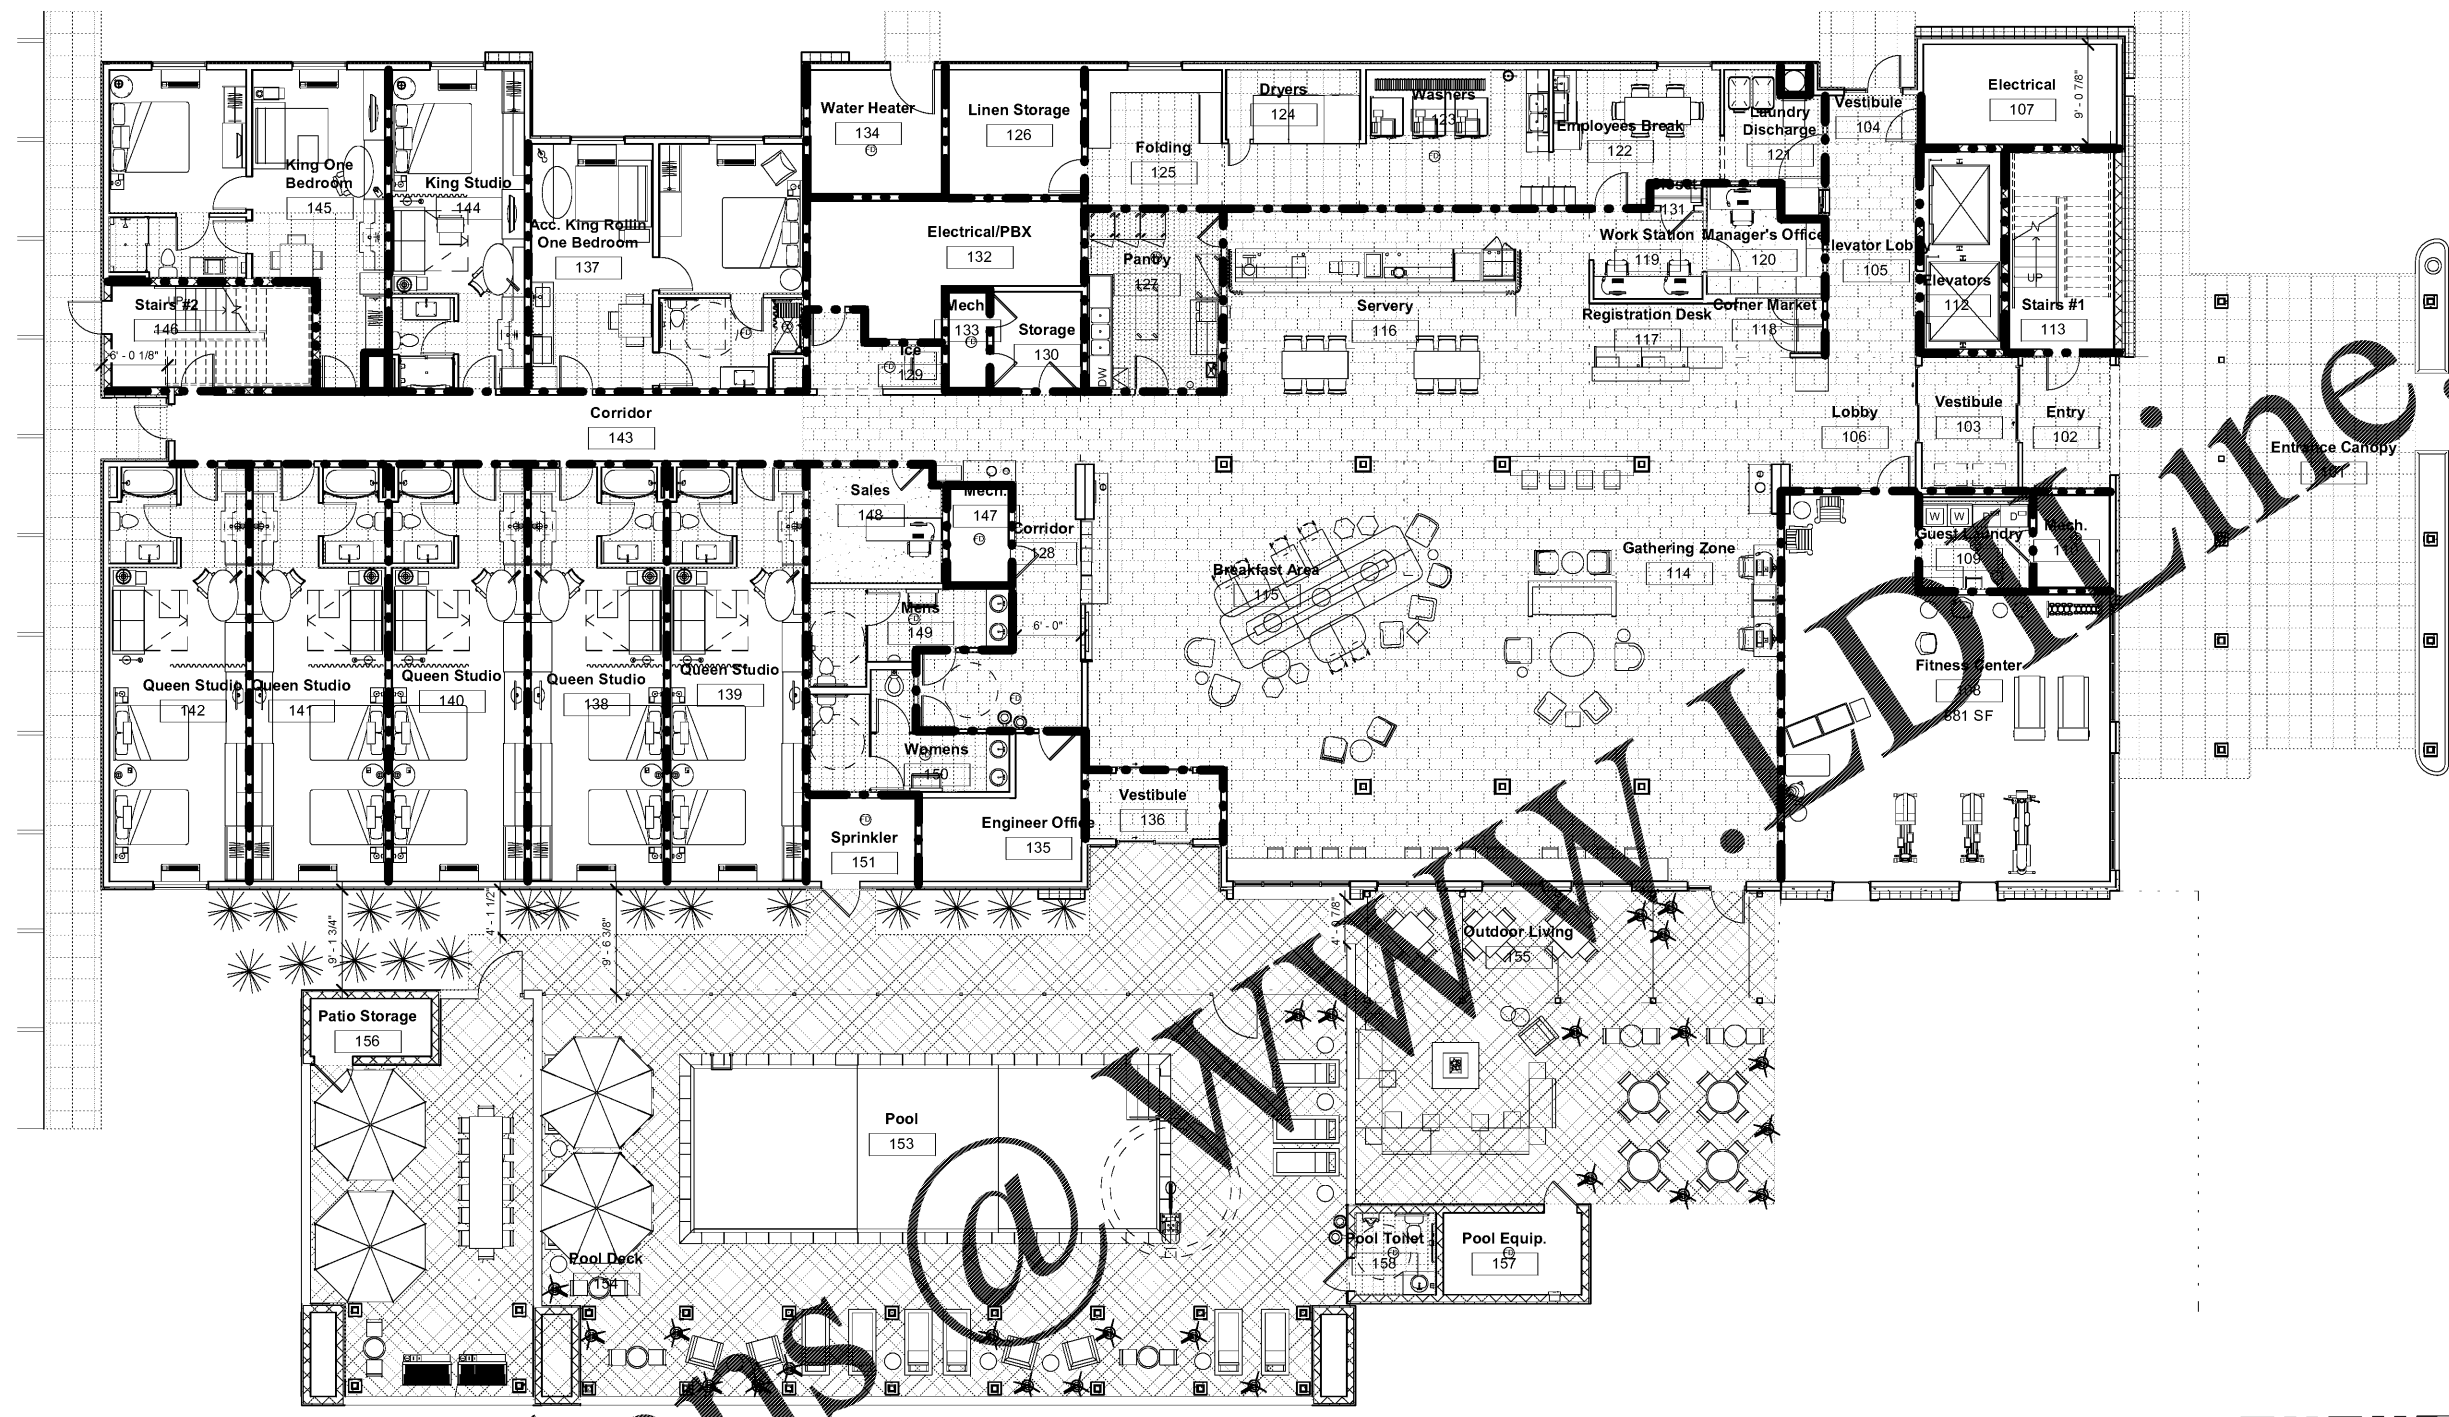


Figure 1 Firewall Plan
 1/8" = 1'-0"

OCCUPANT LOAD CALCULATIONS

Level	Space	Area Sq. Ft.	Occupancy Classification	Area/Occupant Load	Occupant Load
1ST	DINING	1,914	A-2	15	128
1ST	FITNESS/LOBBY OTHER ASSEMBLY	2,090	A-3	50	42
1ST	STORAGE/MECH.	1,098	S-2	300	4
1ST	LAUNDRY	110	F-1	100	4
1ST	OFFICE	44	B	100	4
1ST	KITCHEN	110	K	100	2
1ST	RESIDENTIAL	7,257	R	30	36
2ND	RESIDENTIAL	13,357	R	20	67
3RD	STORAGE/MECH.	1,098	S-2	300	1
3RD	STORAGE	248	S-2	300	1
4TH	RESIDENTIAL	13,357	R-1	20	67
4TH	STORAGE	248	S-2	300	1

FIRST FLOOR OCCUPANT LOAD: 220
 SECOND FLOOR OCCUPANT LOAD: 68
 THIRD FLOOR OCCUPANT LOAD: 68
 FOURTH FLOOR OCCUPANT LOAD: 68
TOTAL OCCUPANT LOAD ALL FLOORS: 424

FIRE PROTECTION FEATURES:

STRUCTURAL ELEMENT	FIRE RATING REQD.	FIRE RATING PROVIDED
- STRUCTURAL FRAMING	1 HOUR	1 HOUR (UL X526)
- BEARING WALLS EXTERIOR	1 HOUR	1 HOUR (UL U356)
- BEARING WALLS INTERIOR	1 HOUR	1 HOUR (UL U337)
- FLOOR CONSTRUCTION	1 HOUR	1 HOUR (ER-3433, ESR 1153)
- ROOF CONSTRUCTION	1 HOUR	1 HOUR (P522)

FIRE BARRIER	FIRE RATING REQD.	FIRE RATING PROVIDED
- STAIR WALLS	2 HOUR	2 HOURS (UL U914, U906, U902)
- ELEVATOR SHAFT	2 HOUR	2 HOURS (UL U914, U906, U902)

FIRE PARTITION	FIRE RATING REQD.	FIRE RATING PROVIDED
- CORRIDOR	1 HOUR	1 HOUR (UL U337)
- GUESTROOM SEPARATION	1 HOUR	1 HOUR (UL U311)

FIRE WALL LEGEND

	INDICATES ONE HOUR FIRE RATED WALL CONSTRUCTION AS PER UL STANDARDS
	INDICATES TWO HOUR FIRE RATED WALL CONSTRUCTION AS PER UL STANDARDS

NOTE:
 1. ALL FIRE-RATED WALLS TO EXTEND TO STRUCTURE ABOVE AS PER FIRE CODE.
 ALL OPENINGS NEED TO MEET REQUIREMENTS.
 2. ALL TOILET EXHAUST CHASE TO BE TWO-HOUR FIRE RATED WITH FIRE DAMPER AS PER CODE.
 3. ALL MECHANICAL ROOMS, ELEVATOR EQUIPMENT ROOM TO BE TWO-HOUR FIRE RATED AS PER CODE.