

THIS DRAWING IS THE PROPERTY OF Dickinson Architects, P.C. and shall remain the property of Dickinson Architects, P.C. It is to be used only for the project and site identified on the drawing. Any other use, reproduction, or distribution of this drawing without the written consent of Dickinson Architects, P.C. is strictly prohibited.

PROJECT TITLE:
**MURPHEY
MIDDLE
SCHOOL P.E.
BUILDING
PROJECT #
B-17-005-3756.1**


REVISIONS			
REV #	DATE	APPRD BY	REVISION
1	11/02/18	MAP	STATE FINAL
2	11/20/18	MAP	ISSUE FOR BID




DA PROJECT NUMBER & NAME:
1707.1

DRAWING TITLE:
**ELECTRICAL
DETAILS**

DRAWING NO:
E602

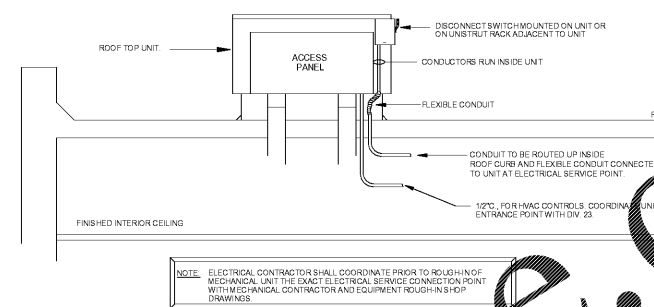


7 DETAIL - ROOF TOP UNIT MOUNTED DISCONNECT
E602 SCA: 1"=10'-0"




8 QUADRUPLER RECEPTACLE WITH USB PORTS
E602 SCA: 1"=10'-0"


FOR 120/208V PANELS:




FOR 277/480V PANELS:




FOR TRANSFORMERS:




FOR DISCONNECTS:




9 EQUIPMENT IDENTIFICATION TAG DETAIL
E602 SCA: 1"=10'-0"




10 DETAIL - CABLE CONNECTION TO GROUND ROD
E602 SCA: 1"=10'-0"




11 DETAIL - CABLE CONNECTION TO STEEL BEAM
E602 SCA: 1"=10'-0"

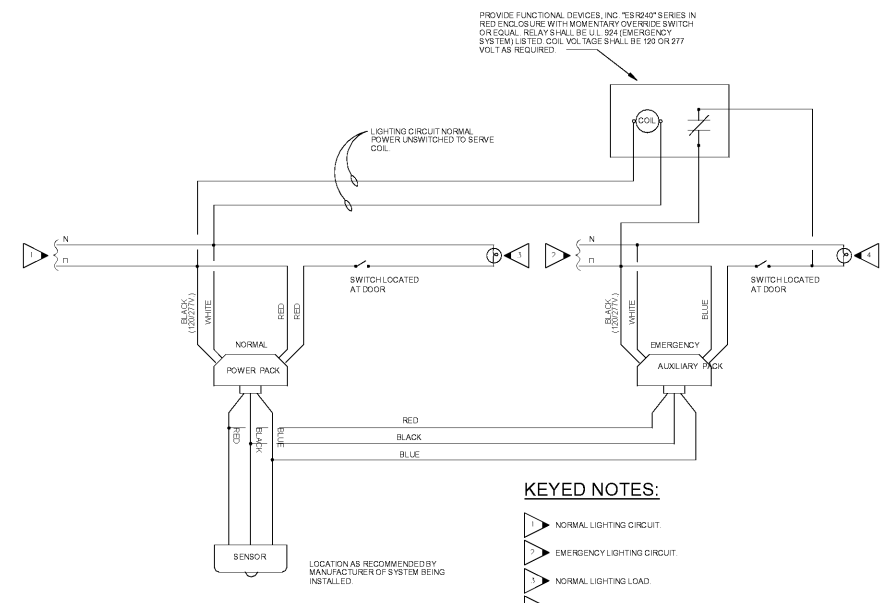


4 OCCUPANCY SENSOR - EMERGENCY RELAY WIRING DIAGRAM
E602 SCA: 1"=10'-0"

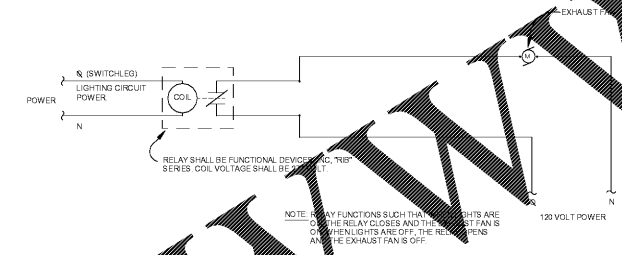


5 EXHAUST FAN RELAY WIRING DIAGRAM
E602 SCA: 1"=10'-0"

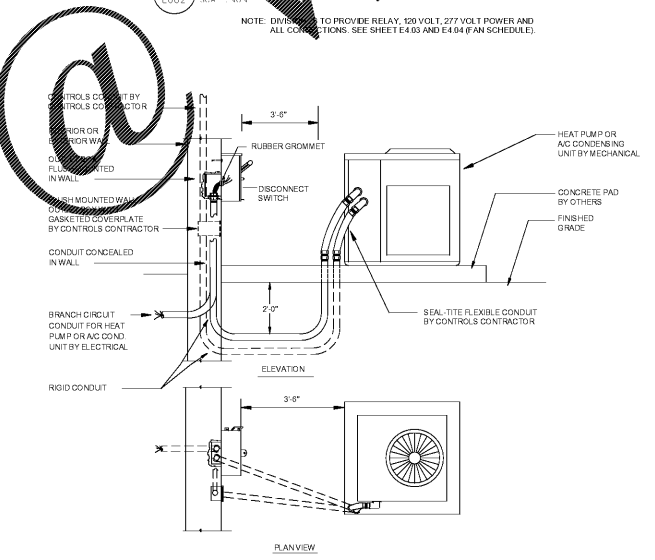


6 DETAIL - DISCONNECT SWITCH MOUNTING AT EXTERIOR H.V.A.C. UNIT
E602 SCA: 1"=10'-0"

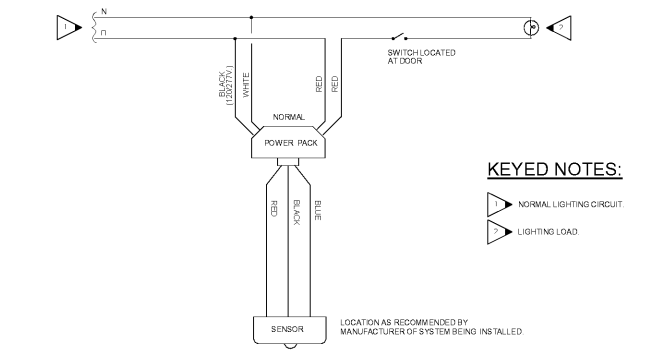

1 OCCUPANCY SENSOR - SWITCHING SCHEMATIC WIRING DIAGRAM
E602 SCA: 1"=10'-0"

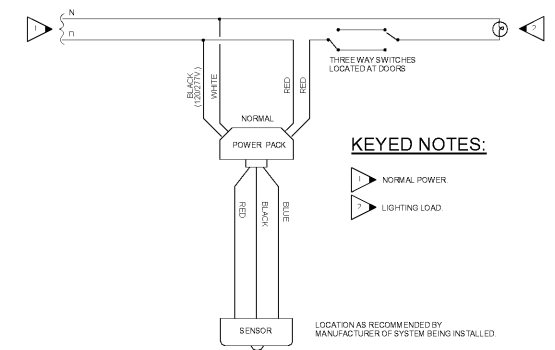

2 OCCUPANCY SENSOR - THREE-WAY SWITCHING SCHEMATIC WIRING DIAGRAM
E602 SCA: 1"=10'-0"

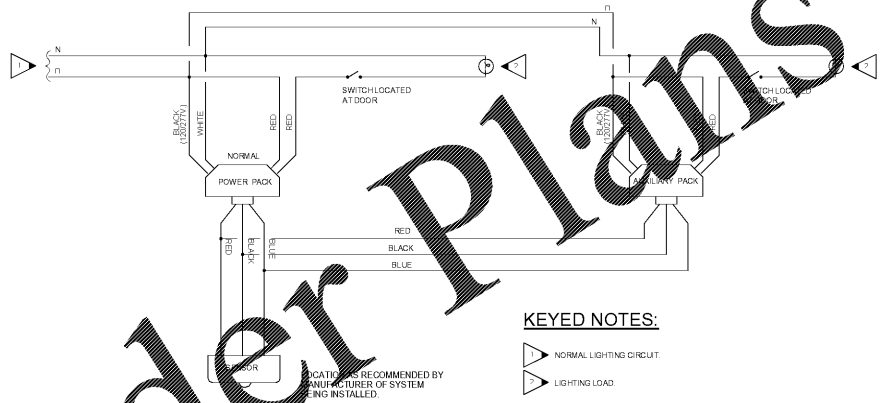

3 OCCUPANCY SENSOR - MULTIPLE SWITCHES SCHEMATIC WIRING DIAGRAM
E602 SCA: 1"=10'-0"

Order Plans

WWW.LDOnline.com