


* ALL RISER PIPES & FITTINGS ARE TO BE COATED WITH A BITUMINOUS COATING AND WRAPPED W/3M TAPE FOR CORROSION PROTECTION---SEE NOTES SHEET RT-T4.0
 ** CONFIRM BURIAL DEPTH WITH RACETRAC PROJECT MANAGER

A LONGITUDINAL TANK SECTION
 T1.2 20,000 GALLON TANK
 3/8" = 1'-0"

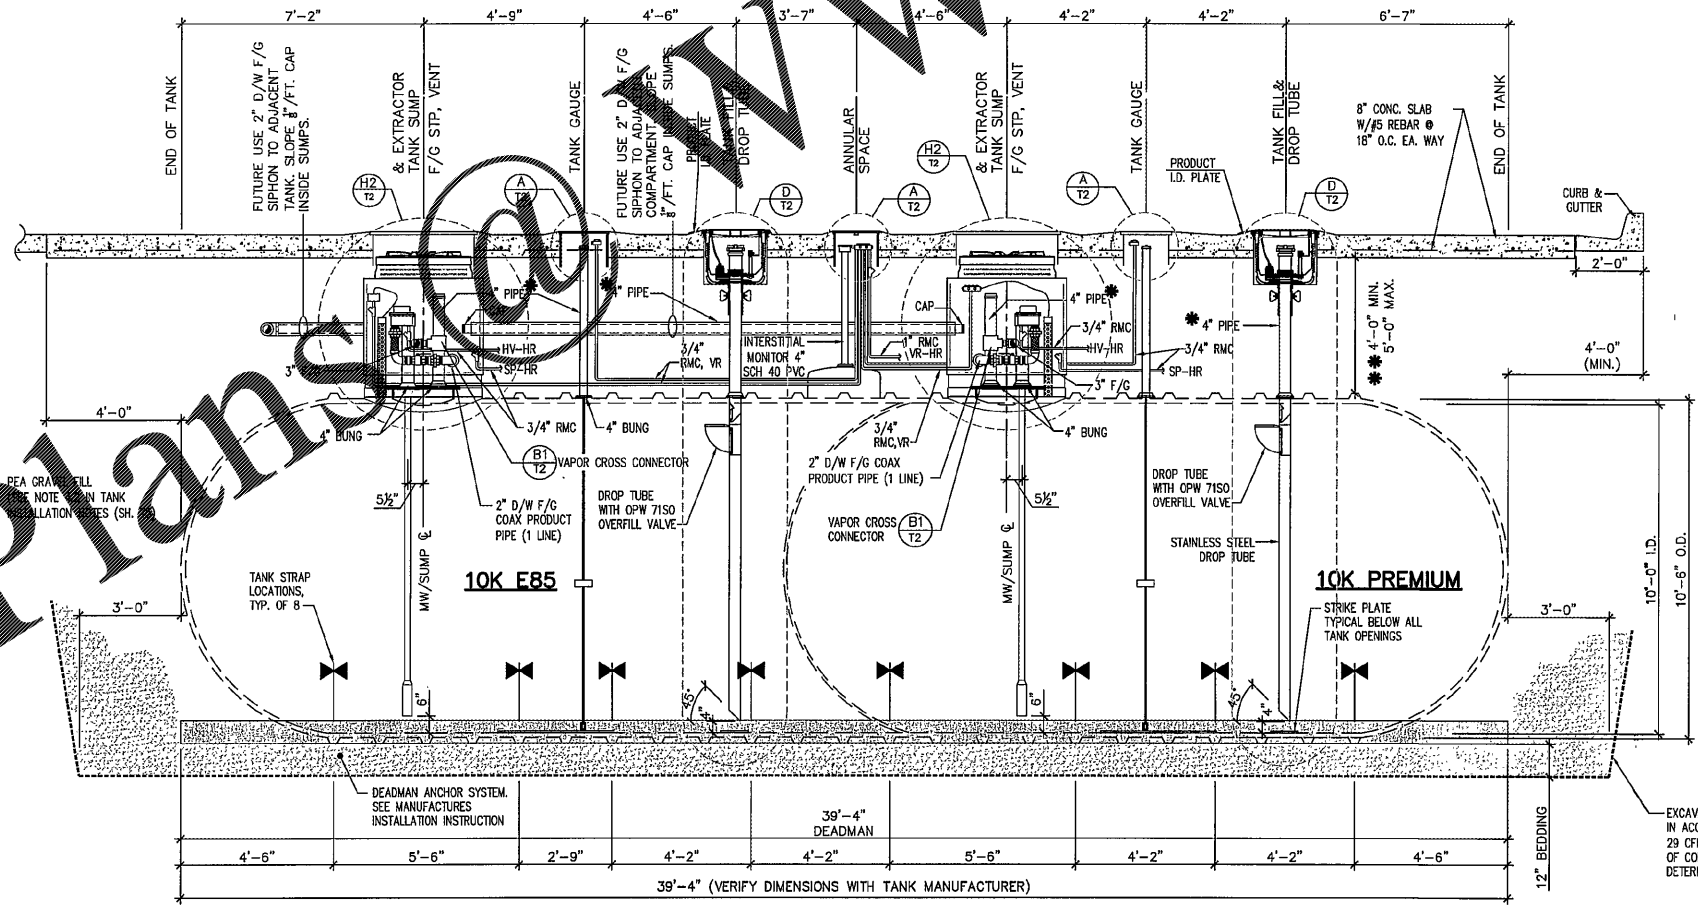

* ALL RISER PIPES & FITTINGS ARE TO BE COATED WITH A BITUMINOUS COATING AND WRAPPED W/3M TAPE FOR CORROSION PROTECTION---SEE NOTES SHEET RT-T4.0
 ** CONFIRM BURIAL DEPTH WITH RACETRAC PROJECT MANAGER

B LONGITUDINAL TANK SECTION
 T1.2 20,000 GALLON TANK
 3/8" = 1'-0"

EXCAVATION TO BE BENCHMARKED IN ACCORDANCE WITH OSHA 29 CFR 1926-950(P) METHOD OF COMPLIANCE TO BE DETERMINED BY CONTRACTOR

EXCAVATION TO BE BENCHMARKED IN ACCORDANCE WITH OSHA 29 CFR 1926-950(P) METHOD OF COMPLIANCE TO BE DETERMINED BY CONTRACTOR

ISSUE/REVISION RECORD	DESCRIPTION
DATE	

Racetrac
 RACETRAC PETROLEUM, INC.
 3225 CUMBERLAND BOULEVARD
 SUITE 100
 ATLANTA, GEORGIA 30339
 (770) 451-7600

PROJECT NAME
EAST MAIN ST.

CARTERVILLE
 GEORGIA
 1325 E. MAIN ST.

RACETRAC PROJECT NUMBER
1310

PLAN SERIES
2011 BR-RH-M90 0801

PLAN MODIFICATION NOTICE
 NO MODIFICATIONS APPLIED
 MODIFICATIONS APPLY

STANDARD PLAN BULLETINS (SPB) MODIFY THE PLAN SERIES SET NOTED ABOVE. THE SPB GIVEN ABOVE REPRESENTS THE LATEST MODIFICATION INCORPORATED TO THIS PLAN SERIES SET. CONTACT RACETRAC ENGINEERING AND CONSTRUCTION FOR ALL BULLETINS.

PROFESSIONAL SEAL



PROJECT NUMBER
18154

SHEET TITLE
TANK DETAILS

SHEET NUMBER
RT-T1.2