

WASTE AND VENT (ISOMETRIC RISER) NTS 4


1. PLUMBING CONTRACTOR SHALL FIELD VERIFY EXACT LOCATION OF THE SIZE & DEPTH OF THE EXISTING SANITARY WASTE PIPING.
2. REFER TO SHEET P1 - PLUMBING SCHEDULE FOR LINE SIZES NOT SHOWN ON PLAN.
3. REFER TO RISER DIAGRAM FOR ALL WASTE AND VENT SIZES NOT SHOWN.
4. ALL VENTS, VTRS, WCO'S, FCO'S, ETC. MAY NOT BE SHOWN ON PLAN. REFER TO PLUMBING RISER DIAGRAM FOR VERIFICATION.
5. INSTALL VTR AT LOCATIONS AS SHOWN ON PLUMBING PLAN AND PLUMBING RISER DIAGRAM. ALL OTHER VENTS GO TO VENT LINE AS SHOWN.
6. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE THIS DATA ON THE LOCATION OF ALL PLUMBING ROUGH-INS WITH INFORMATION PROVIDED ON THE ARCHITECTURAL AND THE STRUCTURAL DRAWINGS AND THE EQUIPMENT ACTUALLY SUPPLIED AND TO CONFIRM THE CORRECTNESS OF ANY DIMENSIONS INDICATED HEREIN.

1. PROVIDE WITH TRAP PRIMER AND CONNECT TO NEAREST CW PIPING.
2. PROVIDE WASTE LINES FROM BEVERAGE UNIT/ICE BIN TO FLOOR SINK, PROVIDE AIR GAP PER LOCAL CODE.
3. VERIFY ROUGH-IN IN HEIGHTS WITH FIXTURE PROVIDED. RIM SHALL BE NO HIGHER THAN 17" AFF AND FLUSH VALVE HANDLE SHALL BE 44" AFF MAX. DIMENSION.
4. CONNECT TO EXISTING VENT UP THROUGH ROOF. SEE RISER FOR ALL VENT AND PIPE SIZING. FIELD COORDINATE FINAL LOCATIONS.
5. PROVIDE 1" COPPER CONDENSATE DRAIN LINE FROM THE EVAPORATOR COILS IN THE WALK-IN COOLER AND FREEZER. PROVIDE P-TRAPS AS CONDENSATE DRAIN LINE AT EVAPORATOR COILS. ROUTE TO FLOOR DRAINS AS SHOWN. CONDENSATE PIPING SHALL BE INSTALLED AS HIGH AS POSSIBLE IN WALK-IN COOLER AND FREEZER TO ALLOW FOR SHELVING INSTALLATION. 1-1/2" FOR INDIRECT WASTE REQUIRED.
6. DO NOT ROUTE PIPING OVER ELECTRICAL PANEL.
7. PROVIDE CONDENSATE LINE AND DRAIN LINE FROM DISHWASHER TO FLOOR SINK, PROVIDE AIR GAP PER LOCAL CODE.
8. ROUTE FULL SIZE CONDENSATE DRAIN LINE FROM WATER HEATER TO FLOOR DRAIN. TERMINATE WITH AIR GAP. REFER TO WATER HEATER INSTALLATION MANUAL FOR ADDITIONAL INFO.

EQUIP #	EQUIPMENT ITEM	TYPE	ELEVATION	REMARKS
FS 1	FLOOR SINK			--
FS 2	FLOOR SINK			--
FD 1	FLOOR DRAIN			--
HD 1	HUB DRAIN			--
WH 1	WATER HEATER	CW		--
WH 2	WATER HEATER	G		ABOVE
WC 1	WATER CLOSET FLUSH TANK	CW	+10' A.F.F.	--
L 1	LAVATORY	TW	+20' A.F.F.	--
L 2	LAVATORY WASTE LINE	W	+16-1/2' A.F.F.	--
S 1	HAND SINK	TW	+18' A.F.F.	1/2" OF LAV @ +2'-8" A.F.F.
S 2	SINK FAUCET	CW/HW	+38' A.F.F.	--
S 3	3-COMPARTMENT SINK FAUCET	CW/HW	+38' A.F.F.	--
TRF	TRIP FRYER		+12' A.F.F.	--
POV	PIZZA OVEN (TRIPLE DECK)	G	+10' A.F.F.	--
EVAP	EVAPORATOR	FW	+38' A.F.F.	VALVE BELOW COUNTER
S50	FILTER SYSTEM	CW	+94' A.F.F.	INLET TO & OUTLET FROM FILTER
ICE	ICE MACHINE	FW	+60' A.F.F.	INLINE FILTER
DISP	DRINK DISPENSER	FW		VIA SYRUP BUNDLE <S22>
S90	COFFEE BREWER	FW	+38' A.F.F.	VALVE BELOW COUNTER
S92	ICE TEA BREWER	FW	+38' A.F.F.	VALVE BELOW COUNTER
S93	HOT HOLDING CABINET	FW	+78' A.F.F.	

PLUMBING ROUGH-IN SCHEDULE NTS 5

IMPORTANT NOTE:
PLUMBING CONTRACTOR SHALL WRAP THE WALK-IN FREEZER DRAIN PIPING WITH HEAT TRACE TAPE, INSULATE WITH 3/4" ARMAFLEX INSULATION, AND PROVIDE PVC FIELD JACKET FOR ALL CONDENSATE PIPE IN THE FREEZER.

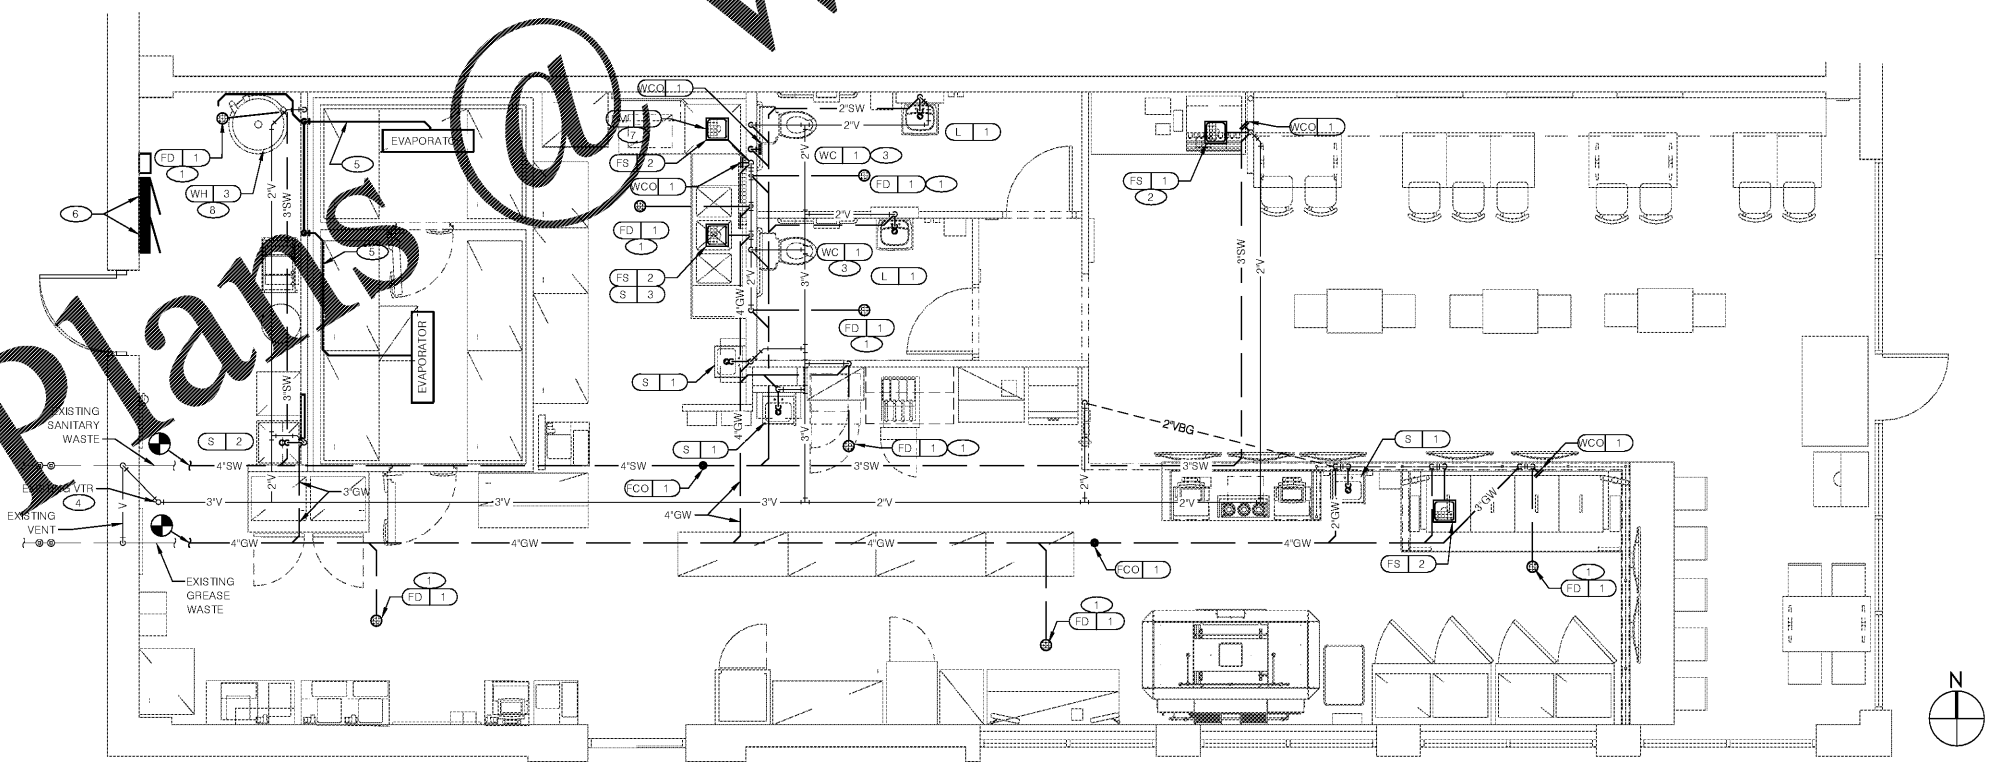

WASTE AND VENT PLAN 1/4" = 1'-0" 1

Order Plans @ [www.ArchLine.com](http://www.WWW.ArchLine.com)


08/10/18
1845
DRAWN: BH, MJ, SO
CHECKED: AR, CF
ACC #: 1820228

WASTE AND VENT PLAN



PIZZA HUT #1845
5229 US HWY 231
WETUMPKA, ALABAMA

ACERTUS CONSULTING GROUP, LLC
14817 West 55th Street • Lenexa, Kansas 66215
P 913.322.5150 • F 913.322.5155
www.AcertusGroup.com



SHEET NUMBER
P2.0

REVISIONS: