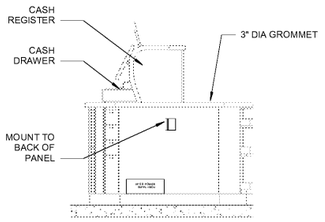

3 CASHWRAP SECTION
1/2" = 1'-0"

PROVIDE RECESSED ENTERTAINMENT BOX, LEVITON MODEL #001-47617-REB WITH LOW PROFILE COVER # 003-47617-LPF. E.C. SHALL PROVIDE TWO (2) NEMA 5-20R RECEPTACLES IN BOX FOR NEW TV MONITORS. (1) 1" EMPTY CONDUIT WITH PULL LINE FROM EACH BOX TO TELE/DATA CLOSET FOR COMMUNICATION REQUIREMENTS. VERIFY LOCATION, MOUNTING HEIGHTS AND REQUIREMENTS PRIOR TO ROUGH-IN.

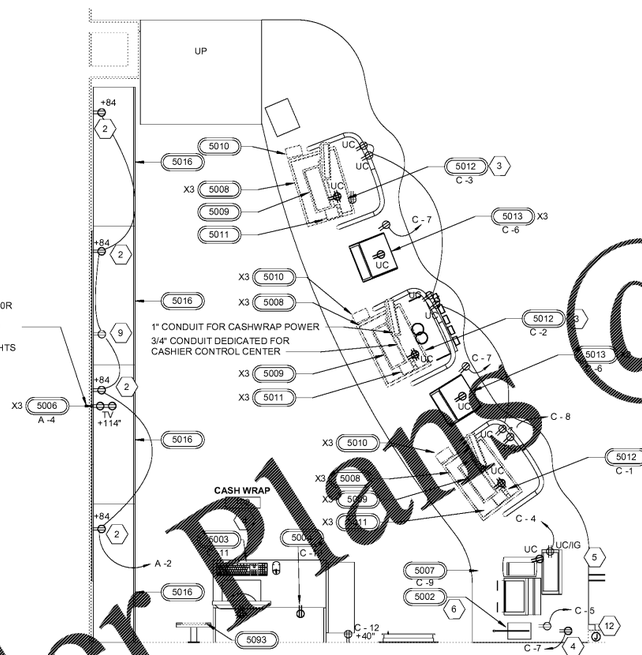

1 ENLARGED CASH WRAP POWER PLAN
1/2" = 1'-0"

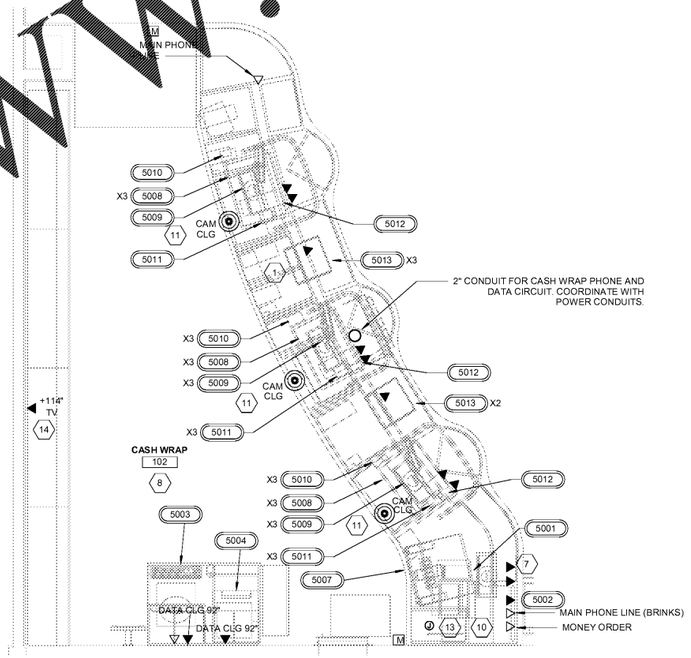

2 ENLARGED CASH WRAP LOW VOLTAGE PLAN
1/2" = 1'-0"

GENERAL NOTES

1. ALL CONVENIENCE OUTLETS SHALL BE MOUNTED AT 18" AFF UNLESS NOTED OTHERWISE.
2. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY ALL EQUIPMENT CONNECTION TYPES AND PROVIDE APPROPRIATE PLUG AND RECEPTACLE CONTRACTOR IS RESPONSIBLE FOR MAKING ALL FINAL CONNECTIONS TO EQUIPMENT PROVIDED BY OTHERS.
3. TWO CATS CABLE WITH RJ-45 CONNECTORS IS TO BE PULLED FROM THE ATM TO THE PHONE BOARD. ALL CAT5 CABLES ARE TO BE CLEARLY LABELED (NOT HAND WRITTEN) AT EACH END.

SHEET KEYNOTES

1	CASHIER CONTROL CENTER, CC-01ALM. SEE DETAIL ON E500.
2	PROVIDE DUPLEX RECEPTACLE FOR FIXTURE LIGHTING.
3	POS, UPS, DUPLEX ISOLATED GROUND RECEPTACLE.
4	MONEY ORDER MACHINE, DUPLEX I.G. RECEPTACLE.
5	BRINKS SAFE, DUPLEX I.G. RECEPTACLE.
6	INTERCOM, DUPLEX RECEPTACLE.
7	ELECTRICAL SUB CONTRACTOR TO INSTALL 100 FEET OF LOTTO CABLE, PROVIDED BY RACETRAC WITH MALE DB9 CONNECTORS, FROM LOTTERY MAIN CONSOLE TO SCANNER NEAR ATM.
8	COORDINATE MOUNTING HEIGHT OF ALL POWER AND DATA DEVICES WITH INTERIOR ELEVATIONS PRIOR TO ROUGH-IN.
9	PROVIDE DUPLEX RECEPTACLE FOR SNUFF COOLER.
10	ROUTE A 1" CONDUIT OVERHEAD WITH (1) 3-PAIR AND (1) 2-PAIR WIRING, FROM TELE/DATA CLOSET TO INTERCOM (REFER TO DETAIL ON SHEET E601). THESE CABLES ARE TO BE HARD-WIRED DIRECTLY INTO THE INTERCOM CONTROL BOX.
11	3MP-INDOOR VARIFOCAL-FD-3400.
12	PROVIDE SINGLE GANG JUNCTION BOX. ROUTE (1) 1/2" CONDUIT WITH PULL STRING TO ABOVE CEILING FOR FUTURE POWER.
13	PROVIDE SINGLE GANG JUNCTION BOX. ROUTE (1) 1/2" CONDUIT WITH PULL STRING TO ABOVE CEILING FOR FUTURE COMMUNICATIONS.
14	E.C. SHALL PROVIDE (1) 1" EMPTY CONDUIT WITH PULL LINE TO TELE/DATA CLOSET FOR COMMUNICATION REQUIREMENTS. VERIFY LOCATION AND REQUIREMENT PRIOR TO ROUGH-IN.

RaceTrac.
COPYRIGHT NOTICE
THESE PLANS ARE SUBJECT TO FEDERAL COPYRIGHT LAWS: ANY USE OF SAME WITHOUT THE EXPRESSED WRITTEN PERMISSION OF RACETRAC PETROLEUM, INC. IS PROHIBITED. 2018 RACETRAC PETROLEUM INC.

DESIGN PROFESSIONALS
HILLFOLEYROSS & ASSOCIATES
ARCHITECTURE
ENGINEERING
3680 Pleasant Hill Road
Suite 200
Duluth, Georgia 30096
p 770.622.9858
f 770.622.9535
www.hillfoleyross.com

© Copyright (as dated below)
This drawing and all reproductions thereof are the property of Hill Foley Ross & Associates, LLC (HFR). It is intended for the sole use of the project named herein. Reproduction without the written consent of HFR is unlawful. All copies are to be returned to HFR upon project completion.

ISSUE/REVISION RECORD

DATE	DESCRIPTION
2018.08.22	PERMIT ISSUE

RaceTrac.
RACETRAC PETROLEUM, INC.
200 GALLERIA PKWY SE
SUITE 900
ATLANTA, GEORGIA 30339
(770) 431-7600

PROJECT NAME

GRIFFIN

GRIFFIN
GEORGIA
1638 US HWY 41
GRIFFIN, GA 30223

RACETRAC PROJECT NUMBER

#1242

PROTOTYPE SERIES 5.5K 2.0

2018 LH MO

PLAN MODIFICATION NOTICE

SPB NO. DATE

STANDARD PLAN BULLETINS (SPB) MODIFY THE PROTOTYPE SERIES SET NOTED ABOVE. THE LISTED SPB REPRESENTS THE LATEST MODIFICATION INCORPORATED TO THIS PROTOTYPE SERIES SET AT ORIGINAL RELEASE. THE ISSUE/REVISION RECORD COLUMN ABOVE LISTS ANY REVISIONS OR SPB INCORPORATED IN THIS SET AFTER THE ORIGINAL RELEASE. CONTACT RACETRAC ENGINEERING AND CONSTRUCTION FOR ANY SUBSEQUENT BULLETINS NOT INCORPORATED HEREIN.

PROFESSIONAL SEAL

GEORGIA REGISTERED PROFESSIONAL ENGINEER WILLIAM S. GADDY, JR. No. 16270
08/22/18

PROJECT NUMBER

17.721.00

SHEET TITLE

ENLARGED POWER PLANS

SHEET NUMBER

E111

ISSUED FOR PERMIT

Order Plans @ WWW.LDILine.com