

DOOR SCHEDULE

DOOR #	DOOR LOCATION	DOOR SIZE	DOOR ELEVATION 2/A401	MATERIAL		FRAME DETAILS		HARDWARE GROUP #	DOOR SIGNAGE	NOTES
				DOOR	FRAME	HEAD	JAMB			
113A	OPEN OFFICE ENTRY	3'-0" X 8'-0"	A	ALUM./GL	ALUM.	9/A402	10/A402	1		
113B	OPEN OFFICE	3'-0" X 7'-0" X 1 3/4"	A	ALUM./GL	ALUM.	7/A402	8/A402	2		
113C	OPEN OFFICE	6'-0" X 7'-0" X 1 3/4"	C	WOOD	H.M.	5/A401	5/A401	3		
114	CONFERENCE ROOM #1	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
115	PRIVATE OFFICE #1	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
116	PRIVATE OFFICE #2	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
117	PRIVATE OFFICE #3	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
118	PRIVATE OFFICE #4	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
119	PRIVATE OFFICE #5	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
120	CONFERENCE ROOM #2	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
121	PRIVATE OFFICE #6	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
122	PRIVATE OFFICE #7	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
123	PRIVATE OFFICE #8	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
124	PRIVATE OFFICE #9	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.
125	PRIVATE OFFICE #10	3'-0" X 7'-0" X 1 3/4"	B	WOOD	H.M.	5/A401	5/A401	4		FRAME FINISH TO BE CLEAR ANODIZED.

*ALL DOORS NOT LISTED ARE EXISTING TO REMAIN.

HARDWARE SCHEDULE

GROUP 1 (DOOR 113A)
 2 PIVOT SET 147 (626 RF) RIXSON
 2 PIVOT M19 (626 RF) RIXSON
 1 HEADER BOLT 4016 ACTIVE LEAF (AD) ADAMS RITE
 1 THRESHOLD BOLT 1015-18-IB ACTIVE LEAF (603 AD) ADAMS RITE
 1 HEADER BOLT 4085-IB INACTIVE LEAF (603 AD) ADAMS RITE
 1 MORTISE DEADLOCK M518505-050 (628 AD) ADAMS RITE
 1 STATUS INDICATOR 4089 (130 AD) ADAMS RITE
 1 CYLINDER, THUMBTURN 4066-01 (130 AD) ADAMS RITE
 1 CYLINDER HOUSING, RIM, K680 X AR CAM (626 YA) YALE
 2 PULL RM7210 (US32D/630), 11" CTC, ROCKWOOD
 2 PUSH RM7212 (US32D/630), 32" CTC, ROCKWOOD
 1 THRESHOLD 171A PEMKO
 1 SET WEATHER STRIP BY DOOR MANUFACTURER
 2 SWEEP BY DOOR MANUFACTURER
 1 ASTRA GAL SET BY DOOR MANUFACTURER
 1 DETEX EAS 500 BATTERY POWERED DOOR ALARM
 1 CYLINDER HOUSING, RIM, K680 1 3/8 (626) YALE
 1 CYLINDER HOUSING, RIM, K680 1 3/8 (626) YALE
 1 ADA PUSH BUTTON (GC TO COORDINATE POWER)
 1 HES 5000 ELECTRIC STRIKE
 SECURITRON AS100 SENSOR

GROUP 3 (DOOR 113C)
 6 HINGES TA2314 4 1/2 X 4 1/2 NRP (US32D) MCKINNEY
 1 STOREROOM LOCKSET B AU 5405 (626) YALE
 1 PAIR AUTO FLUSH BOLTS 2842
 2672 DOOR COORDINATOR
 2 8501 NORTON CLOSERS

GROUP 4 (DOORS 114-125)
 3 HINGES TA2314 4 1/2 X 4 1/2 (US26D) MCKINNEY
 1 AB ENTRY LOCKSET (626)
 1 CLOSER 8501 (689) NORTON
 1 DOOR STOP 471 (US26D) ROCKWELL
 3 SILENCER 608 ROCKWELL

GROUP 2 (DOOR 113B)
 1 PIVOT SET 147 (626 RF) RIXSON
 1 PIVOT M19 (626 RF) RIXSON
 1 CYLINDER, THUMBTURN 4066-01 (130 AD) ADAMS RITE
 1 CYLINDER HOUSING, RIM, K680 X AR CAM (626 YA) YALE
 1 CYLINDER HOUSING, RIM, K680 1 3/8 (626) YALE
 1 PULL RM7210 (US32D/630), 11" CTC, ROCKWOOD
 1 PUSH RM7212 (US32D/630), 32" CTC, ROCKWOOD
 1 THRESHOLD 171A PEMKO
 1 ELECTRIC CARD KEY READER (LP TO SUPPLY & INSTALL)

NOTE:
 THE STUDS NOTED ON THE PARTITION TYPES ARE THE MINIMUM. GC TO VERIFY AND PROVIDE THE PROPER METAL STUDS REQUIRED FOR ACTUAL VERTICAL SPAN.


AT EXPOSED METAL DECK EXTEND GYPSUM BOARD & METAL STUDS TO 1/2" BELOW ROOF DECK. AT ACOUSTIC TILE CEILING EXTEND GYPSUM BOARD & METAL STUDS TO 4" ABOVE CEILING.

ACOUSTICAL LAY-IN CEILING, WHERE SPECIFIED, SEE REFLECTED CEILING PLAN.

1/2" GYPSUM BOARD
 1625162-33 @ 16" O.C.

EXISTING EXTERIOR WALL
 BASE AS SCHEDULED

FLOOR FINISH AS SCHEDULED



NOTE:
 PROVIDE MOISTURE RESISTANT GYP. BD. AT RESTROOMS, EWC, BREAKROOM SINK WALL, AND CLEANING CLOSET.

WALL TO EXTEND TO 12'-0" A.F.F.
 A.C.T.
 2" MOISTURE RESISTANT GYP. BOARD
 3625162-33 @ 16" O.C.
 PROVIDE 1/2" SOUND ATTENUATION BATT INSULATION @ 16" A.F.F. STC = 50 MIN.
 BASE AS SCHEDULED
 FLOOR FINISH AS SCHEDULED

CONTINUOUS BOTTOM TRACK SECURED TO SLAB W/ 145 X 1/2" POWDER ACTUATED FASTENERS @ 16" O.C.

CONTINUOUS BOTTOM TRACK SECURED TO SLAB W/ 145 X 1/2" POWDER ACTUATED FASTENERS @ 16" O.C.

CONTINUOUS BOTTOM TRACK SECURED TO SLAB W/ 145 X 1/2" POWDER ACTUATED FASTENERS @ 16" O.C.

PAINTING GENERAL NOTES

- ALL BUILDING COLUMNS TO BE PAINTED PT-4 TO 13'-0" A.F.F. AND PT-2 FROM 13'-0" A.F.F. TO UNDERSIDE OF ROOF DECK.
- ALL MECHANICAL ELECTRICAL CONDUIT, SUPPORTS, OVERHEAD EQUIPMENT, AND ANY MISCELLANEOUS DEVICES AT THE UNDERSIDE OF ROOF DECK OR MOUNTED ABOVE 13'-0" A.F.F. TO BE PAINTED PT-2.
- PAINT INTERIOR BOLLARDS PT-1.
- ALL HOLLOW METAL DOORS AND FRAMES TO BE EPOXY AND PAINTED TO MATCH ADJACENT WALL.
- ALL CONDUIT DROPS SHALL BE PAINTED TO MATCH ADJACENT WALL.

HARDWARE GENERAL NOTES

- DOOR SIGNAGE PER SCHEDULE TO BE PROVIDED BY HARDWARE SUPPLIER INSTALLED BY GENERAL CONTRACTOR. ROCKWOOD BFM SERIES. BACKGROUND COLOR = BLACK 101; BORDER, LETTERING & BRAILLE = WHITE 949.
- ALL DOOR HANDLES TO BE LEVER TYPE PER A.D.A. REQUIREMENTS.
- ALL LOCKSETS, PADLOCKS, CYLINDERS, SLIDING ENTRANCE AND EXIT DOORS WILL BE SHIPPED WITH YALE "SPIC" CONSTRUCTION CORES FOR USE DURING THE CONSTRUCTION PHASE.
- THE OFFICE DEPOT OFFICE MAX STORE MANAGER IS RESPONSIBLE FOR INSTALLING THE NEW CORES PROVIDED BY OFFICE DEPOT LOSS PREVENTION.

STUD LIMITING HEIGHT NOTES

- CLEAR HEIGHT IS THE DISTANCE FROM FLOOR TO TOP OF WALL OR TO BRACE LOCATION (HORIZ. OR DIAGONAL KNEE BRACE).
- SEE DETAIL 1/A401 FOR TYPICAL BRACING REQUIREMENTS.
- ALL METAL STUD MEMBERS SHALL BE FORMED FROM CORROSION-RESISTANT STEEL, CORRESPONDING TO THE REQUIREMENTS OF ASTM A653-94 AND SHALL BE ZINC COATED MEETING ASTM A924. MINIMUM YIELD STRENGTH SHALL BE 33,000 PSI FOR ALL RUNNERS AND ALL 33 MILS AND 43 MILS MEMBERS; AND 50,000 PSI FOR ALL 54 MILS, 68 MILS, AND 97 MILS. STUDS PROPERTIES SHALL BE AS MANUFACTURED BY METAL STUD MANUFACTURERS ASSOCIATIONS PER I.C.B.O. NO. 4943 OR APPROVED EQUAL. STUDS SHALL BE A MINIMUM 33 MILS "C" SHAPE, 1.625" WIDE (I.O.G.N.), OF THE DEPTHS AND SPACING SHOWN ON DRAWINGS. TRACKS SHALL BE 54 MILS, WITH A MINIMUM FLANGE OF 1.25". BRIDGING SHALL BE COLD ROLLED CHANNEL, MINIMUM 1.5" DEEP WITH 0.5625" FLANGE WIDTH. SPACE BRIDGING AT 4'-0" MAXIMUM O.C. VERTICALLY. DOUBLE UP STUDS AT ALL JAMBS. ALL CONNECTIONS SHALL BE PER MANUFACTURER'S RECOMMENDATIONS. SPLICE IN FRAMING MEMBERS, OTHER THAN RUNNER TRACK SHALL NOT BE PERMITTED. ANCHOR RUNNER TRACK TO CONCRETE WITH 1.45X1.5" HILT FASTENERS PER ESR-1663 AT 32" O.C. MAX.

ROOM FINISH SCHEDULE

ROOM NO.	ROOM NAME	FLOOR		BASE		WALLS				CEILING		CEILING HEIGHT	NOTES	
		LVT-1	CP-1	WB-1	WB-2	LVT-2	PL-1	PL-2	PL-3	PL-4	GL-1			GL-2
100	VESTIBULE												EXISTING	PAINT EXISTING GYP. BD. CEILING PT-3.
101	SALES FLOOR												EXP. DECK	REFER TO A102 FOR FLOOR FINISH LOCATIONS. PAINT WALLS FROM 13'-0" A.F.F. TO DECK PT-2 U.O.N.
102	RECEIVING												EXP. DECK	
103	CASH OFFICE												EXISTING	REPLACE DAMAGED CEILING TILES TO MATCH EXISTING
104	HALLWAY												VARIES	REPLACE DAMAGED CEILING TILES TO MATCH EXISTING
105	ASSOCIATE LOUNGE												EXISTING	REFER TO A303 FOR WALL FINISH LOCATIONS.
106	MANAGER'S OFFICE												EXISTING	
107	CLEANING CLOSET												EXISTING	
108	EXISTING WOMEN												EXISTING	REPLACE DAMAGED CEILING TILES TO MATCH EXISTING
109	EXISTING MEN												EXISTING	REPLACE DAMAGED CEILING TILES TO MATCH EXISTING
110	STORAGE												EXISTING	REPLACE DAMAGED CEILING TILES TO MATCH EXISTING
113	OPEN OFFICE												EXP. DECK	PAINT WALLS FROM 10'-0" A.F.F. TO DECK PT-2.
114	CONFERENCE ROOM #1												10'-0"	
115	PRIVATE OFFICE #1												10'-0"	
116	PRIVATE OFFICE #2												10'-0"	
117	PRIVATE OFFICE #3												10'-0"	
118	PRIVATE OFFICE #4												10'-0"	
119	PRIVATE OFFICE #5												10'-0"	
120	CONFERENCE ROOM #2												10'-0"	
121	PRIVATE OFFICE #6												10'-0"	
122	PRIVATE OFFICE #7												10'-0"	
123	PRIVATE OFFICE #8												10'-0"	
124	PRIVATE OFFICE #9												10'-0"	
125	PRIVATE OFFICE #10												10'-0"	
-	INTERIOR COLUMNS												EXP. DECK	PAINT WALLS FROM 13'-0" A.F.F. TO DECK PT-2. PAINT COLUMNS PT-4 FROM FINISH FLOOR TO 13'-0" A.F.F. AND PT-2 FROM 13'-0" A.F.F. TO DECK.


*EXISTING FINISHES TO REMAIN IN EXISTING ROOMS UNLESS NOTED.

MATERIAL SCHEDULE

CODE	DESCRIPTION	PRODUCT / NAME	COLOR / FINISH	SIZE	MANUFACTURER	LOCATION USED	NOTES
CP-1	CARPET	STYLE: PUNCTUATE PRODUCT NO. 1017049-003-00	DUSK	24" X 24"	TANDUS CENTIVA	TECH AND INTERIOR CPD	INSTALL WITH QUARTER TURN
CP-2	CARPET	STYLE: MARLED TWEED 11072 PH FLEX-AIRE BACKING	SATEEN TWEED 27306	24" X 24"	TANDUS CENTIVA	OPEN OFFICE	INSTALL MONOLITHIC
CP-3	CARPET	STYLE: LINE WAVE 04846 ON FLEX-AIRE BACKING	WIRES 21303	24" X 24"	TANDUS CENTIVA	PRIVATE OFFICES 1-6	INSTALL WITH VERTICAL ASHLAR
LVT-1	LUXURY VINYL TILE PLANK	STYLE: EXOTIC WOOD CFX 3214-TK	CAMPHOR WOOD	6" X 36"	TANDUS CENTIVA	OPEN OFFICE	INSTALL W/ JOHNSONITE SCC-XX-B, COLOR 63 BURNT UMBER - ADHERE TO WALLS WITH CONTACT CEMENT
LVT-2	LUXURY VINYL TILE	STYLE: YAKBUGI #CYK	SHINKA 4501	6" PLANKS	TANDUS CENTIVA	WOOD WALLS	INSTALL W/ JOHNSONITE SCC-XX-B, COLOR 63 BURNT UMBER - ADHERE TO WALLS WITH CONTACT CEMENT
GL-1	PORCELAIN TILE BACKSPLASH	JUMBO HEX	COTTON GLOSSY	4 3/4" X 6"	ARIZONA TILE	OPEN OFFICE KITCHEN	MINIMUM GROUT GR-3
GL-2	PORCELAIN TILE BACKSPLASH	JUMBO HEX PENCIL BULLNOSE	COTTON GLOSSY	1/2" X 8"	ARIZONA TILE	OPEN OFFICE KITCHEN	MINIMUM GROUT GR-3
GR-1	GROUT	#47 CHARCOAL	MAPEI				
GR-2	GROUT	#77 FROST	MAPEI				
GR-3	GROUT	H160 DELOREAN GRAY	BOSTIK - HYDROMENT DRY TILE GROUT				
CS-1	CONCRETE SEALER	DAY CHEM SURE HARD (J-17)			DAYTON SUPERIOR	RECEIVING	
PL-1	TEXTURE LAMINATE	4888-38	RUSTIC SLATE		WILSONART	COUNTERTOPS	
PL-2	MATTE CHARCOAL PLASTIC LAMINATE	S 6014-T	BLACK PEARL		NEVAMAR	AS NEEDED	
PL-3	PLASTIC LAMINATE	WHITE DRIFTWOOD 8200K-16	WHITE		WILSONART	ALL BASE CABINETS	
PL-4	PLASTIC LAMINATE	BLACKENED BRONZE 1519-56	BLACKENED BRONZE		FORMICA	OPEN SHELVES	
SS-1	SOLID STONE SURFACE	GRAPHITE	GRAPHITE		ZODIAQ	OPEN OFFICE KITCHEN	
PT-1	RED	STOP SW 6869	SW 6869		SHERWIN WILLIAMS PROMAR 200 ZERO VOC EG-SHEL FINISH, B20-2600 SERIES	CONFERENCE ROOM CHECKOUT WALL	EGGSHELL
PT-2	CHARCOAL GRAY	SEALSKIN SW 7675	SW 7675		SHERWIN WILLIAMS WATERBORNE ACRYLIC DRY FALL FLAT FINISH, B427001	EXPOSED ROOF DECK, STRUCTURE & MISC. EQUIP.	PAINT FROM DECK TO 13'-0" A.F.F.
PT-3	WHITE	WHITE FLOUR SW 7102	SW 7102		SHERWIN WILLIAMS PROMAR 200 ZERO VOC EG-SHEL FINISH, B20-2600 SERIES	LOWER WALLS	EGGSHELL - UNLESS NOTED OTHERWISE
PT-4	WHITE	WHITE FLOUR SW 7102	SW 7102		SHERWIN WILLIAMS PRO INDUSTRIAL™	LOWER WALLS	PRE-CATALYZED WATER BASED EPOXY
WB-1	WALL BASE	54	BLACK-BROWN	4" W/ TOE	ARMSTRONG	OPEN OFFICE, PRIVATE OFFICES, AND CONFERENCE ROOMS	
WB-2	WALL BASE	#204	GRAY	4" W/ TOE	BURKE		
ACT-1	ACOUSTICAL CEILING TILE	MODEL #704 CORTEGA™	WHITE	2' x 2' x 5/8"	ARMSTRONG	CEILING	1/2" WHITE GRID OR USG SYSTEM EQUAL
GB-1	GYPSUM BOARD CLING.		PAINT PT-3				MOISTURE RESISTANT GYP. BOARD IF NOT EXISTING
PLY-1	F.R.T. PLYWOOD			3/4"			


1 PARTITION TYPES

SCALE: 3/8" = 1'-0"

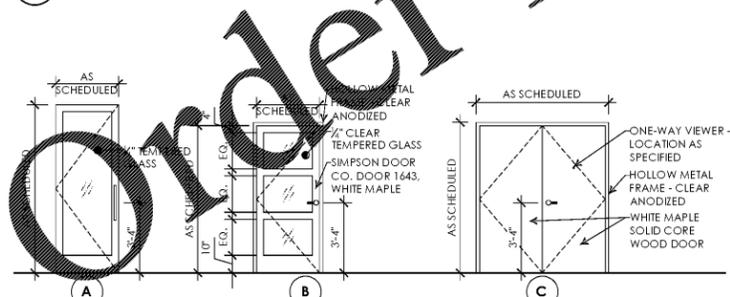


3 DOOR ELEVATIONS

SCALE: 1/4" = 1'-0"



2 SLIP TRACK DETAIL

SCALE: 3" = 1'-0"

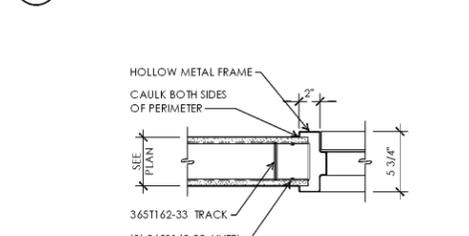


5 HOLLOW METAL FRAME HEAD/JAMB DETAIL

SCALE: 1-1/2" = 1'-0"



COLD-FORMED STEEL IDENTIFICATION

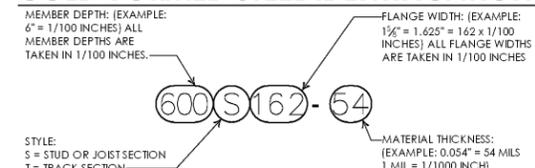

INT. STUD FRAMING HEIGHTS

TYPE	SPACING	ALLOWABLE DEFLECTION	MAXIMUM HEIGHT
250S125-33	16	L/240	12'-0"
250S125-43	16	L/240	13'-0"
362S125-33	16	L/240	16'-0"
362S125-43	16	L/240	17'-5"
400S125-43	16	L/240	18'-10"
600S125-33	16	L/240	23'-9"
600S125-43	16	L/240	26'-1"

ARCHITECTURAL DESIGN GUILD
 2000 S. ... Blvd.
 St. Louis, MO 63143
 www.adg-stl.com
 P: 314.644.1234
 F: 314.644.4373