

FIRE PROTECTION UNREFERENCED NOTES

1. ALL TAMPER AND FLOW SWITCHES MUST BE CONNECTED TO A MONITORED FIRE ALARM SYSTEM.
2. FIRE PROTECTION CONTRACTOR TO OBTAIN OWNER/ARCHITECT APPROVAL OF SPRINKLER TYPE AND FINISH PRIOR TO PURCHASING.
3. FIRE PROTECTION CONTRACTOR TO PROVIDE COVERAGE AS INDICATED ON DRAWING.
4. SEE ARCHITECTURAL DRAWINGS FOR SMOKE AND FIRE RATED WALLS.

franklin architects
 1411 Market Street P.O. Box 4048
 Chattanooga, TN 37405
 V: 423.266.1207 F: 423.266.1216

In association with:
 Project No. 150-18

A.E.E.D., inc.
 Advanced Energy
 Engineering & Design, Inc.
 408 McCalle Ave
 Chattanooga, TN 37402
 www.aeedinc.com
 (423) 752-3438

CCS Gym
 Expansion + Spirit
 Store


for
**Chattanooga
 Christian School**



3354 Charger Dr.
 Chattanooga, TN 37409

This drawing is the property of
 Franklin Associates Architects Inc.
 Any use, reuse, reproduction, display
 or sale of this drawing without the
 express written consent of the Architect
 is strictly prohibited.

Copyright © 2018 | franklin architects



CONSTRUCTION
 DOCUMENTS

Revisions		
No.	Issue	Date

Sheet Information	
Date	11.26.2018
Job No.	6774.3 / 6774.4

Title

FIRE PROTECTION

SPRINKLER PLAN -
 GYM ADDITION


Sheet



FP101

SPRINKLER HEAD SCHEDULE (FOR THIS SHEET)

SYMBOL	QTY	MFG.	SIN	TYPE	RESPONSE	TEMPERATURE	K-FACTOR	DESCRIPTION
●	24	VIKING	VK302	PENDENT	QUICK	155 °F	5.6	RECESSED PENDENT, WHITE
○	19	VIKING	VK300	UPRIGHT	QUICK	155 °F	5.6	BRASS

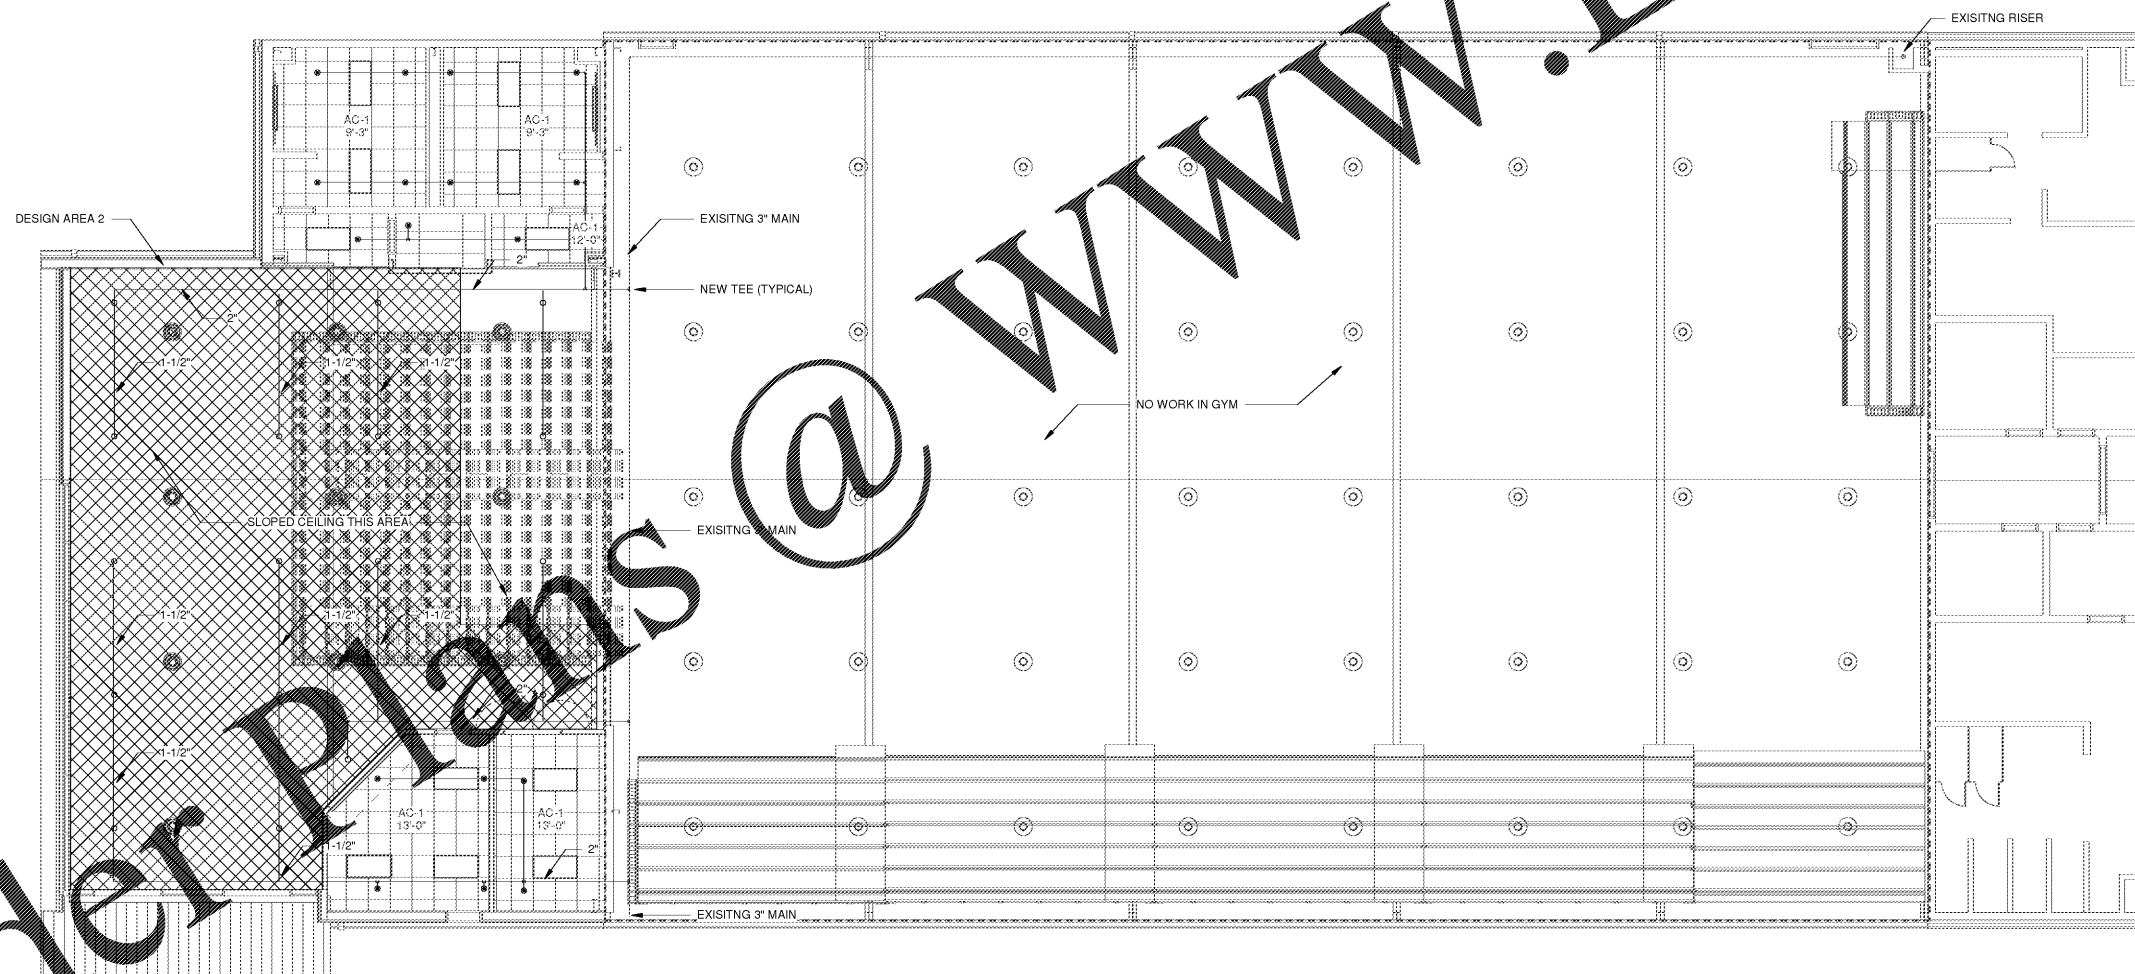

Last Plotted: 11/26/2018 4:15:16 PM

1 Fire Protection - Sprinkler - Gym Addition
 1/8" = 1'-0"