

FIRE PROTECTION UNREFERENCED NOTES

1. ALL TAMPER AND FLOW SWITCHES MUST BE CONNECTED TO A MONITORED FIRE ALARM SYSTEM.
2. FIRE PROTECTION CONTRACTOR TO OBTAIN OWNER/ARCHITECT APPROVAL OF SPRINKLER TYPE AND FINISH PRIOR TO PURCHASING.
3. FIRE PROTECTION CONTRACTOR TO PROVIDE COVERAGE AS INDICATED ON DRAWING.
4. SEE ARCHITECTURAL DRAWINGS FOR SMOKE AND FIRE RATED WALLS.

franklin|architects  
 1411 Market Street P.O. Box 4048  
 Chattanooga, TN 37405  
 v: 423.266.1207 f: 423.266.1216

In association with:  
 Project No. 150-18

**A.E.E.D., inc.**  
 Advanced Energy  
 Engineering & Design, Inc.  
 408 McCalle Ave  
 Chattanooga, TN 37402  
 www.aeedinc.com  
 (423) 752-3438

CCS Gym  
 Expansion + Spirit  
 Store

for  
**Chattanooga  
 Christian School**



3354 Charger Dr.  
 Chattanooga, TN 37409

This drawing is the property of  
 Franklin Associates Architects Inc.  
 Any use, reuse, reproduction, display  
 or sale of this drawing without the  
 express written consent of the Architect  
 is strictly prohibited.

Copyright © 2018 | franklin architects



CONSTRUCTION  
 DOCUMENTS

Revisions		
No.	Issue	Date

Sheet Information	
Date	11.26.2018
Job No.	6774.3 / 6774.4

Title

**FIRE PROTECTION**

SPRINKLER PLAN -  
 SPIRIT SHOP


Sheet



**FP102**

SPRINKLER HEAD SCHEDULE (FOR THIS SHEET)

SYMBOL	QTY	MFG.	SIN	TYPE	RESPONSE	TEMPERATURE	K-FACTOR	DESCRIPTION
●	24	VIKING	VK302	PENDENT	QUICK	155 °F	5.6	RECESSED PENDENT, WHITE
○	2	VIKING	VK300	UPRIGHT	QUICK	155 °F	5.6	BRASS

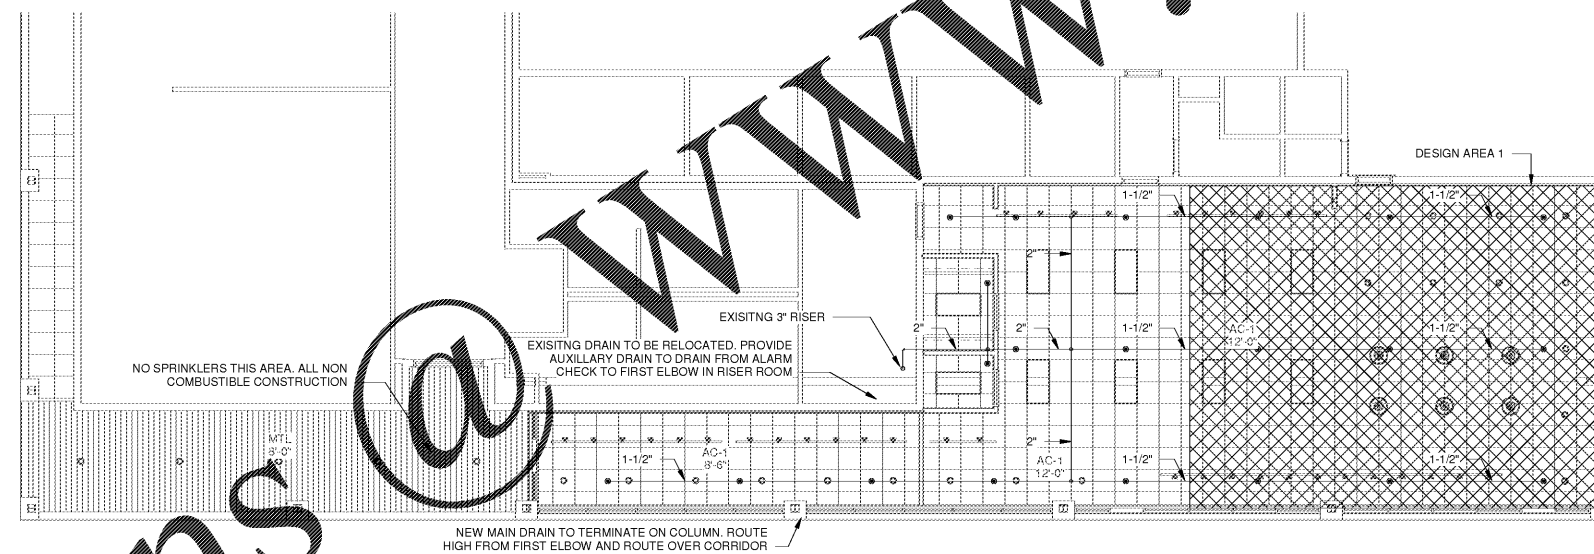

① Fire Protection - Sprinkler - Spirit Shop  
 1/8" = 1'-0"

Order Plans

WWW.LDILine.com