


2 CORNER TOWER FRONT ELEVATION
3/16" = 1'-0"




3 TYPICAL SITE LIGHTING CIRCUITS
3/16" = 1'-0"




4 FRONT ENTRY TOWER LIGHTING
3/16" = 1'-0"

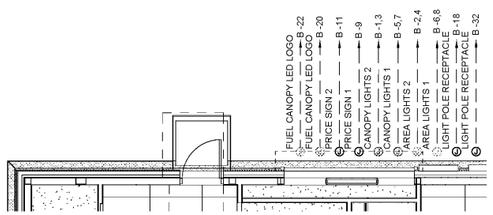


1 LIGHTING PLAN
3/16" = 1'-0"

## GENERAL NOTES

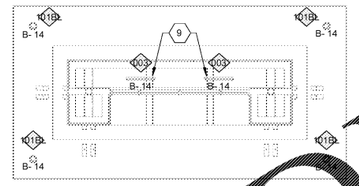1. ALL EXIT SIGNS AND/OR EMERGENCY LIGHTS SHALL BE CONNECTED AHEAD OF ANY LIGHT SWITCHES. DO NOT SWITCH EXIT SIGNS AND/OR EMERGENCY LIGHTS INDICATED WITH LETTERS 'EM'. AN UNSWITCHED HOT CONDUCTOR SHALL BE ROUTED DIRECTLY FROM THE PANELBOARD TO THE FIXTURE (BY-PASS ANY CONTRACTORS).
2. SEE LIGHT FIXTURE SCHEDULE (E001) FOR FIXTURE INFORMATION.
3. COORDINATE ALL BUILDING MOUNTED LIGHT FIXTURES WITH ARCHITECTURAL ELEVATIONS PRIOR TO ROUGH-IN.

## SHEET KEYNOTES
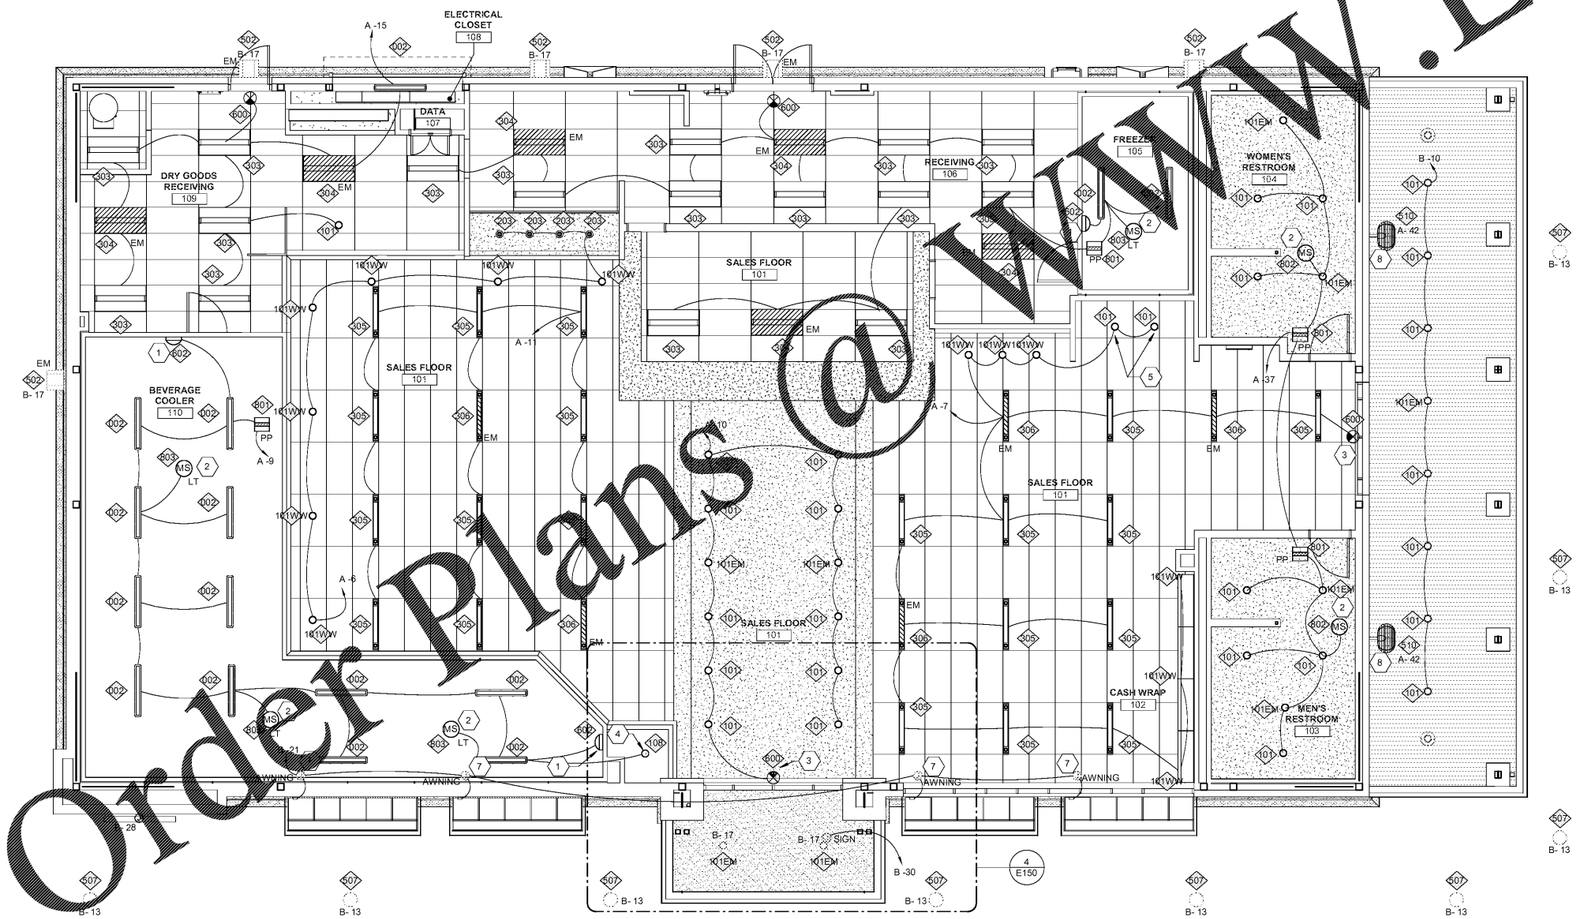
| | |
|---|---|
| 1 | WALL MOUNTED EMERGENCY EGRESS FIXTURE. |
| 2 | OCCUPANCY SENSOR RO CONTROL LIGHTS. |
| 3 | EXIT SIGN TO BE WALL MOUNTED. COORDINATE WITH ARCHITECTURAL ELEVATIONS. |
| 4 | E.C. TO INSTALL LIGHT FIXTURE IN VENDOR PROVIDED SOFFIT. INSTALL PER MANUFACTURER'S RECOMMENDATIONS. |
| 5 | PROVIDE WITHOUT INVERTER. G.C. SHALL INSTALL LED LAMP WITH +/- 575 LUMENS. |
| 6 | PROVIDE JUNCTION BOX ON INTERIOR WALL AND WHIP FOR MARKETING BANNER. COORDINATE LOCATION WITH SIGN MANUFACTURER. |
| 7 | JUNCTION BOX ON INTERIOR OF BUILDING ABOVE ACCESSIBLE CEILING FOR POWER FEED TO AWNING LIGHT. ROUTE CONDUIT CONCEALED IN WALL CAVITY AND EXTEND FUTURE WHIP CONCEALED TO LIGHT AND MAKE FINAL CONNECTIONS. SEAL WALL PENETRATIONS WATER TIGHT. COORDINATE AWNING INSTALLER. |
| 8 | E.C. SHALL PROVIDE DARK BRONZE RECEPTACLE COVER FOR PATIO FANS. E.C. SHALL INSTALL RECEPTACLE AT 6'-6" A.F.F. |
| 9 | FRONT TOWER INTERIOR LIGHT FIXTURES. 4 TOTAL FIXTURES (2 AT THE TOP AND 2 AT THE BOTTOM) TO LUMINATE INTERIOR OF TOWER. |

Order Plans @ WWW.LDILine.com

RaceTrac.
COPYRIGHT NOTICE
THESE PLANS ARE SUBJECT TO FEDERAL COPYRIGHT LAWS: ANY USE OF SAME WITHOUT THE EXPRESSED WRITTEN PERMISSION OF RACETRAC PETROLEUM, INC. IS PROHIBITED. 2016 RACETRAC PETROLEUM INC.

DESIGN PROFESSIONALS

HILLFOLEYROSSI & ASSOCIATES
ARCHITECTURE
ENGINEERING
3680 Pleasant Hill Road
Suite 200
Duluth, Georgia 30096
p 770.622.9858
f 770.622.9535
www.hillfoleyrossi.com

© Copyright (as dated below)
This drawing and all reproductions thereof are the property of Hill Foley Rossi & Associates, LLC (HFR). It is intended for the sole use of the project named hereon. Reproduction without the written consent of HFR is unlawful. All copies are to be returned to HFR upon project completion.

ISSUE/REVISION RECORD

| DATE | DESCRIPTION |
|---|---|
| 09/04/18 | ISSUED FOR PERMIT |

RaceTrac.
RACETRAC PETROLEUM, INC.
200 GALLERIA PARKWAY SOUTHEAST
SUITE 900
ATLANTA, GEORGIA 30339
(770) 431-7600

PROJECT NAME
**PEACHTREE PKWY & ENG.**

**PEACHTREE CORNERS**
**5780 PEACHTREE PKWY**
**PEACHTREE CORNERS, GA**

RACETRAC STORE NUMBER
**1201**

PROTOTYPE SERIES 5.5K 2.0
**2018 RH MO**

PLAN MODIFICATION NOTICE
SPB NO. DATE

STANDARD PLAN BULLETINS (SPB) MODIFY THE PROTOTYPE SERIES SET NOTED ABOVE. THE LISTED SPB REPRESENTS THE LATEST MODIFICATION INCORPORATED TO THIS PROTOTYPE SERIES SET AT ORIGINAL RELEASE. THE ISSUE/ REVISION RECORD COLUMN ABOVE LISTS ANY REVISIONS OR SPB INCORPORATED IN THIS SET AFTER THE ORIGINAL RELEASE. CONTACT RACETRAC ENGINEERING AND CONSTRUCTION FOR ANY SUBSEQUENT BULLETINS NOT INCORPORATED HEREIN.

PROFESSIONAL SEAL

09/04/18

PROJECT NUMBER
18.703.00

SHEET TITLE
**LIGHTING PLAN**

SHEET NUMBER
**E150**

ISSUED FOR PERMIT