


Revision Schedule		
Revision Number	Revision Description	Revision Date

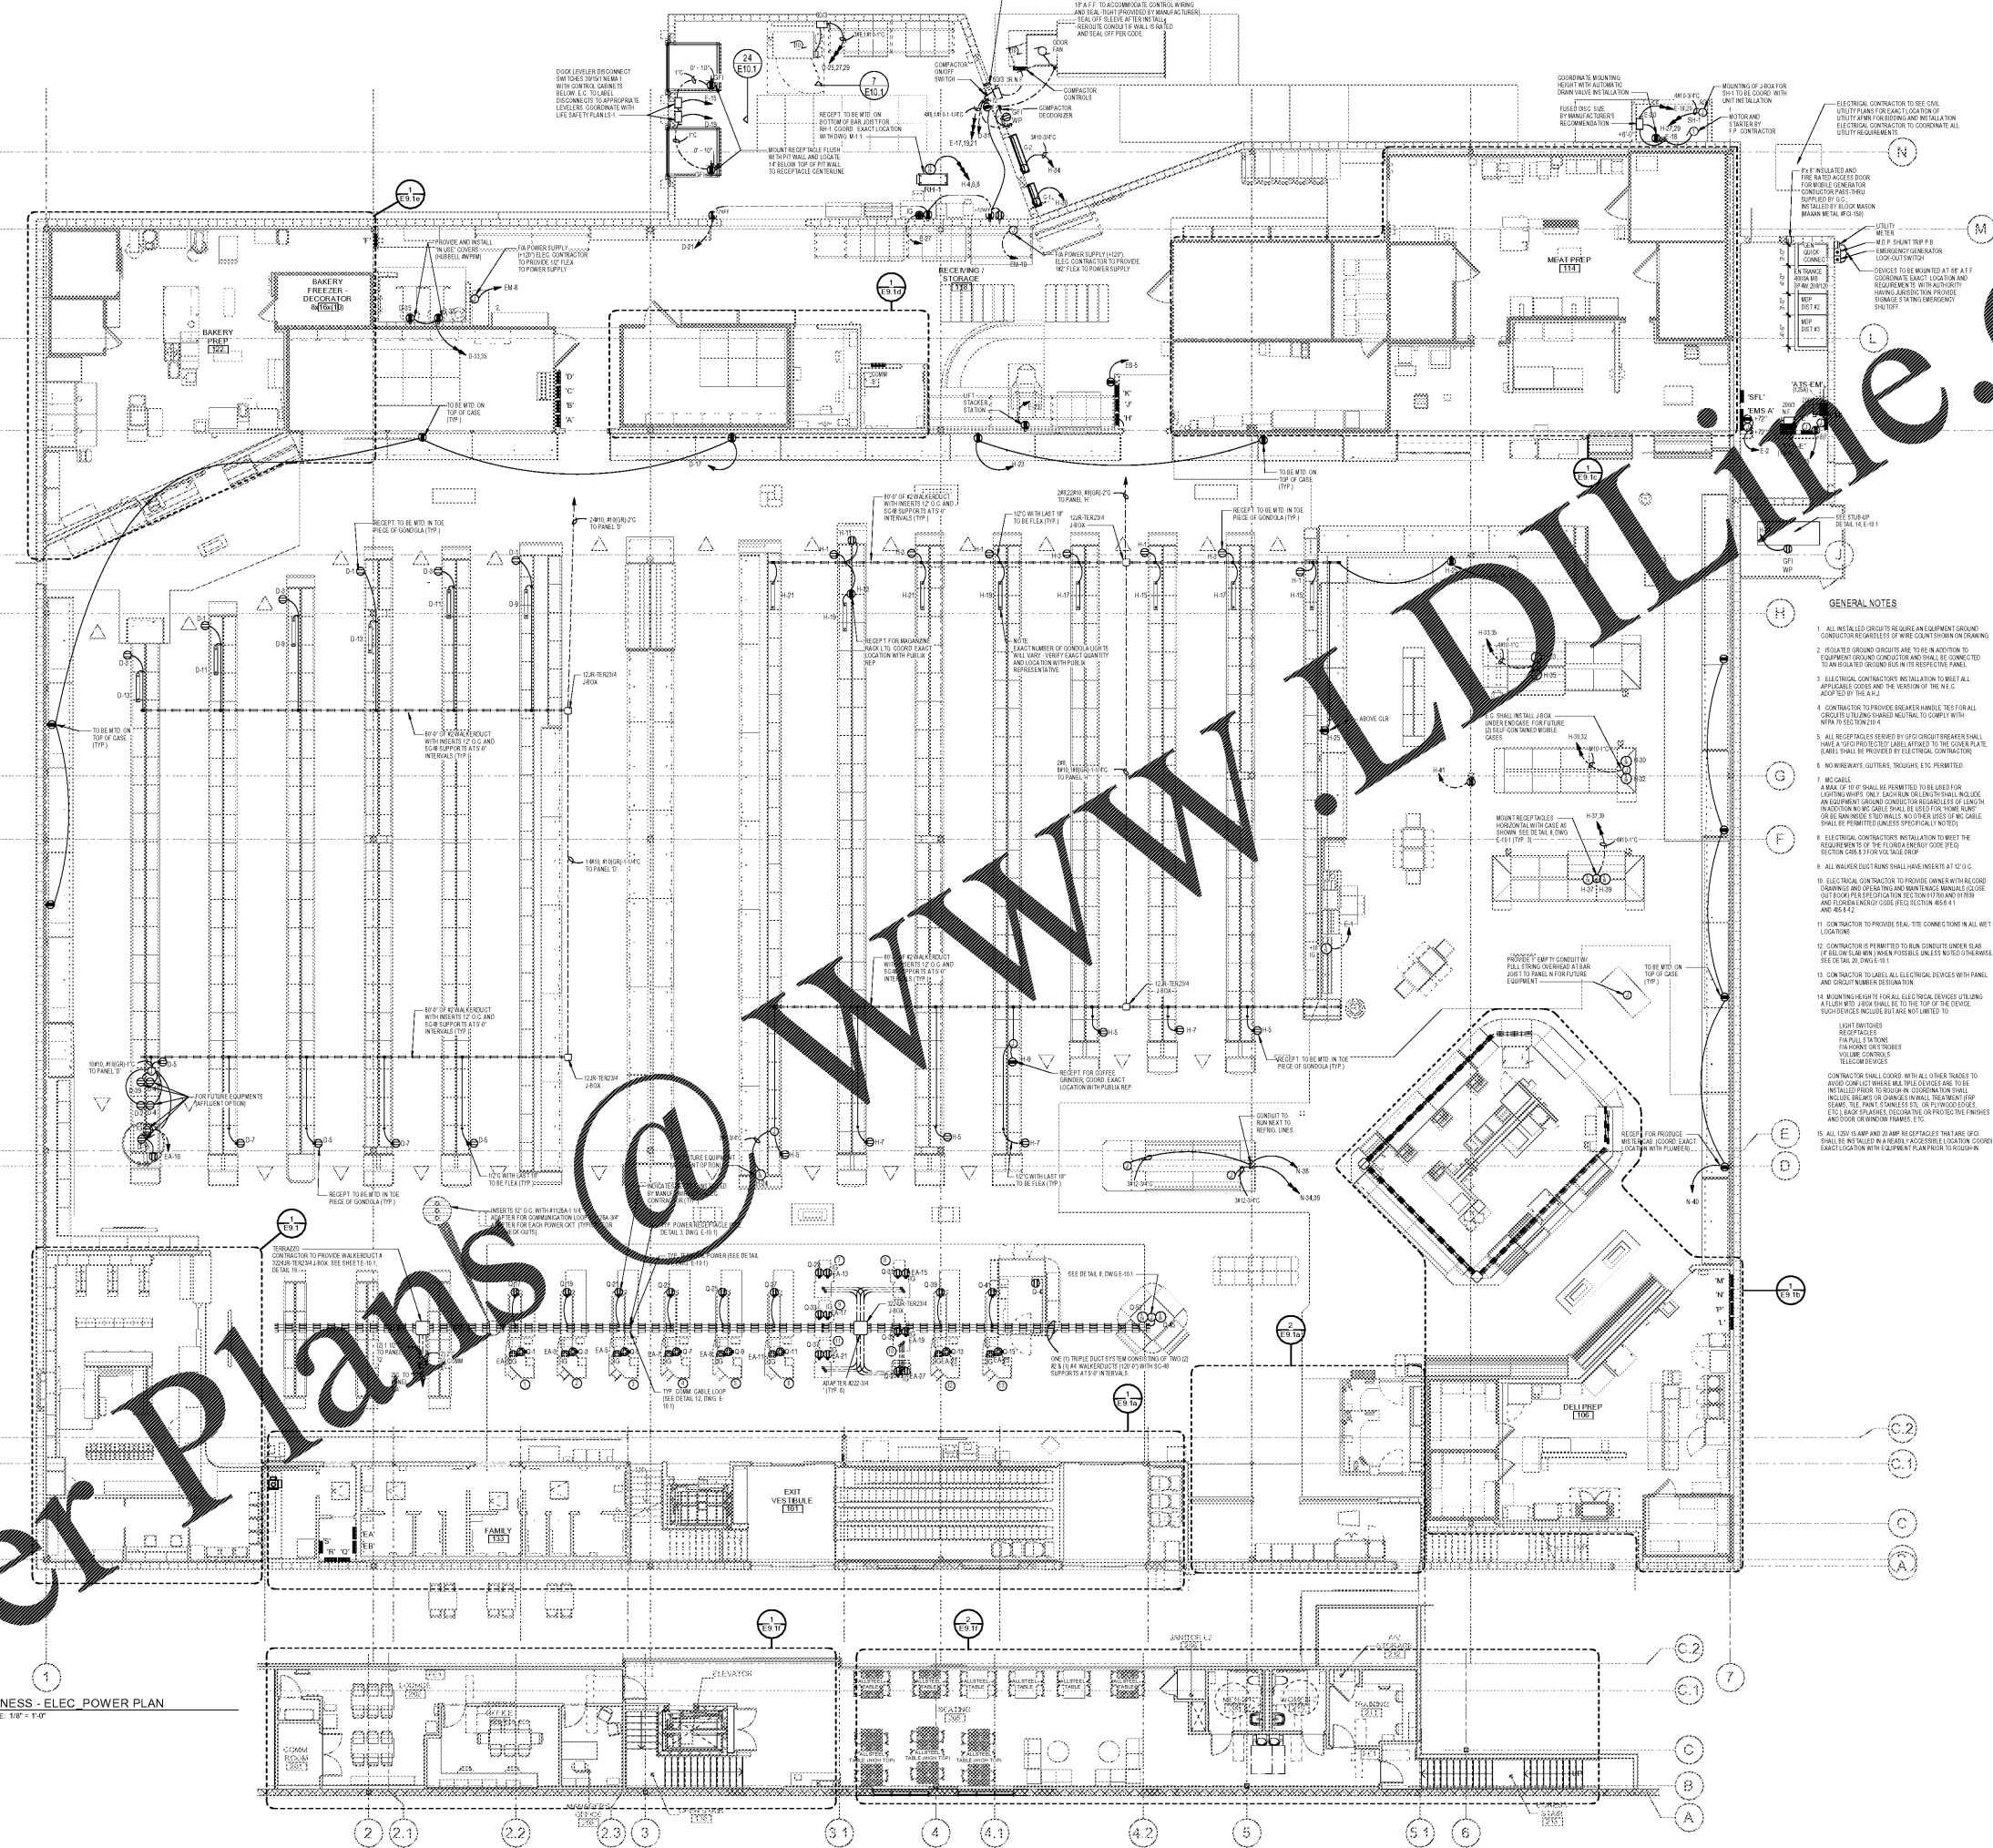

- GENERAL NOTES**
1. ALL INSTALLED CIRCUITS TO REQUIRE AN EQUIPMENT GROUNDING CONDUCTOR (E.G. EGC) SHALL BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE (NEC) AND THE VERSION OF THE NEC ADOPTED BY THE A.J.C.
 2. ISOLATED GROUND CIRCUITS ARE TO BE IN ADDITION TO EQUIPMENT GROUNDING CONDUCTORS AND SHALL BE CONNECTED TO AN ISOLATED GROUND BUS IN THE DISTRIBUTION PANEL.
 3. ELECTRICAL CONTRACTOR'S INSTALLATION TO MEET ALL APPLICABLE CODES AND THE VERSION OF THE NEC ADOPTED BY THE A.J.C.
 4. CONTRACTOR TO PROVIDE BREAKER HANDLE TESTS FOR ALL CIRCUITS INCLUDING PHASE NEUTRAL TO COMPLY WITH NFPA 70 SECTION 210.4
 5. ALL RECEPTACLES SERVED BY GFCI CIRCUIT BREAKERS SHALL HAVE A GFCI PROTECTED AND Labeled TO THE CONDUIT. LABEL SHALL BE PROVIDED BY ELECTRICAL CONTRACTOR.
 6. NO WIREWAYS, GUTTERS, TROUGH, ETC. PERMITTED.
 7. W/CABLE: A MAXIMUM OF 10' SHALL BE PERMITTED TO BE USED FOR LIGHTING WIRING. ONLY CABLE RAYS OR LINES SHALL INCLUDE AN EQUIPMENT GROUNDING CONDUCTOR (E.G. EGC) IN ADDITION TO THE CABLE SHALL BE USED FOR "HOT" WIRING. ONLY CABLE SHALL BE USED FOR "HOT" WIRING. W/CABLE SHALL BE PERMITTED (UNLESS SPECIFIED NOTED).
 8. ELECTRICAL CONTRACTOR'S INSTALLATION TO MEET THE REQUIREMENTS OF THE FLORIDA ENERGY CODE (FEC) SECTION 610.0 AND THE FLORIDA ENERGY CODE (FEC) SECTION 610.1 AND 610.2.
 9. ALL WIREWAYS SHALL HAVE INSERTS AT 12" O.C.
 10. ELECTRICAL CONTRACTOR TO PROVIDE OWNER WITH RECORD DRAWINGS AND OPERATING AND MAINTENANCE MANUALS TO BE SUBMITTED TO THE PROJECT ARCHITECT FOR REVIEW AND APPROVAL. RECORD DRAWINGS AND OPERATING AND MAINTENANCE MANUALS TO BE SUBMITTED TO THE PROJECT ARCHITECT FOR REVIEW AND APPROVAL.
 11. CONTRACTOR TO PROVIDE REAL-TIME CONNECTIONS IN ALL WET LOCATIONS.
 12. CONTRACTOR IS PERMITTED TO RUN CONDUITS UNDER SLAB IF BELOW SLAB WHEN POSSIBLE UNLESS NOTED OTHERWISE. SEE DETAIL 10.010.01.
 13. CONTRACTOR TO LABEL ALL ELECTRICAL DEVICES WITH PANEL AND CIRCUIT NUMBER DESIGNATION.
 14. MOUNTING HEIGHTS FOR ALL ELECTRICAL DEVICES UTILING A FLOOR MOUNT JACK SHALL BE TO THE TOP OF THE DEVICE. SUCH DEVICES INCLUDE BUT ARE NOT LIMITED TO: LIGHT SWITCHES, RECEPTACLES, PULL STATIONS, SWITCHES, RELAYS, VOLUME CONTROLS, BELLSOUND DEVICES.
 15. ALL LOW VOLT AND 24 AMP RECEPTACLES THAT ARE GFCI SHALL BE INSTALLED IN REAR AND ACCESSIBLE LOCATION COORDINATE EXACT LOCATION WITH EQUIPMENT PLAN PRIOR TO ROUGH-IN.

3 BUSINESS - ELEC. POWER PLAN
SCALE: 1/8" = 1'-0"

2 ELECTRICAL MEZZANINE POWER PLAN
SCALE: 1/8" = 1'-0"

Order Plans @ www.wldline.com

www.wldline.com