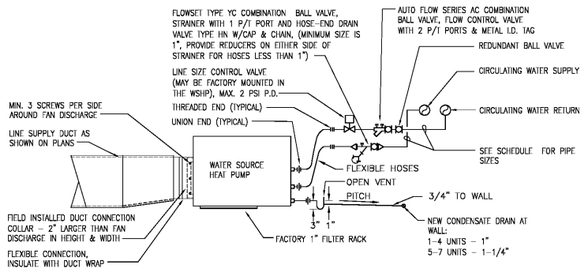

TYPICAL WATER SOURCE HEAT PUMP UNIT PIPING AND DUCT CONNECTION DETAIL

3 / M4.2 SCALE: NO SCALE

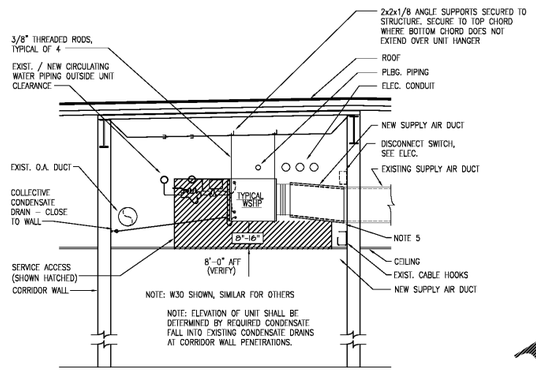

SECTION AT TYPICAL WATER SOURCE HEAT PUMP UNIT

2 / M4.2 SCALE: NO SCALE

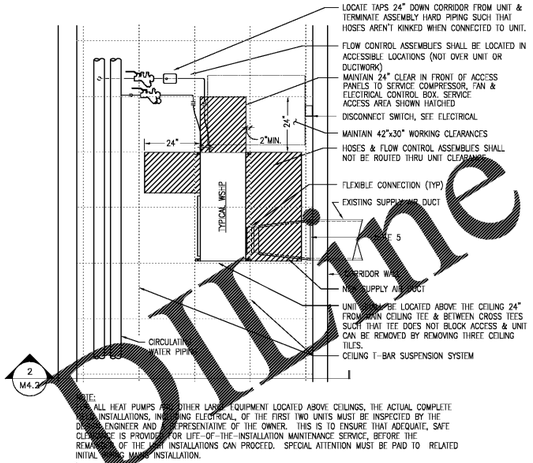

NOTE:
FOR ALL HEAT PUMPS AND OTHER LARGE EQUIPMENT LOCATED ABOVE CEILINGS, THE ACTUAL COMPLETE INSTALLATIONS, INCLUDING ELECTRICAL, OF THE FIRST TWO UNITS MUST BE INSPECTED BY THE DESIGN ENGINEER AND THE PRESENTATIVE OF THE OWNER. THIS IS TO ENSURE THAT ADEQUATE, SAFE CLEARANCE IS PROVIDED FOR LIFE-OF-THE-INSTALLATION MAINTENANCE SERVICE, BEFORE THE REMAINDER OF THE UNIT INSTALLATIONS CAN PROCEED. SPECIAL ATTENTION MUST BE PAID TO RELATED INITIAL PIPING INSTALLATION.

PARTIAL PLAN AT TYPICAL WATER SOURCE HEAT PUMP UNIT

1 / M4.2 SCALE: NO SCALE

FOR PRICING

Order Plans @ www.LDime.com

ISA CONSULTING ENGINEERS
Johnson, Spellman & Associates, Inc.
330 Commerce Drive, Suite 100
Fayetteville, Georgia 30214
770.461.4565 www.jsae.com

COPYRIGHT OWNERSHIP
This drawing is the property of Foreman Seeley Fountain Architecture and may not be used, copied or reviewed without expressed written permission.
© 2018

Revisions:

HVAC AND ROOFING RENOVATIONS FOR BRITT ELEMENTARY SCHOOL

2503 SKYLAND DRIVE SW
SNELLVILLE, GEORGIA 30078

Facility Code # 3050

FOREMAN | SEELEY | FOUNTAIN
architecture
3251 Governors Lake Drive, Suite 155, Peachtree Corners, Georgia 30071
(770) 729-8433 www.FSFarchitecture.com fax (770) 729-8466

Sheet Title:
HVAC DETAILS

Drawn By:	GBP
Scale:	AS NOTED
Date:	12/14/2018
Job No.:	18JS97
Sheet No.:	M4.2