


24 VAC / CO <sub>2</sub> +	<input checked="" type="checkbox"/>	1	<input checked="" type="checkbox"/>
24 VAC / CO <sub>2</sub> -	<input checked="" type="checkbox"/>	2	<input checked="" type="checkbox"/>
24 VDC PWR / ILS +	<input checked="" type="checkbox"/>	3	<input checked="" type="checkbox"/>
24 VDC PWR / ILS -	<input checked="" type="checkbox"/>	4	<input checked="" type="checkbox"/>
ILS SIGNAL +	<input checked="" type="checkbox"/>	5	<input checked="" type="checkbox"/>
CO <sub>2</sub> + SIGNAL IN	<input checked="" type="checkbox"/>	6	<input checked="" type="checkbox"/>
CO <sub>2</sub> SIGNAL OUT (SALES FLOOR HVAC)	<input checked="" type="checkbox"/>	7	<input checked="" type="checkbox"/>
OUTDOOR AIR TEMPERATURE	<input checked="" type="checkbox"/>	8	<input checked="" type="checkbox"/>
OUTDOOR LIGHT	<input checked="" type="checkbox"/>	9	<input checked="" type="checkbox"/>
EMPLOYEE OVERRIDE	<input checked="" type="checkbox"/>	10	<input checked="" type="checkbox"/>
EXTERIOR OVERRIDE	<input checked="" type="checkbox"/>	11	<input checked="" type="checkbox"/>
BACNET NETWORK	<input checked="" type="checkbox"/>	12	<input checked="" type="checkbox"/>
SHLD	<input checked="" type="checkbox"/>	13	<input checked="" type="checkbox"/>
V+	<input checked="" type="checkbox"/>	14	<input checked="" type="checkbox"/>
DATA-	<input checked="" type="checkbox"/>	15	<input checked="" type="checkbox"/>
DATA+	<input checked="" type="checkbox"/>	16	<input checked="" type="checkbox"/>
GND	<input checked="" type="checkbox"/>	17	<input checked="" type="checkbox"/>
MODBUS NETWORK / ND ENERGY METER	<input checked="" type="checkbox"/>	18	<input checked="" type="checkbox"/>
	<input checked="" type="checkbox"/>	19	<input checked="" type="checkbox"/>
	<input checked="" type="checkbox"/>	20	<input checked="" type="checkbox"/>
	<input checked="" type="checkbox"/>	21	<input checked="" type="checkbox"/>
	<input checked="" type="checkbox"/>	22	<input checked="" type="checkbox"/>
	<input checked="" type="checkbox"/>	23	<input checked="" type="checkbox"/>
	<input checked="" type="checkbox"/>	24	<input checked="" type="checkbox"/>

\* STANDARD  
 OVERRIDE  
 OPTION

# ANTUMBRA  
 OVERRIDE  
 OPTION

- JUMPER SETTINGS**
- JP1
  - JP2
  - JP3
  - JP4
  - JP5
  - JP6
  - JP7
  - JP8
  - JP19

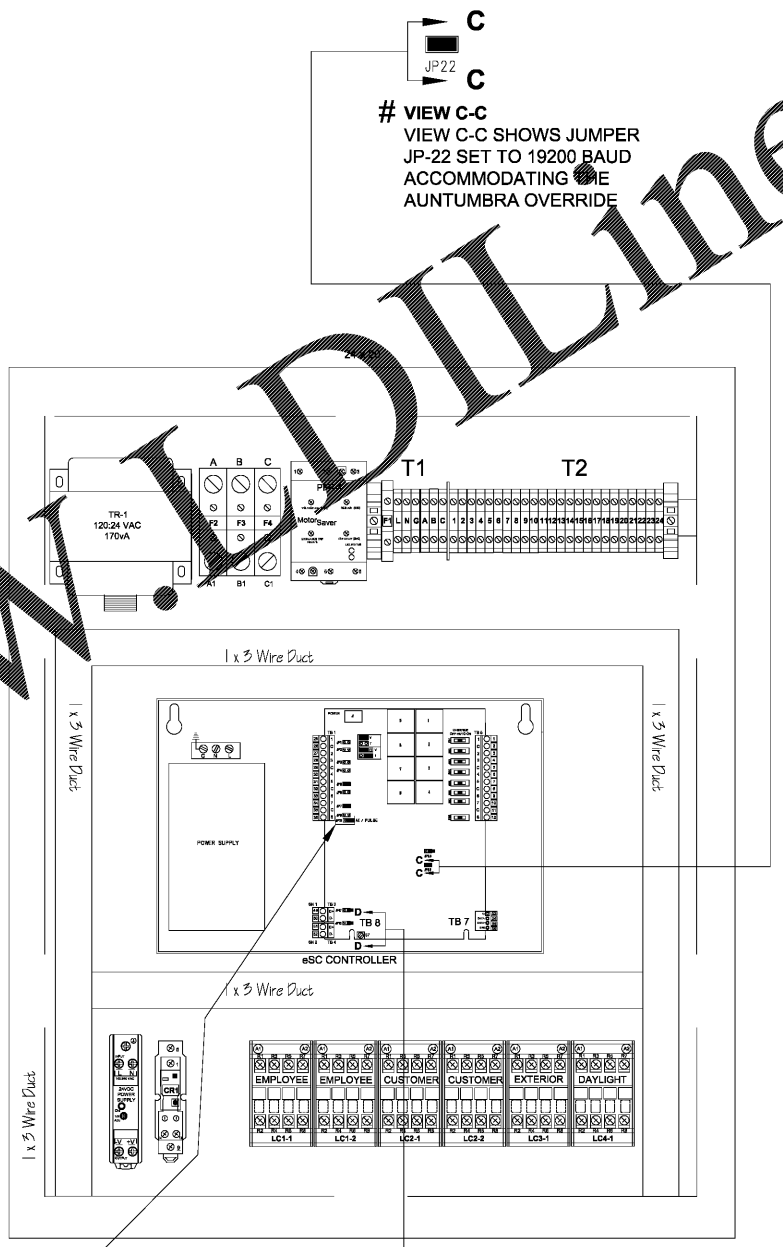

# VIEW C-C  
 VIEW C-C SHOWS JUMPER  
 JP-22 SET TO 19200 BAUD  
 ACCOMMODATING THE  
 AUNTUMBRA OVERRIDE

**INTERFACE PANEL & eSC WIRING DETAILS**  
 SCALE: None

VIEW D-D  
 VIEW D-D SHOWS TB8 MAXIMUM  
 TIGHTENING TORQUE  
 UL 4.4 lb-in / SEV 0.5 Nm

**DOLLAR TREE  
 EQUIPMENT DETAILS**  
 (FOR REFERENCE ONLY NOT TO SCALE)

REVISION: 7	DATE: 07/10/18	ECN#: 2306
UPDATE TO CURRENT CYLON ADDRESS		
REVISION: 8	DATE: 09/27/18	ECN#: 2339
ADD METER		
REVISION:	DATE:	ECN#:
REVISION:	DATE:	ECN#:
DRAWN: WPC	ENGINEER: CGP	
PART #: 94-339	OPTION: P	

Order Plans @ [www.wdiline.com](http://www.wdiline.com)