


ROOF TRUSS & OUTLOOKER REACTIONS & CONNECTORS SCHEDULE

TRUSS/OUTLOOKER MARK	DEAD LOAD		LIVE LOAD		UPLIFT		TRUSS/OUTLOOKER SIMPSON CONNECTOR		REFERENCE SECTION
	EXT. WALL	INT. WALL	EXT. WALL	INT. WALL	EXT. WALL	INT. WALL	EXT. WALL	INT. WALL	
T1	0.28K	0.31K	0.23K	0.25K	0.665K	0.504K	HTSM16	MTS12	A/S4.1, J/S4.1 & C/S4.1
T2	0.33K	0.36K	0.27K	0.29K	0.7K	0.581K	HTSM16	MTS12	A/S4.1 & C/S4.1
T3	0.29K	0.36K	0.24K	0.29K	0.595K	0.581K	TRUSS TO TRUSS CONN. BY TRUSS SUPPLIER	MTS12	K/S4.1 & C/S4.1
T4	0.21K	0.18K	0.17K	0.14K	0.553K	0.28K	HTSM16	MTS12	A/S4.1 & A/S4.2
T5		0.07K		0.06K		0.112K		H2.5T	C/S4.1
OL1	0.15K	0.09K	0.12K	0.07K	0.105	0.063K	H3Z	H3Z & LU24	B/S4.1

ROOF FRAMING PLAN
 1/8" = 1'-0"

- PLAN NOTES:**
- REFER TO SECTION K/S4.1 FOR CORRIDOR TOP PLATE CHORD SPLICE.
 - REFER TO SECTION 2/S4.1 FOR NON-BEARING WALL DETAIL.
 - WOOD ROOF TRUSSES SHALL SPAN FROM EXTERIOR WALL TO INTERIOR WALL (MAXIMUM TRUSS LENGTH 28'-6").
 - BP1 = 7" X 8" X 0'-7" BEARING PLATE W/ (1) 3/8" X 4" H.S. ANCHOR.
 - = BOTTOM CHORD HORIZONTAL BRACING REFER TO DTL. S4.2.

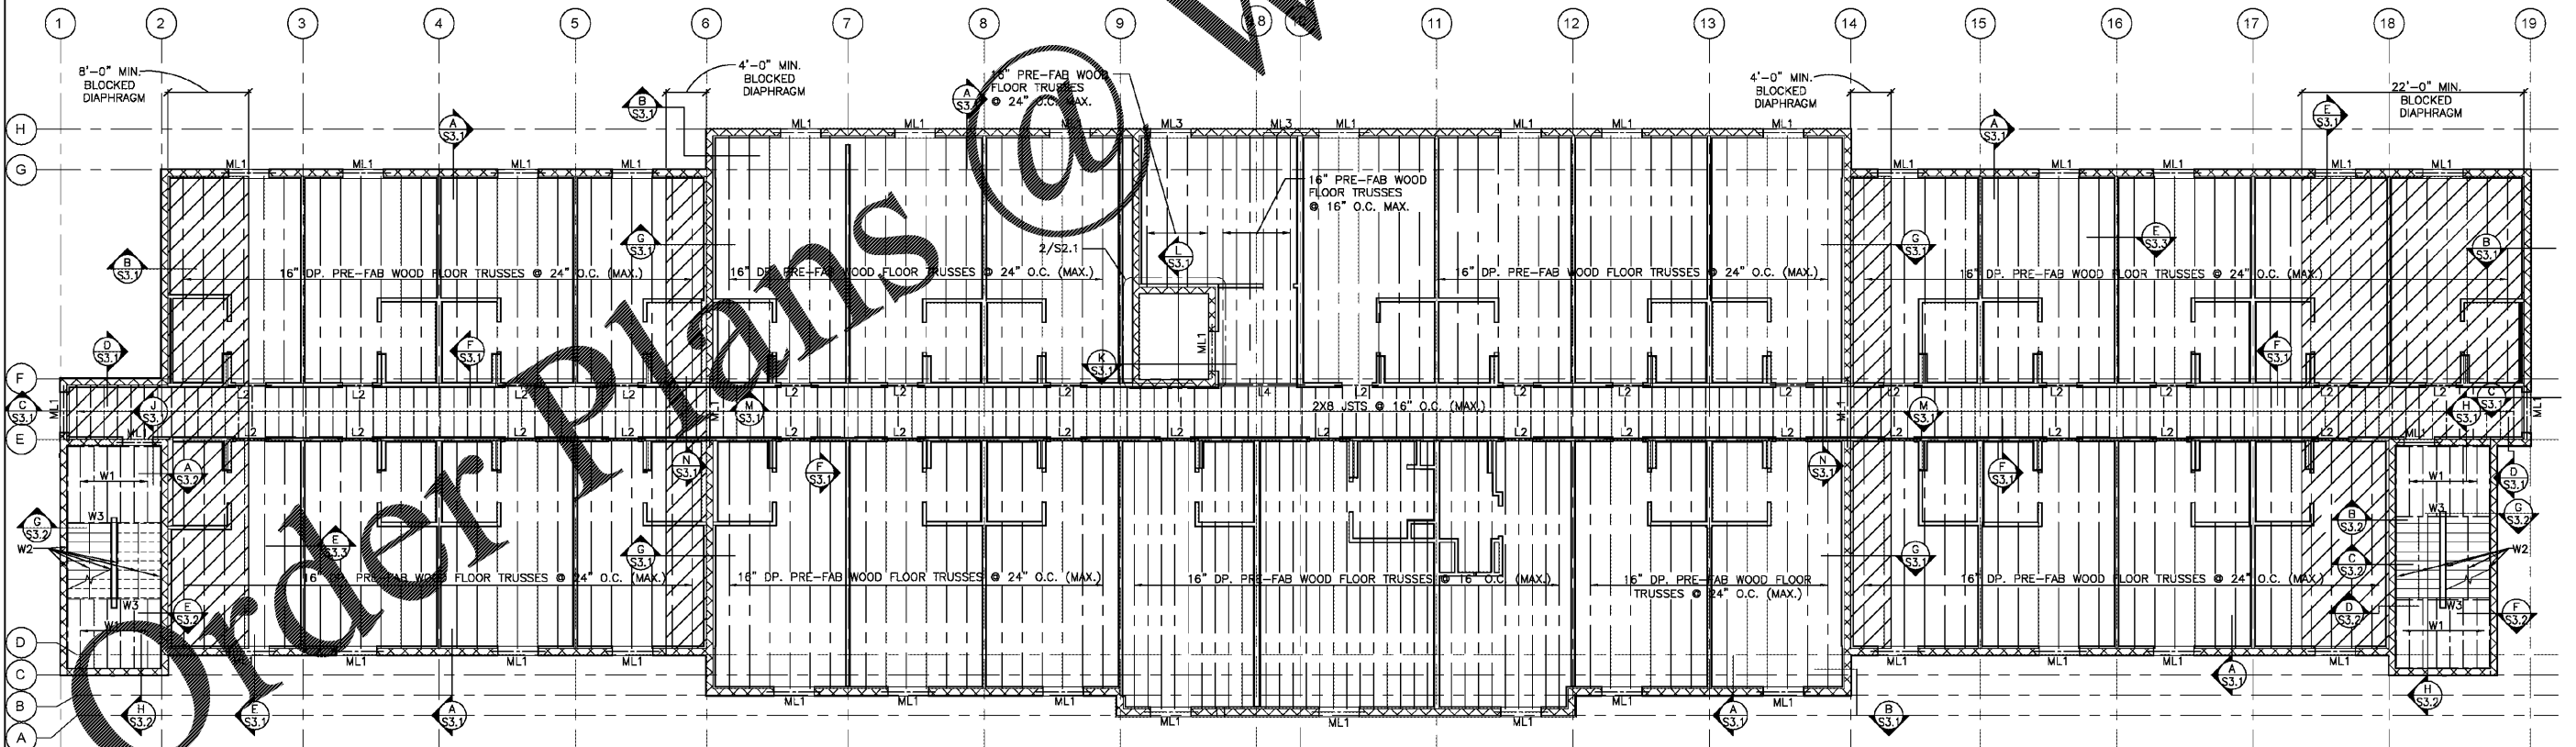

THIRD & FOURTH FLOOR FRAMING PLAN
 1/8" = 1'-0"

- PLAN NOTES:**
- ADD FLOOR TRUSSES AS REQUIRED TO MISS PLUMBING LOCATIONS.
 - REFER TO SECTION 1/S3.1 FOR FLOOR TOP PLATE CHORD SPLICES.
 - REFER TO SECTION 2/S4.1 FOR NON-BEARING WALL DETAIL.
 - ⊙ = STAIR FRAMING MEMBER (SEE SCHED. ON SHT. SO.1).

BLOCKED DIAPHRAGM INDICATED ON FLOOR PLAN SHALL HAVE 2X NOMINAL BLOCKING AT ALL PANEL EDGES W/ 10d NAILS @ 6" O.C. AT ALL SHEET ENDS/DISCONTINUOUS SIDES/BOUNDARIES & 6" O.C. ⊙ INTERMEDIATE FRAMING MEMBERS

COORDINATE WALL FRAMING W/ SHOWER / TUB CONTROLS (TYP. ALL FLOORS)

WOODSPRING SUITES
 CYPRESS CREEK, FLORIDA
 Pasco County
 Cypress Creek, FL

Issues & Revisions:

Proj. No.: 078761
 Date: 10/02/2018

Sheet Name:
 3RD & 4TH FLR
 FRAMING PLAN
 & ROOF FRAMING
 PLAN

S1.3