


Bearing Wall Ratings — 3/4 Hr, 1, 1-1/2 or 2 Hr (See Items 5 & 7)

This design was evaluated using a load design method other than the Limit States Design Method (e.g., Working Stress Design Method). For jurisdictions employing the Limit States Design Method, such as Canada, a load restriction factor shall be used — See Guide R301.0 or R301.07.

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

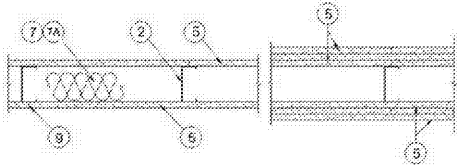

1. **Floor and Ceiling Runners** — (Not Shown) — Channel shaped, fabricated from min 0.0325 in. bare metal thickness (No. 20 MSG) corrosion-protected steel, that provide a sound structural connection between steel studs and adjacent assemblies such as floors, ceilings and/or other walls. Attached to floor and ceiling assemblies with steel fasteners spaced not greater than 24 in. OC.

1A. **Floor and Ceiling Runners** — (Not Shown, As an alternate to Item 1, For Use With Item 5A and 5C) — Channel shaped runners min 3-1/2 in. deep with 1-1/4 in. flanges fabricated from min. No. 20 MSG corrosion-protected steel. Attached to floor and ceiling assemblies with steel fasteners spaced not greater than 24 in. OC.

2. **Steel Studs** — Min 0.0325 in. bare metal thickness (No. 20 MSG) corrosion-protected steel studs, min 3-1/2 in. wide, cold formed, designed in accordance with the current edition of the Specification for the Design of Cold-Formed Steel Structural Members by the American Iron and Steel Institute (AISI). All design details enhancing the structural integrity of the wall assembly, including the axial design load of the studs, shall be as specified by the steel stud designer and/or producer, and shall meet the requirements of all applicable local code agencies. The maximum stud spacing shall not exceed 24 in. OC. Studs attached to floor and ceiling runners with 1/2 in. long Type S-12 steel screws on both sides of the studs or by welded or bolted connections designed in accordance with the AISI specifications.

2A. **Steel Studs** — (As an alternate to Item 2, For use with Item 5A, 5C, 5D, and 5E) — Channel shaped, fabricated from min 20 MSG corrosion-protected or galv steel, 3-1/2 in. min width, min 1-1/2 in. flanges and 1/4 in. return, spaced a max of 16 in. OC. Studs friction-fit into floor and ceiling runners.

2B. **Steel Studs** — (As an alternate to Item 2 and 2A, For Use With Item 5B) — Min 0.0325 in. (No. 20 MSG) corrosion-protected cold formed steel studs, min 3-1/2 in. deep by 1-5/8 in. wide with 1/2 in. returns. Braced at mid-height and designed in accordance with the current edition of the Specification for the Design of Cold-Formed Steel Structural Members by the American Iron and Steel Institute (AISI). All design details enhancing the structural integrity of the wall assembly, including the axial design load of the studs, shall be as specified by the steel stud designer and/or producer, and shall meet the requirements of all applicable local code agencies. The max stud spacing shall not exceed 24 in. OC. Studs attached to floor and ceiling runners with 1/2 in. long Type S-12 steel screws on both sides of the studs or by welded or bolted connections designed in accordance with the AISI specifications.

2C. **Framing Members - Steel Studs** — (As an alternate to Item 2, For use with Item 5C) — Channel shaped, fabricated from min 20 MSG corrosion-protected or galv steel, 3-1/2 in. min width, min 1-1/2 in. flanges and 1/4 in. return, spaced a max of 16 in. OC. Studs friction-fit into floor and ceiling runners. Studs to be cut 5/8 to 3/4 in. less than assembly height.

3. **Lateral Support Members** — (Not shown) — Where required for lateral support of studs, support shall be provided by means of steel straps, channels or other similar means as specified in the design of a particular steel stud wall system.

4. **Wood Structural Panel Sheathing** — (Optional, For use with Item 5 only) — (Not Shown) — 4 ft wide, 7/16 in. thick oriented strand board (OSB) or 15/32 in. thick structural 1 sheathing (plywood complying with DCP-F51 or PS-2, or APA Standard PPR-156, manufactured with exterior glue, applied horizontally or vertically to the steel studs. Vertical joints centered on studs, and staggered one stud space from wallboard joints. Attached to studs with hat-head self-drilling tapping screws with a min. head diam. of 0.292 in. at maximum 5 in. OC, in the perimeter and 12 in. OC, in the field. When used, gypsum panels attached over OSB or plywood panels and fastener lengths for gypsum panels increased by min. 1/2 in.

5. **Gypsum Board** — Gypsum panels with beveled, square or tapered edges, applied vertically or horizontally. Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Vertical joints in adjacent layers (multilayer systems) staggered one stud cavity. Horizontal joints need not be backed by steel framing. Horizontal edge joints and horizontal butt joints on opposite sides of studs need not be staggered when load is reduced to 90 percent of max stud capacity. When load is at 100 percent, horizontal edge joints and horizontal butt joints on opposite sides of studs staggered a min of 12 in. Horizontal edge joints and horizontal butt joints in adjacent layers (multilayer systems) staggered a min of 12 in. When used in widths other than 48 in., gypsum panels to be installed horizontally. The thickness and number of layers and percent of design load for the 45 min, 1 hr, 1-1/2 hr, and 2 hr ratings are as follows:

Wallboard Protection on Each Side of Wall

Rating	No. of Layers & Thkns of Panel	% of Design Load
45 Min	1 layer, 1/2 in. thick	100
1 hr	1 layer, 5/8 in. thick	100
1-1/2 hr	2 layers, 1/2 in. thick	100
2 hr	2 layers, 5/8 in. thick	80
2 1/2 hr	2 layers, 5/8 in. thick	100
3 hr	3 layers, 1/2 in. thick	100
3 1/2 hr	3 layers, 1/2 in. thick	100
2 hr	2 layers, 3/4 in. thick	100

(*)Rating applicable when Batts and Blankets (Item 7) are used.
CGC INC — 1/2 in. thick Type IP-X2, IPC-AR, C, WRX, or 5/8 in. thick Type SCX, SHX, WRX, IP-X1, AR, C, IP-AR, IP-X2, IPC-AR, ULX, or WRC; 3/4 in. thick Types AR, IP-AR, IP-X3, ULTRACODE
UNITED STATES GYPSUM CO — 1/2 in. thick Type C, IP-X2, IPC-AR, or WRC; 5/8 in. thick Type AR, C, FRX-G, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SGX, SHX, ULX, WRX, or WRC; 3/4 in. thick Types AR, IP-AR or IP-X3, ULTRACODE
USG BORAL DRYWALL SFZ LLC — 1/2 in. Type C; 5/8 in. Types C, SCX, SGX, ULTRACODE
USG MEXICO S A DE CV — 1/2 in. thick Type C, IP-X2, IPC-AR, WRC; 5/8 in. thick Type AR, C, IP-AR, IP-X, IP-X2, IPC-AR, SCX, SHX, ULX, WRX or WRC; 3/4 in. thick Types AR, IP-AR, IP-X3, ULTRACODE

5A. **Gypsum Board** — (As an alternate to Item 5 when used as the base layer on one or both sides of wall. For direct attachment only, not to be used with Item 4) — Nom 5/8 in. or 3/4 in. may be used as alternate to 5/8 in. or 3/4 in. shown in Item 5, Wallboard Protection on Each Side of Wall table. Nom 5/8 in. or 3/4 in. thick lead backed gypsum panels with beveled, square or tapered edges, applied vertically or horizontally. Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. When the gypsum board panels are installed vertically all vertical joints must be centered over studs and staggered min 1 stud cavity on opposite sides of studs. Gypsum board secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 8 in. OC to the top and bottom tracks and in the field with screws 1 in. and 4 in. from the perimeter. For the 2 hour double layer system — when the gypsum board panels are installed horizontally the joints need not be staggered on opposite sides of assembly. Base layer secured on each side of the studs with 1-1/4 in. long Type S-12 bugle head steel screws spaced 16 in. OC to the top and bottom track and in the field with screws beginning 1 in. and 8 in. from the horizontal joints. Face layer horizontal joints staggered 8 in. from base layer joints and secured with 1-5/8 in. long Type S-12 bugle head steel screws spaced 16 in. OC to the top and bottom tracks and in the field with screws beginning 1 in. and 8 in. from the horizontal joints. Face layer screws offset 8 in. from base layer screws. When the gypsum board panels are installed vertically all vertical joints must be centered over studs and staggered min 1 stud cavity on opposite sides of studs. Face layer gypsum boards secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 16 in. OC with screws 2 in. and 16 in. from the perimeter. Base layer gypsum boards secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 16 in. OC with screws 1-1/2 in. and 8 in. from the perimeter. Face layer screws offset 8 in. from base layer screws.
CGC INC — Type USGX
UNITED STATES GYPSUM CO — 5/8 in. thick Type USGX (Joint tape and compound, Item 9, optional with Type USGX)
USG BORAL DRYWALL SFZ LLC — 5/8 in. thick Type USGX (Joint tape and compound, Item 9, optional with Type USGX)
USG MEXICO S A DE CV — Type USGX

gypsum panels with beveled, square or tapered edges, applied vertically. Vertical joints centered over 20 MSG steel studs and staggered min 1 stud cavity on opposite sides of studs. See Items 1A, 2A & 8A(a). Wallboard secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field. To be used with Lead Batten Strips (see Item 12) or Lead Discs or Tabs (see Item 13).
RAY-BAR ENGINEERS CORP. — Type RB-LBC

5B. **Gypsum Board** — (As an alternate to Items 5 and 5A) — Nom 5/8 in. thick gypsum panels with square edges, applied horizontally or vertically. For the 1 hour single layer system — when the gypsum board panels are installed horizontally the joints are to be staggered by a minimum of 12 in. on opposite sides of assembly, they are to be secured on each side of the studs with 1-1/4 in. long Type S-12 bugle head steel screws spaced 8 in. OC to the top and bottom tracks and in the field with screws 1 in. and 4 in. from the horizontal joints. When the gypsum board panels are installed vertically all vertical joints must be centered over studs and staggered min 1 stud cavity on opposite sides of studs. Gypsum board secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 8 in. OC to the top and bottom tracks and in the field with screws 1 in. and 4 in. from the perimeter. For the 2 hour double layer system — when the gypsum board panels are installed horizontally the joints need not be staggered on opposite sides of assembly. Base layer secured on each side of the studs with 1-1/4 in. long Type S-12 bugle head steel screws spaced 16 in. OC to the top and bottom track and in the field with screws beginning 1 in. and 8 in. from the horizontal joints. Face layer horizontal joints staggered 8 in. from base layer joints and secured with 1-5/8 in. long Type S-12 bugle head steel screws spaced 16 in. OC to the top and bottom tracks and in the field with screws beginning 1 in. and 8 in. from the horizontal joints. Face layer screws offset 8 in. from base layer screws. When the gypsum board panels are installed vertically all vertical joints must be centered over studs and staggered min 1 stud cavity on opposite sides of studs. Face layer gypsum boards secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 16 in. OC with screws 2 in. and 16 in. from the perimeter. Base layer gypsum boards secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 16 in. OC with screws 1-1/2 in. and 8 in. from the perimeter. Face layer screws offset 8 in. from base layer screws.
CGC INC — Type USGX
UNITED STATES GYPSUM CO — 5/8 in. thick Type USGX (Joint tape and compound, Item 9, optional with Type USGX)
USG BORAL DRYWALL SFZ LLC — 5/8 in. thick Type USGX (Joint tape and compound, Item 9, optional with Type USGX)
USG MEXICO S A DE CV — Type USGX

5C. **Gypsum Board** — (As an alternate to Item 5 when used as the base layer on one or both sides of wall. For direct attachment only, not to be used with Item 4) — Nom 5/8 in. thick lead backed gypsum panels with beveled, square or tapered edges, applied vertically. Vertical joints centered over studs and staggered min 1 stud cavity on opposite sides of studs. Wallboard secured to studs with 1-1/4 in. long Type S-12 (or #6 by 1-1/4 in. long bugle head fine driver) steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field.
NEW ENGLAND LEAD BURNING CO INC, DBA NELCO — Nelco

5D. **Gypsum Board** — (As an alternate to Item 5 when used as the base layer on one or both sides of wall. For direct attachment only, not to be used with Item 4) — Nom 5/8 or 3/4 in. may be used as alternate to 5/8 or 3/4 in. shown in Item 5, Wallboard Protection on Each Side of Wall table. Nom 5/8 or 3/4 in. thick lead backed gypsum panels with beveled, square or tapered edges, applied vertically. Vertical joints centered over 20 MSG steel studs and staggered min 1 stud cavity on opposite sides of studs. See Items 1A, 2A, 8A(a). Wallboard secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field. To be used with Lead Batten Strips (see Item 12) or Lead Discs (see Item 13A).
MAYCO INDUSTRIES INC — Type X-Ray Shielded Gypsum

5E. **Gypsum Board** — (As an alternate to Item 5 when used as the base layer on one or both sides of wall. For direct attachment only, not to be used with Item 4) — Nom 5/8 in. may be used as alternate to 5/8 in. shown in Item 5, Wallboard Protection on Each Side of Wall table. Nom 5/8 or 3/4 in. thick lead backed gypsum panels with beveled, square or tapered edges, applied vertically. Vertical joints centered over 20 MSG steel studs and staggered min 1 stud cavity on opposite sides of studs. See Items 1A, 2A & 8A(a). Wallboard secured to studs with 1-1/4 in. long Type S-12 steel screws spaced 8 in. OC at perimeter and 12 in. OC in the field. Lead batten strips required behind vertical joints of lead backed gypsum wallboard and optional at remaining stud locations. Lead batten strips, min 2 in. wide, max 6 ft long with a max thickness of 0.14 in. placed on the face of studs and attached to the stud with construction adhesive and two 1 in. long Type S-12 pan head steel screws, one at the top of the strip and one at the bottom of the strip. Lead discs, nominal 3/8 in. diam by max 0.085 in. thick. Compression fitted or adhered over the screw heads. Lead batten strips and discs to have a purity of 99.9% meeting the Federal specification QQ-L-2011, Grade "C".
RADIATION PROTECTION PRODUCTS INC — Type RPP - Lead Lined Drywall

5F. **Gypsum Board** — Gypsum panels with beveled, square or tapered edges, applied vertically or horizontally. Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Horizontal joints need not be backed by steel framing. Horizontal edge joints and horizontal butt joints on opposite sides of studs need not be staggered. Horizontal edge joints and horizontal butt joints between layers need not be staggered. When used in widths other than 48 in., gypsum panels to be installed horizontally. Insulation (Item 7C) required when using Type ULX for the 1 hour Rating. The thickness and number of layers and percent of design load are as follows:

Wallboard Protection on Each Side of Wall

Rating	No. of Layers & Thkns of Panel	% of Design Load
1 hr	1 layer, 5/8 in. thick	100
2 hr	2 layers, 5/8 in. thick	80
2 1/2 hr	2 layers, 5/8 in. thick	100

(*)Rating applicable when Batts and Blankets (Item 7) are used.
UNITED STATES GYPSUM CO — 5/8 in. thick Type ULX

6. **Fasteners** — (Not Shown) — For use with Item 5 and 5F - Type S-12 steel screws used to attach panels to runners (Item 1 or 1A) and studs (Item 2 or 2A) or furring channels (Item 8). **Single layer systems**: First layer: 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 8 in. OC when panels are applied horizontally, or 12 in. OC when panels are applied vertically. **Two layer systems**: First layer: 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC. Second layer: 1-5/8 in. long for 1/2 and 5/8 in. thick panels or 2-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC with screws offset 8 in. from first layer. **Three-layer systems**: First layer: 1 in. long for 1/2 in. thick panels, spaced 24 in. OC. Second layer: 1-5/8 in. long for 1/2 in. thick panels, spaced 24 in. OC. Third layer: 2-1/4 in. long for 1/2 in. thick panels, spaced 12 in. OC. Screws offset min 6 in. from layer below.

7. **Batts and Blankets** — (Required as indicated under Item 5 and 5F) — Nom 2 in. thick mineral wool batts, friction fitted between studs and runners. See **Batts and Blankets (B, B1, B2, B3, B4, B5, B6, B7, B8, B9, B10, B11, B12, B13, B14, B15, B16, B17, B18, B19, B20, B21, B22, B23, B24, B25, B26, B27, B28, B29, B30, B31, B32, B33, B34, B35, B36, B37, B38, B39, B40, B41, B42, B43, B44, B45, B46, B47, B48, B49, B50, B51, B52, B53, B54, B55, B56, B57, B58, B59, B60, B61, B62, B63, B64, B65, B66, B67, B68, B69, B70, B71, B72, B73, B74, B75, B76, B77, B78, B79, B80, B81, B82, B83, B84, B85, B86, B87, B88, B89, B90, B91, B92, B93, B94, B95, B96, B97, B98, B99, B100)** Categories for names of Classified companies.

7A. **Batts and Blankets** — (Optional, Not Shown) — Place in stud cavities, any glass fiber or mineral wool insulation bearing the UL Classification Marking on its Surface Characteristics and/or Fire Resistance. See **Batts and Blankets (B, B1, B2, B3, B4, B5, B6, B7, B8, B9, B10, B11, B12, B13, B14, B15, B16, B17, B18, B19, B20, B21, B22, B23, B24, B25, B26, B27, B28, B29, B30, B31, B32, B33, B34, B35, B36, B37, B38, B39, B40, B41, B42, B43, B44, B45, B46, B47, B48, B49, B50, B51, B52, B53, B54, B55, B56, B57, B58, B59, B60, B61, B62, B63, B64, B65, B66, B67, B68, B69, B70, B71, B72, B73, B74, B75, B76, B77, B78, B79, B80, B81, B82, B83, B84, B85, B86, B87, B88, B89, B90, B91, B92, B93, B94, B95, B96, B97, B98, B99, B100)** Categories for names of Classified companies.

7B. **Batts and Blankets** — (Optional, Not Shown) — Place in stud cavity, glass fiber insulation bearing the UL Classification Marking on its Surface Characteristics and/or Fire Resistance.
OWENS CORNING — Type Fiberglas Acoustic Batts

7C. **Fiber Spray** — (Optional) — As an alternate to Batts and Blankets (Item 7) — Not for use with Items 8A or 8B. Fiber applied to interior face of gypsum panels. The fiber is applied with adhesive, at a minimum density of 4.0 pcf, to cover 100% of the surface. The fiber is applied in accordance with the application instructions supplied with the product. See **OWENS CORNING** (CCAZ) or **AMERICAN ROCKWOOL MANUFACTURING, LLC** — Type Rockwool Premium Plus

8. **Batts and Blankets** — (Optional, Not Shown) — Place in stud cavities, any 3-1/2 in. thick glass fiber insulation bearing the UL Classification Marking as to Surface Characteristics and/or Fire Resistance. See **Batts and Blankets (B, B1, B2, B3, B4, B5, B6, B7, B8, B9, B10, B11, B12, B13, B14, B15, B16, B17, B18, B19, B20, B21, B22, B23, B24, B25, B26, B27, B28, B29, B30, B31, B32, B33, B34, B35, B36, B37, B38, B39, B40, B41, B42, B43, B44, B45, B46, B47, B48, B49, B50, B51, B52, B53, B54, B55, B56, B57, B58, B59, B60, B61, B62, B63, B64, B65, B66, B67, B68, B69, B70, B71, B72, B73, B74, B75, B76, B77, B78, B79, B80, B81, B82, B83, B84, B85, B86, B87, B88, B89, B90, B91, B92, B93, B94, B95, B96, B97, B98, B99, B100)** Categories for names of Classified companies.

9. **Furring Channels** — (Optional on one or both sides, not shown, for single or double layer systems) — Resilient furring channels fabricated from min 25 MSG corrosion-protected steel, spaced vertically a max of 24 in. OC.

Flange portion attached to each intersecting stud with 1/2 in. long Type S-12 panhead steel screws. Not for use with type FRX-G gypsum panels and Item 5A, 5C, 5D, or 5E.

8A. **Steel Framing Members (Not Shown)** — (Optional on one or both sides, not shown, for single or double layer systems) — As an alternate to Item 8, furring channels and Steel Framing Members as described below:
a. **Furring Channels** — Formed of No. 25 MSG galv steel, 2-3/8 in. wide by 7/8 in. deep, spaced max. 24 in. OC perpendicular to studs. Channels secured to studs as described in Item 6. Gypsum board attached to furring channels as described in Item 6. Not for use with type FRX-G gypsum panels and Item 5A, 5C, 5D, or 5E.
b. **Steel Framing Members** — Used to attach furring channels (Item 8a) to studs (Item 2). Clips spaced max. 48 in. OC, and secured to studs with No. 8 x 1-1/2 in. minimum self-drilling, S-12 steel screw through the center grommet. Furring channels are friction fitted into clips. RSIC-1 clip for use with 2-3/8 in. wide furring channels. RSIC-1 (2.75) clip for use with 2-3/8 in. wide furring channels.
PAC INTERNATIONAL L L C — Types RSIC-1, RSIC-1 (2.75)

8B. **Steel Framing Members** — (Not Shown) — (Optional on one or both sides, not shown, for single or double layer systems) — As an alternate to Item 8, furring channels and Steel Framing Members as described below:
a. **Furring Channels** — Formed of No. 25 MSG galv steel, 2-3/8 in. wide by 7/8 in. deep, spaced max. 24 in. OC perpendicular to studs. Channels secured to studs as described in Item 6. Gypsum board attached to furring channels as described in Item 6. Not for use with type FRX-G gypsum panels and Item 5A, 5C, 5D, or 5E.
b. **Steel Framing Members** — Used to attach furring channels to studs (Item 2). Clips spaced max. 48 in. OC, and secured to studs with No. 8 x 1-1/2 in. minimum self-drilling, S-12 steel screw through the center grommet. Furring channels are friction fitted into clips.
PLITEQ INC — Type GENIECLIP

8C. **Steel Framing Members** — (Not Shown) — (Optional on one or both sides, not shown, for single or double layer systems) — As an alternate to Item 8, furring channels and Steel Framing Members as described below:
a. **Furring Channels** — Formed of No. 25 MSG galv steel, 2-3/8 in. wide by 7/8 in. deep, spaced max. 24 in. OC perpendicular to studs as described in Item 6. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 AWG galvanized steel wire. Gypsum board attached to furring channels as described in Item 6. Not for use with type FRX-G gypsum panels and Item 5A, 5C, 5D, or 5E.
b. **Steel Framing Members** — Used to attach furring channels to studs (Item 2). Clips spaced max. 48 in. OC, and secured to studs with 2 in. coarse drywall screw through the center hole. Furring channels are friction fitted into clips.
STUDDO BUILDING SYSTEMS — RESILMOUNT Sound Isolation Clips - Type A237R

8D. **Steel Framing Members** — (Not Shown) — (Optional on one or both sides, not shown, for single or double layer systems) — As an alternate to Item 8, resilient channels and Steel Framing Members as described below:
a. **Furring Channels** — Formed of No. 18 AWG galvanized steel wire. Gypsum board attached to furring channels as described in Item 6. Not for use with type FRX-G gypsum panels and Item 5A, 5C, 5D, or 5E.
b. **Steel Framing Members** — Used to attach furring channels to studs (Item 2). Clips spaced max. 48 in. OC, and secured to studs with 2 in. coarse drywall screw through the center hole. Furring channels are friction fitted into clips.
REGUPO, AMERICA — Type SonusClip

8E. **Steel Framing Members** — (Not Shown) — (Optional on one or both sides, not shown, for single or double layer systems) — As an alternate to Item 8, resilient channels and Steel Framing Members as described below:
a. **Resilient Channels** — Formed of No. 25 MSG galv steel, spaced 24 in. OC, and perpendicular to studs. Channels secured to studs as described in Item 6. Ends of adjoining channels overlapped 6 in. and secured in place with two No. 8 15 x 1/2 in. Phillips Modified Truss screws spaced 2-1/2 in. from the center of the overlying gypsum board attached to resilient channels as described in Item 6. Not for use with type FRX-G gypsum panels and Item 5A, 5C, 5D, or 5E.
b. **Steel Framing Members** — Used to attach resilient channels (Item 8Ea) to studs (Item 2). Clips spaced 48 in. OC, and secured to studs with No. 8 x 2-1/2 in. coarse drywall screw through the center hole. Resilient channels are secured to clips with one No. 10 x 1/2 in. minimum self-drilling screw.
KEENE BUILDING PRODUCTS CO INC — Type RC4 Acoustic Clip

9. **Joint Tape and Compound** — Vinyl or casing, dry or prepackaged joint compound applied in two coats. Joints and screw heads of outer layers. Paper tape, nom 2 in. wide, embedded in first layer of compound around all joints of outer layers. Paper tape and joint compound to be certified when gypsum boards are secured to square edges of studs.

10. **Sliding, Brick or Stucco** — (Optional, Not Shown) — Aluminum, vinyl or steel sliding, brick veneer or stucco, meeting the requirements of local code agencies. Sliding attached to studs with corrugated metal ties attached to each stud with steel anchors. Not more than one sliding course of brick.

11. **Caulking and Sealant** — (Optional, Not Shown) — Acoustic sealant applied around the perimeter perimeter for sound control.
UNITED STATES GYPSUM CO — Type AS

12. **Lead Batten Strips** — (Not Shown, For Use With Item 5A) — Lead batten strips, min 1-1/2 in. wide, max 10 ft long with a max thickness of 0.142 in. Strips placed on the interior face of studs and attached to the exterior face of the studs with 1 in. long Type S-12 pan head steel screws, one at the top of the strip and one at the bottom of the strip. Lead batten strips to have a purity of 99.9% meeting the Federal specification QQ-L-2011, Grade "C". Lead batten strips required behind vertical joints of lead backed gypsum wallboard (Item 5A) and optional at remaining stud locations.

12A. **Lead Batten Strips** — (Not Shown, for use with Item 5D) — Lead batten strips, 2 in. wide, max 10 ft long with a max thickness of 0.142 in. Strips placed on the face of studs and attached to the stud with two min. 1 in. long min. 1 in. long min. Type S-8 pan head steel screws, one at the top of the strip and one at the bottom of the strip or with one min. 1 in. long min. Type S-8 pan head steel screw at the top of the strip. Lead batten strips to have a purity of 99.9% meeting the Federal specification QQ-L-2011, Grades "B, C or D". Lead batten strips required behind vertical joints of lead backed gypsum wallboard (Item 5D) and optional at remaining stud locations.

13. **Lead Discs or Tabs** — (Not Shown, For Use With Item 5A) — Used in lieu of or in addition to the lead batten strips (Item 12) or optional at other locations - Max 3/4 in. diam by max 0.125 in. thick lead discs compression fitted or adhered over steel screw heads or max 1/2 in. by 1-1/4 in. by max 0.125 in. thick lead tabs placed on gypsum boards (Item 5A) underneath screw locations prior to the installation of the screws. Lead discs or tabs to have a purity of 99.9% meeting the Federal specification QQ-L-2011, Grade "C".

13A. **Lead Discs** — (Not Shown, for use with Item 5D) — Max 5/16 in. diam by max 0.140 in. thick lead discs compression fitted or adhered over steel screw heads. Lead discs to have a purity of 99.9% meeting the Federal Specification QQ-L-2011, Grades "B, C or D".

14. **Lead Batten Strips** — (Not Shown, For Use With Item 5C) — Lead batten strips, 2 in. wide, max 10 ft long with a max thickness of 0.142 in. Strips placed on the face of studs and attached to the stud with two min. 1 in. long min. 1 in. long min. Type S-8 pan head steel screws, one at the top of the strip and one at the bottom of the strip or with one min. 1 in. long min. Type S-8 pan head steel screw at the top of the strip. Lead batten strips to have a purity of 99.9% meeting the Federal specification QQ-L-2011, Grade "C". Lead batten strips required behind vertical joints of lead backed gypsum wallboard (Item 5C) and optional at remaining stud locations.

15. **Lead Tabs** — (Not Shown, For Use With Item 5C) — 2 in. wide, 5 in. long with a max thickness of 0.142 in. Tabs friction fit around front face of stud, stud folded back flange, and the back face of the stud. Tabs required at each location where a screw that secures the gypsum boards (Item 5C) will penetrate the steel stud. Lead tabs to have a purity of 99.9% meeting the Federal specification QQ-L-2011, Grade "C". Lead tabs may be held in place with standard adhesive tape if necessary.

16. **Wall and Partition Facings and Accessories** — (Optional, Not Shown) — For use with Item 1, Item 2 to 2C, Item 3, Item 5, Item 6, Item 7A, Item 8 and Item 9. For a maximum fire rating of 1 hour. On one side of the wall, over the first layer of Gypsum Board (Item 5), install Reflexor membrane with the gold side facing outwards. Membrane installed with T60 staples spaced 12 inches on center in both directions as per manufacturer's instructions, seams in membrane to be overlapped by 2 inches. When Reflexor membrane is used an additional layer of Gypsum Board identical to the one used in the first layer and as specified in Item 5 shall be installed over the membrane. Additional layer of Gypsum Board to be installed through the membrane to the clip as specified in Item 5 except the fastener length shall be increased by a minimum of 5/8 inch. Install Batts and Blankets in the stud cavity as per

Item 7A. On the other side of the wall prior to the installation of the Gypsum Board install Resilient Channels as per Item 8. Over the Resilient Channels install 3/4 inch thick SONOPan panel secured to the Resilient Channels with drywall screws and washers spaced at 16 in. OC on the perimeter of the panel and 8 in. OC in the field of the panel. Over the SONOPan panel install the same Gypsum Board as specified in Item 5 with the fastener length increased by minimum 3/4 inch. Not evaluated or intended as a substitute for the required layers of UL Classified Gypsum Board.
MSL — Reflexor membrane, SONOPan panel.


* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

Last Updated on 2018-07-12

July 12, 2017

Non-Furring Wall Rating — 2 Hr

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

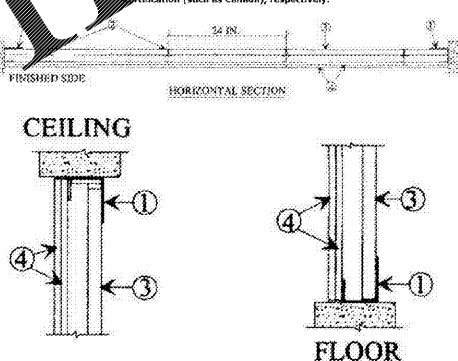

1. **Channel Track** — "T" shaped channel, 2-1/2 in. deep with channel legs of 1 in. and 2 in. fabricated from min.