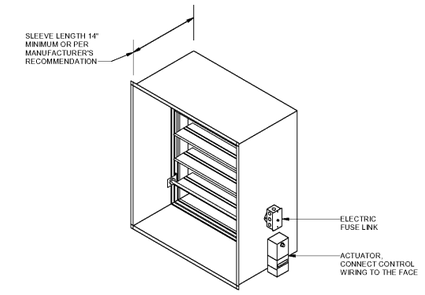

NOTE:
IF THE SLEEVE IS CONNECTED TO DUCT INSTEAD OF A GRILLE, ADD 2" TO SLEEVE LENGTH.

1 M004 FIRE SMOKE DAMPER
NOT TO SCALE

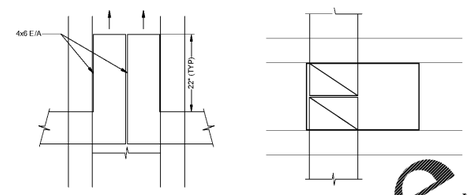

NOTE:
SIZE FREE AREA OF EXHAUST FRAME (NOT INCLUDING SPACE OCCUPIED BY SUBDUCTS) TO MAINTAIN 500 FPM VELOCITY (MAX 1000 AS PROJECTS MANUFACTURED BY EXHAUST OR SUBDUCT REQUIRE MANUFACTURER

2 M004 22" EXHAUST SUBDUCT
NOT TO SCALE

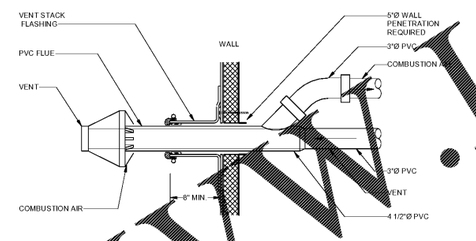

3 CONCENTRIC FLUE VENT
NOT TO SCALE

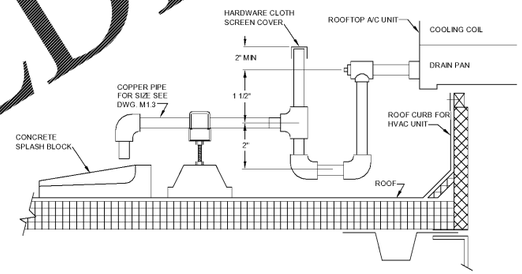

4 M004 CONDENSATE DRAIN DETAIL - SPLASH BLOCK
NOT TO SCALE

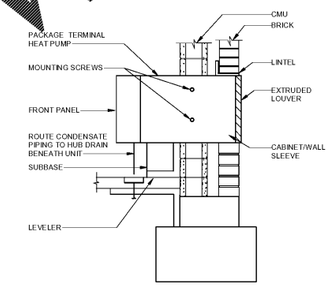

5 M004 PACKAGE TERMINAL HEAT PUMP MOUNTING
NOT TO SCALE

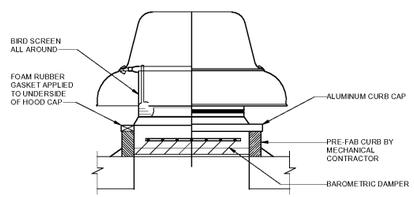

6 M004 ROOF-MOUNTED RELIEF HOOD
NOT TO SCALE

Order Plans @ WWW.LDILine.com

mcmillan pazdan smith ARCHITECTURE

CONSULTANT LOGO

DEVITA
ATLANTA • CHARLOTTE • GREENVILLE
RICHMOND
877.4.DEVITA • corp@devitainc.com
Devita & Associates, Inc. Project : 17239
NC Firm License # C-0819
Drawn By: ELZ Checked By: DV

SEALS

WINDSOR AUGHTRY

HOME2 ASHEVILLE

390 AIRPORT RD.
ARDEN, NC 28704

SHEET ISSUE:
07/30/18
FOR CONSTRUCTION

Revisions		
Number	Description	Date

PRINCIPAL IN CHARGE:
PROJECT ARCHITECT:
DRAWN BY:

SHEET TITLE:
MECHANICAL DETAILS

SHEET NO:
M004

PROJ. NO:
017376.00