


MECHANICAL KEY NOTES: []

- 1. HARD WIRED THERMOSTAT MOUNTED AT 48" A.F.F. COORDINATE ALL WIRING WITH ELECTRICAL CONTRACTOR.
- 2. EXHAUST DUCT FROM CENTRIFUGAL EXHAUST FAN ON ROOF ROUTED DOWN IN SHAFT OPENING. SEE SECTION DETAILS 2 THRU 6 ON SHEET M002 FOR MORE INFORMATION.
- 3. SUPPLY DUCT ROUTED FROM ROOFTOP MAU ON ROOF. SEE SECTION DETAIL 1 ON SHEET M002 FOR MORE INFORMATION.
- 4. PTHP TO BE MOUNTED IN WALL PER MANUFACTURER'S RECOMMENDATION. ROUTE CONDENSATE LINE FROM PTHP DOWN IN WALL AND DISCHARGE ON SPLASH BLOCK. SEE DETAILS 4 AND 5 ON SHEET M004 FOR MORE INFORMATION.
- 5. BOTTOM OF WALL CAP MINIMUM 9" A.F.F.
- 6. PTHP UNIT CONDENSATE PIPING TO BE ROUTED TO HUB DRAIN BENEATH UNIT.

mcmilian
pazdan
smith
ARCHITECTURE

ATLANTA CHARLOTTE GREENVILLE
RICHMOND
877.4.DEVITA
Devita & Associates, Inc. Project: 17239
NC Perm License # C-0819
ELZ Checked By: DV

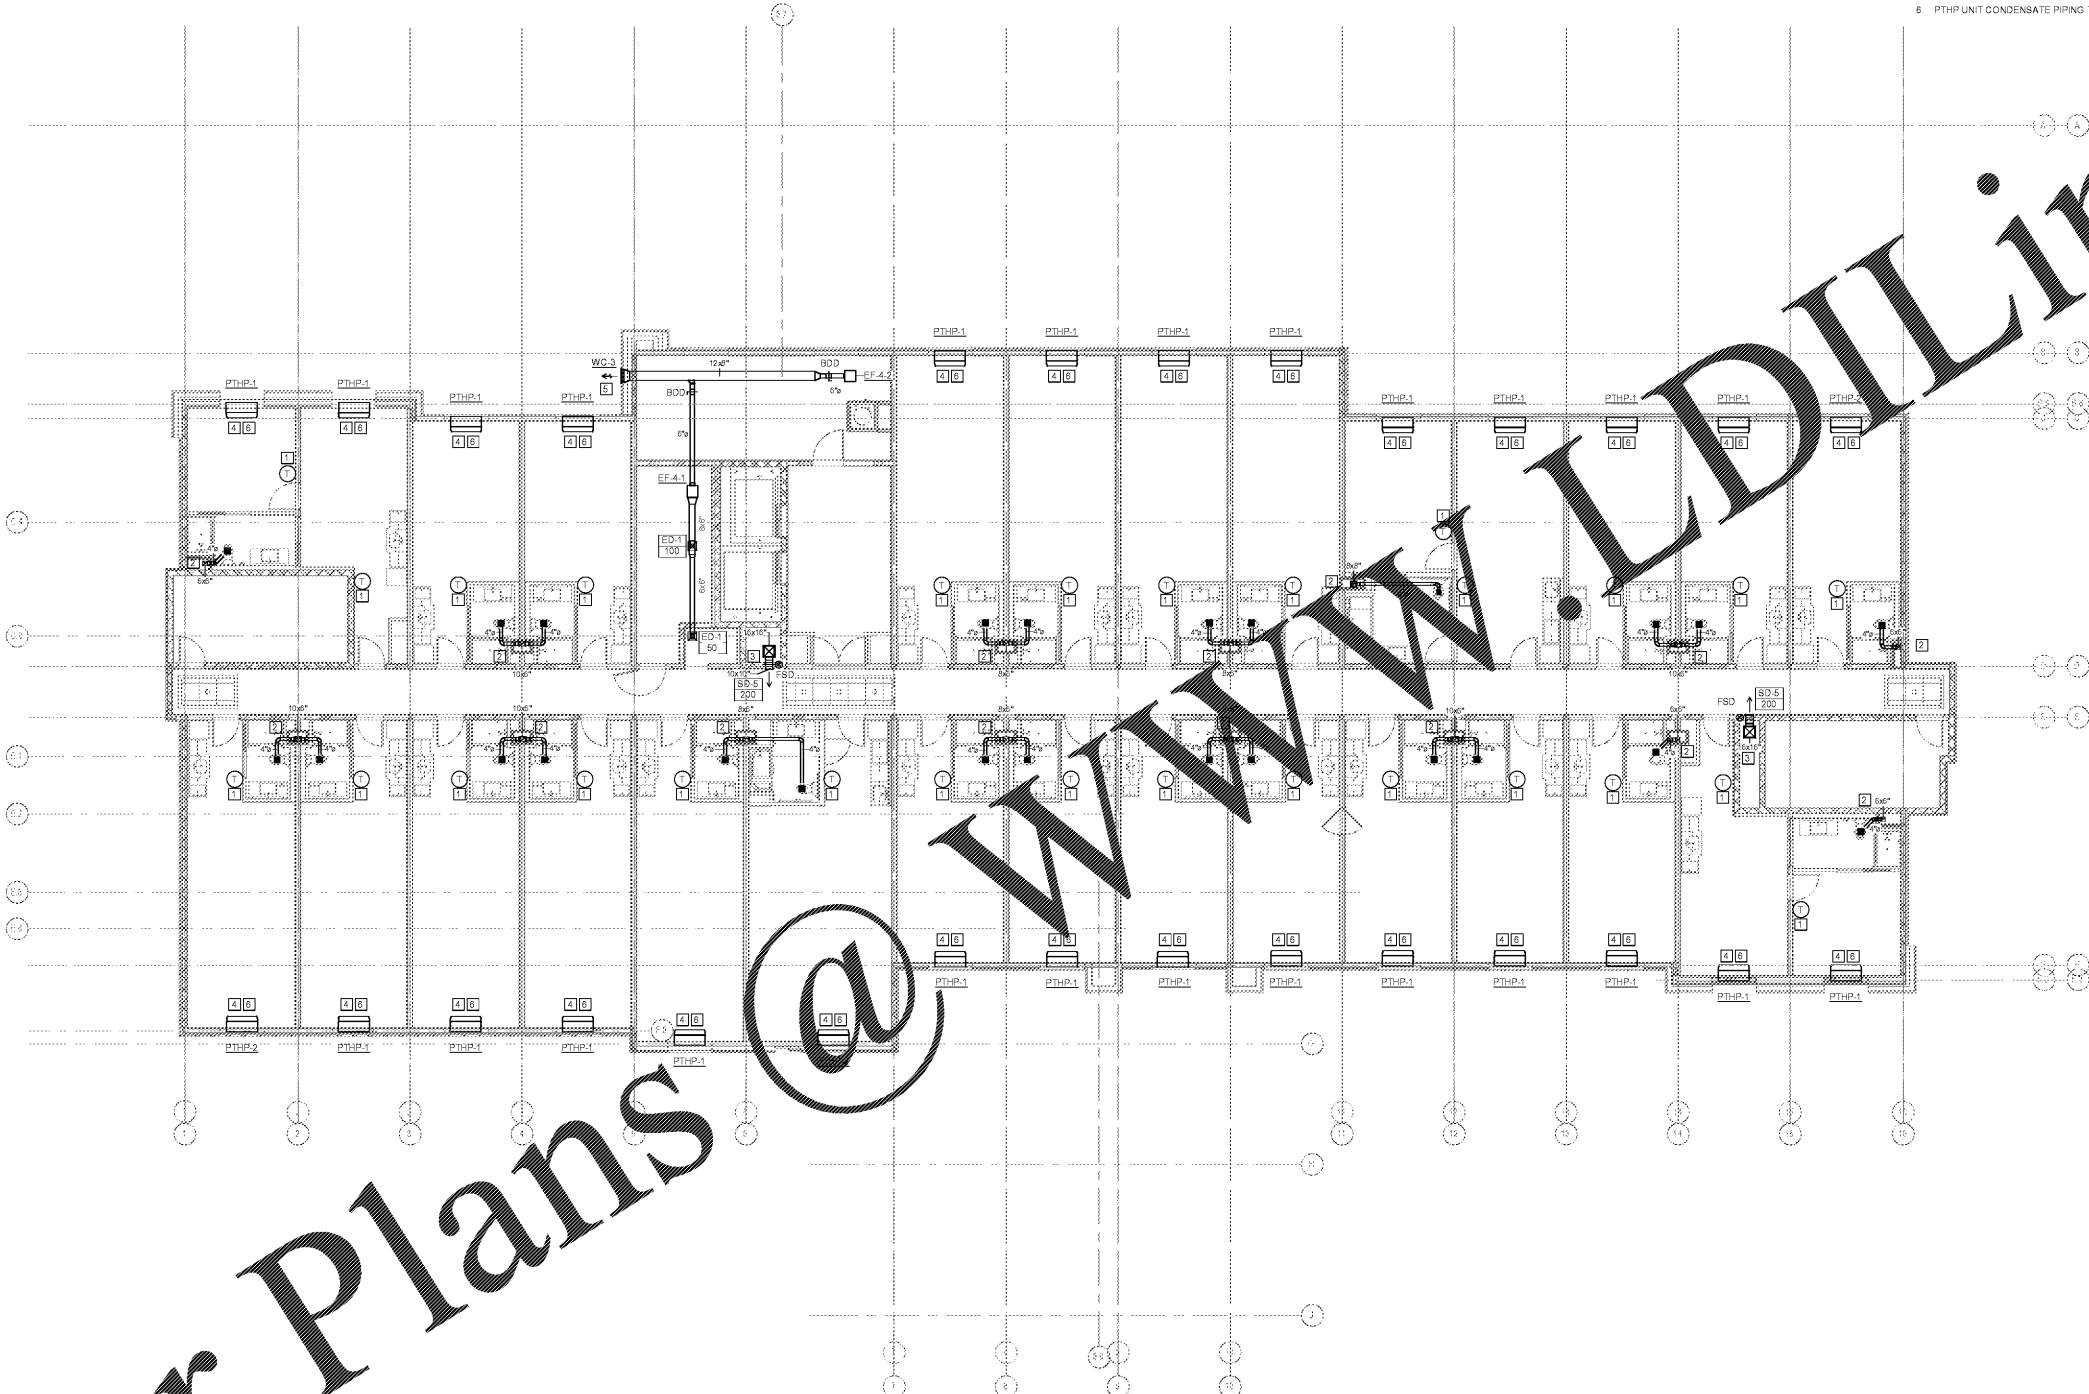

1 LEVEL 4 RCP FLOOR PLAN (HVAC)
M104
1/8" = 1'-0"

WINDSOR AUGHTRY
HOME2 ASHEVILLE
380 AIRPORT RD.
ASHEVILLE, NC 28704

SHEET ISSUE:
07/30/18
FOR CONSTRUCTION

Revisions		
Number	Description	Date

PRINCIPAL IN CHARGE:
PROJECT ARCHITECT:
DRAWN BY:
SHEET TITLE:
LEVEL 4 FLOOR
PLAN - HVAC

SHEET NO. PROJ. NO.
M104 017878.00

Order Plans @ www.LDILine.com